BANGALORE WATER SUPPLY
AND SEWERAGE BOARD
CAUVERY BHAVAN, KEMPEGOWDA ROAD
BANGALORE - 560 009

Telephone: 91-80-22945108 Fax: 91-80-22945108

Through Karnataka Public Procurement Portal

KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP)

TENDER FOR THE WORK OF

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERTIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A]

AND

PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS – B]

HYBRID MODE FOR BOMMANAHALLI ZONE IN 110 VILLAGE AREAS (Phase II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) – (Contract Package No. BWSSB CE-P/KWSDRP/WBS-III)

VOLUME 4 of 4

(DRAWINGS)

APRIL – 2025

Office of the *Chief Engineer (Project)*
BANGALORE WATER SUPPLY & SEWERAGE BOARD
3rd Floor, Cauvery Bhavan,
K.G. Road,
Bangalore -560 009
www.kppp.karnataka.gov.in

CONTENTS			
Volumes	**Part**	**Sections**	**Description**
Volume-1	**Bidding Procedures**	**Section -1**	Invitation for Tenders (IFT)
		Section-2	Instructions to Tenderers (ITT)
		Section-3	Qualification Information and Evaluation Methodology
		Section-4	Form of Tender, Letter of Acceptance, Notice to Proceed with the work and Agreement Form
		Section-5	Conditions of Contract (CC) and Special Conditions of Contract (SCC)
		Section-6	Contract Data and Appendix to Special Conditions of Contract
		Section- 7	Form of Technical proposal (Volume-2)
		Section- 8	Drawings (Volume-4)
		Section- 9	Form of Price Proposal (Volume-3)
		Section-10	Format of Bank Guarantee for Security Deposit
Volume-2	**Technical Specifications and Technical Schedules**	**Section - 7 of Volume-1**	**Specifications**
			Part-1: Project Details
			Part-2: The Site
			Part-3: General Requirements
			Part-4: General Workmanship, Materials and Design Requirements for Plant
			Part-5: Process Requirements
			Part-6: General Electrical Requirements
			Part-7: Instrumentation Control and Automation Works
			Part-8: General Mechanical Requirements
			Part-9: General Painting and Protection Requirement
			Part-10: Civil, Structural and Sewer Network Requirements
			Part-11: Particular Technical Specifications for Civil, Structural and Sewer Network
			Part-12: Particular Electrical Plant Requirements
			Part-13: Particular Instrumentation & Control Requirements
			Part 14: Inspection, Testing and Commissioning Requirements
			Part 15: Training & Advisory Requirements

CONTENTS			
Volumes	**Part**	**Sections**	**Description**
			Part 16: Operation & Maintenance
			Part 17: Handing Over
			Part 18: Environmental Management Plan (EMP) and Environmental Monitoring Plan (EMoP)
		Section- 7A	**Form of Technical proposal**
		Section- 7B	**Technical Schedules**
			Technical Schedule - I: Construction Programme
			Technical Schedule-II: Proposed Plant Details
			Technical Schedule-III: Instrumentation Control & Automation Equipment's
			Technical Schedule-IV: Electrical works
			Technical Schedule V: Operating Details
			Technical Schedule VI: Schedule of Subcontractors
			Technical Schedule VII: Quality Assurance and Quality Control Plan
			Technical Schedule VIII: Environmental Management Plan
			Technical Schedule IX: Safety Plan
			Technical Schedule X: Functional Guarantees of the Plant
			Technical Schedule XI: Statement of Deviation from the Technical Specifications
Volume -3	**Price Proposal**	**Section- 9A**	Form of Price Proposal
		Section- 9B	Price schedule
Volume-4	**Drawings**	**Section - 8**	Drawings

VOLUME-4

WBS-3

DRAWINGS

List of Drawings of WBS-3		
Sl. No.	**Drawing No:**	**List of drawings**
1	TN-KWSDRP-WBS3-CV-3000	Proposed Waste Water Treatment Plants (WwTPs)
2	TN-KWSDRP-WBS3-CV-3008	Topographical Survey for Proposed WwTP 10MLD at U M Kaval Bangalore
3	TN-KWSDRP-WBS3-CV-3009	Topographical Survey Layout of Proposed WwTP 15 MLD at Hulimavu, Bangalore
4	TN-KWSDRP-WBS3-CV-3010	Topographical Survey Layout of Proposed WwTP 35MLD at Anjanapura Bangalore
5	TN-KWSDRP-WBS3-CV-3011	Topographical Survey for Proposed ISPS 4 MLD at Gottigere Bangalore
6	TN-KWSDRP-WBS3-CV-3012	Topographical Survey Layout of Proposed ISPS 3 MLD at Vakil Garden Lake Bangalore
7	TN-KWSDRP-WBS3-CV-3013	Topographical Survey Layout of Proposed WwTP 5 MLD at Ibluru Bangalore
8	TN-KWSDRP-WBS3-CV-3026	RCC Precast Sewer Machine hole details - 1200 mm dia. (Typical) for depth upto 3.0 M
9	TN-KWSDRP-WBS3-CV-3027	RCC Precast Sewer Machine hole details - 1500 mm dia. (Typical) for depth upto 3.0 M
10	TN-KWSDRP-WBS3-CV-3028	RCC Precast Sewer Machine hole details - 1500 mm dia. (Typical) for depth upto 7.0 M
11	TN-KWSDRP-WBS3-CV-3029	RCC Precast Sewer Machine hole details - 1800 mm dia. (Typical) for depth upto 3.0 M
12	TN-KWSDRP-WBS3-CV-3030	RCC Precast Sewer Machine hole details - 1800 mm dia. (Typical) for depth upto 6.0 M
13	TN-KWSDRP-WBS3-CV-3031	RCC Precast Sewer Machine hole details - 1800 mm dia. (Typical) for depth up to 8.0 M
14	TN-KWSDRP-WBS3-CV-3032	RCC Precast Sewer Machine hole details - 1800 mm dia. (Typical) for depth up to 10.0 M
15	TN-KWSDRP-WBS3-CV-3033	Standard Details of RCC Cast In-situ Machine hole - 1200mm, 1500mm and 1800 mm dia. Up to 3.0 m and 1500 mm , 1800 mm dia. Up to 6m depth (Typical)
16	TN-KWSDRP-WBS3-CV-3034	RCC Cast In-situ machine hole - 1200mm, 1500mm and 1800 mm dia. Up to 3.0 M to 6 M depth (Typical)
17	TN-KWSDRP-WBS3-CV-3035	RCC Precast Sewer Machine hole details for 1200, 1500 & 1800 mm dia. (Vertical wall)
18	TN-KWSDRP-WBS3-CV-3036	Standard Details of RCC Cast In-situ Machine hole 1200 mm, 1500mm, 1800mm Dia. Upto 3 M depth. 1500mm, 1800mm upto 6 M depth (Typical) with Ventilation Shaft
19	TN-KWSDRP-WBS3-CV-3037	Plan & Section of Brick Masonary Manchine hole for 1.2m dia., 2 M & 6 M Depth
20	TN-KWSDRP-WBS3-CV-3038	Plan & Section of Brick Masonary Manchine hole for 1.5 m dia., 2 m & 6 m Depth
21	TN-KWSDRP-WBS3-CV-3039	Typical Drawing of Pipe Bedding/Encasing
22	TN-KWSDRP-WBS3-CV-3040	Typical Cross Sections for Restoration of Ashpalt & Concrete Roads
23	TN-KWSDRP-WBS3-CV-3052	5MLD WWTP at Iblur Process Flow Diagram
24	TN-KWSDRP-WBS3-CV-3053	10MLD WWTP at U M Kaval Process Flow Diagram
25	TN-KWSDRP-WBS3-CV-3054	15MLD WWTP at Hulimavu Process Flow Diagram
26	TN-KWSDRP-WBS3-CV-3055	35MLD WWTP at Anjanapura Process Flow Diagram
27	TN-KWSDRP-WBS3-EL-4001	Electrical Single Line Diagram (SLD) for Electrical works at Waste Water Treatment Plant (WWTP) - Typical
28	TN-KWSDRP-WBS3-EL-4002	Electrical Single Line Diagram for Electrical works at ISPS (Typical) SH 01 of 02
29	TN-KWSDRP-WBS3-EL-4002	Electrical Single Line Diagram for Electrical works at ISPS (Typical) SH 02 of 02
30	TN-KWSDRP-WBS3-EL-4003	Electrical Single Line Diagram (SLD) for Electrical works at Lift Pumping Station (Typical)
31	TN-KWSDRP-WBS3-EL-4004	Electrical Single Line Diagram for Electrical works at Waste Water Treatment Plant (WWTP) with Reuse and Solar Sludge Drying Beds-Typical
32	TN-KWSDRP-WBS3-EL-4005	Electrical Single Line Diagram for Electrical works at Waste Water Treatment Plant (WWTP) with Bio-Gas Generation and Reuse
33	TN-KWSDRP-WBS3-IC-5003	SCADA Control system Architecture Drawing for WwTP at Iblur
34	TN-KWSDRP-WBS3-IC-5004	SCADA Control system Architecture Drawing for WwTP at U M Kaval
35	TN-KWSDRP-WBS3-IC-5005	SCADA Control system Architecture Drawing for WwTP at Hulimavu
36	TN-KWSDRP-WBS3-IC-5006	SCADA Control system Architecture Drawing for WwTP at Anjanapura
37	TN-KWSDRP-WBS3-IC-5011	Control system Architecture Drawing for Intermediate Sewage Pumping Station (ISPS) at Gottigere
38	TN-KWSDRP-WBS3-IC-5012	Control system Architecture Drawing for Intermediate Sewage Pumping Station (ISPS) at Vakil Garden
39	TN-KWSDRP-WBS3-ME-6000	Typical Mechanical GA Drawing for Lift Pumping Station
40	TN-KWSDRP-WBS3-HFD-6010	Typical Hydraulic Flow Diagram for Intermediate Sewage Pumping Station

TITLE: PROPOSED WASTE WATER TREATMENT PLANTS (WWTPS)

DWG NO: TN-KWSDRP-WBS3-CV-3000

NORTH

LEGEND:-

- 110 VILLAGES
- CMC AREA
- TMC AREA
- CORE AREA
- MAJOR ROAD
- VILLAGE BOUNDARY
- RAILWAY TRACK

PROPOSED STPs LOCATIONS UNDER WORLD BANK SCHEME

PROPOSED WwTP

YELAHANKA CMC
BYTRAYANAPURA CMC
DASARAHALLI CMC
K.R PURAM CMC
MAHADEVPURA CMC
R.R NAGAR CMC
KENGERI TMC
BOMMANAHALLI CMC
CORE AREA
HEBBAL VALLEY
HEBBAL MINOR VALLEY
VRISHBHAVATHY VALLEY
CHALLAGATTA VALLEY
ARKAVATHI VALLEY
KATHRIGUPPE VALLEY
TAVARAKERE VALLEY

HAROHALLI, GOVINDAPURA, YASUDEVPURA, MANCHANAHALLI, ANANTHAPURA, KENCHANAHALLI, Attur Lake, KATTIGENAHALLI, DODDABETTAHALLI, CHIKKABETTAHALLI, BELLAHALLI, THIRUMANAHALLI, CHOKKANAHALLI, ABBIGERE, CHIKKALASANDRA, MYADARAHALLI, SIDDENEHALLI, SHETTYHALLI, From Byrathi WwTP to CMC, N.NAGENAHALLI, KOTHANUR, KOTHANUR, NAGAYAKAPURA, BYRATHI, KYLASANAHALLI, BILISHIVALLI, RACHENAHALLI, DHANISANDRA, DASARAHALLI, KEDDALAHALLI, S. CHANNASANDRA, KORAMAVU AGRAHARA, KALKERE, VARANASI, CHALLAKERE, KORAMAVU, DODDABIDARAKALLU, KARIVOBANAHALLI, HANDRAHALLI, LINGADENAHALLI, HOSAHALLI, HEROHALLI, GIDAKONDANAHALLI, ULLALA, SONNANAHALLI, BELATHUR & KUMBENA AGRAHARA, KADUGODI PLANTATION, CHANNASANDRA, NAGONDANAHALLI, NAGADUR, KANEKANDYA, SORAHUNISE, TUBARAHALLI, SIDDAPURA, RAMAGONDANAHALLI, BELLANDUR KERE, BALAGERE, VARTHUR, PANATHUR, GUNJUR, KARIYAMMANA AGRAHARA, DEVARA BEESANAHALLI, BELLANDUR, BHOGANAHALLI, AMBALIPURA, DODDA KANNALLI, KASAVANAHALLI, CHIKKA BELLANDUR, SUNNASANDRA, HARALURU, KUDLU, PARAPPANAEAGRAHARA, NAGANATHAPURA, BASAPURA, CHIKKATHOGURU, BHARTHENAGRAHARA, AREHALLI, VADDARAPALYA, UTTARAHALLI, SUBRAMANYAPURA, GANAKAL, VASANTHPUR, TURAHALLI, GUBBULU, DODDAKALLASANDRA, HEMIGEPURA, SOMAPURA, HEMIGEPURA, MANAVARTHIKAVU, VARAHASANDRA, LINGADEERNAHALLI, HOSAHALLI, RAGHUVANA HALLI, THIPPASANDRA, VAJRA HALLI, ALAHALLI, ANJANAPURA, GOLAHALLI, KEMBETHAHALLI, PILLAGANAHALLI, GOTTIGERE, KAMMANAHALLI, KALENA AGRAHARA, CHANDRASEKARAPURA, YELLANAHALLI, BEGUR, BASAVANAPURA, Iblur Proposed 5MLD WwTP, Vakil Garden 3MLD Proposed ISPS, U Manavarthikaval 10MLD Proposed WwTP, Anjanapura 35MLD Proposed WwTP, Gottigere 4MLD Proposed ISPS, Hulimavu 15MLD Proposed WwTP

P0	02/04 2025	FOR TENDER PURPOSE	SGS	MKV		
ISSUE	DATE	DESCRIPTION	BY	CIVIL		APPD.
			CHECKED			

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: Proposed Waste Water Treatment Plants (WwTPs)

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3000	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3000.dwg		A1 SIZE

TITLE: TOPOGRAPHICAL SURVEY LAYOUT FOR PROPOSED WWTP 10MLD AT U M KAVAL BANGALORE

DWG NO: TN-KWSDRP-WBS3-CV-3008

N1422800

N1422700

N1422600

E773900

E774000

E774100

NORTH

PROPOSED RCC PRECAST COMPOUND WALL

Metro Pillar (under Construction)

A1 840.362

A2 839.997

TBM1 839.447

838.25

838.75

837.50

836.75

836.25

835.75

835.50

PROPOSED GABBION WITH CHAIN LINK FENCING

PROPOSED GABBION WITH CHAIN LINK FENCING

Stream

HFL:836.200

KEY PLAN

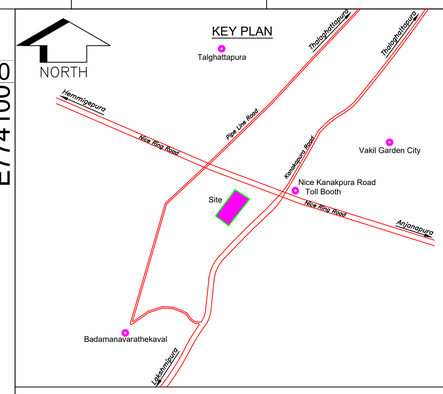

NOTES:

1. ALL LEVELS ARE IN METERS,UNLESS OTHER WISE MENTIONED.
2. ALL LEVELS ARE CARRIED FROM GTS BM (RL 903.20 M) LOCATED IN TRINITY CHURCH AT TRINITY CIRCLE.

LEGEND

DESCRIPTION	TYPE
ASPHALT ROAD	
COVERED DRAIN	
OPEN/LINED DRAIN	
COMPOUND WALL	
FENCE	
CHAMBER	CH
TELEPHONE POLE	
ELECTRIC BOX	E
POWER LINE & POLE	
TRANSFORMER	
TREES & TREE GIRTH	
BUILDING	
PRECAST COMPOUND WALL	
PROPOSED CHAIN LINK FENCING WITH GABBION	
CONTOUR WITH CONT RL	881
SPOT LEVELS	881.437
DRAIN CENTER/INVERT LEVELS	883.577
TRAVERSE POINTS	B1
BENCH MARKS	RBM1

AREA STATEMENT

Area in Sqmt	Area in Acre
16094.28	3.97

CONTRACTOR SHALL PROPOSE THE COMPLETE WWTP UNITS INCLUDING TSPS WITHIN THE AREA SHOWN IN HATCHED PORTION ACCORDINGLY MAXIMUM AREA AVAILABILITY IS ONLY 3.97 ACRES

PROPOSED AREA FOR WWTP

ISSUE	DATE	DESCRIPTION	SGS	MKV				APPD.
P0	02/04 2025	FOR TENDER PURPOSE	BY	DE				CHECKED

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:
TOPOGRAPHICAL SURVEY LAYOUT FOR PROPOSED WwTP 10MLD AT U M KAVAL BANGALORE

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: –	DWG. NO. TN-KWSDRP-WBS3-CV-3008	ISSUE: P0
FILE NAME: U M KAVAL WWTP– 10MLD.dwg		A1 SIZE

TITLE: TOPOGRAPHICAL SURVEY LAYOUT FOR PROPOSED WWTP
15MLD AT HULIMAVU, BANGALORE

DWG NO: TN-KWSDRP-WBS3-CV-3009

NORTH

E782500 E782600 E782700

N1423800 N1423700

Proposed Area for 15MLD WwTP

10 MLD STP at Hulimavu

PROPOSED GABBION WITH CHAIN LINK FENCING

PROPOSED GABBION WITH CHAIN LINK FENCING

PROPOSED PRECAST COMPOUND WALL

EXISTING PRECAST COMPOUND WALL

ENTRY

HFL:898.500

Valmark CityVille Apartment

Fence

Stream

Asphalt Road

Metalled Road

Building

Lined Drain

Compound Wall

Pump House

Fence

895.50 895.75 896.25 896.75 897.50 898.25 898.75 899.25

KEY PLAN :

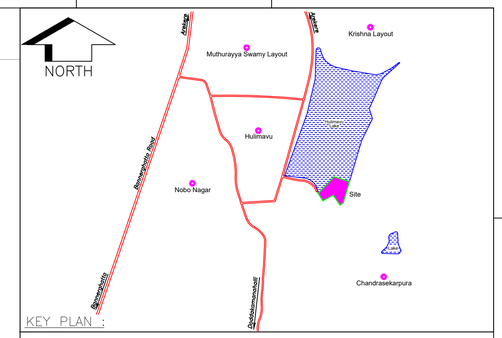

NOTES:

1. ALL LEVELS ARE IN METERS,UNLESS OTHER WISE MENTIONED.
2. ALL LEVELS ARE CARRIED FROM GTS BM (RL 903.20 M) LOCATED IN TRINITY CHURCH AT TRINITY CIRCLE.

LEGEND

DESCRIPTION	TYPE
ASPHALT ROAD	
COVERED DRAIN	
OPEN/LINED DRAIN	
COMPOUND WALL	
FENCE	
CHAMBER	CH
TELEPHONE POLE	
ELECTRIC BOX	E
POWER LINE & POLE	
TRANSFORMER	
TREES & TREE GIRTH	G1m
BUILDING	
PRECAST COMPOUND WALL	
PROPOSED CHAIN LINK FENCING WITH GABBION	
CONTOUR WITH CONT RL	895
SPOT LEVELS	881.437
DRAIN CENTER/INVERT LEVELS	883.577
TRAVERSE POINTS	B1
BENCH MARKS	RBM1

AREA STATEMENT

Area in Sqmt	Area in Acre
9961.231	2.46

CONTRACTOR SHALL PROPOSE THE COMPLETE WWTP UNITS INCLUDING TSPS WITHIN THE AREA SHOWN IN HATCHED PORTION ACCORDINGLY MAXIMUM AREA AVAILABILITY IS ONLY 2.46 ACRES

PROPOSED AREA FOR WWTP

ISSUE	DATE	DESCRIPTION	BY	DES			APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV			
			CHECKED				

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS (WORKS - A) AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS (WORKS - B) HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:
TOPOGRAPHICAL SURVEY LAYOUT FOR PROPOSED WwTP
15MLD AT HULIMAVU, BANGALORE

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: –	DWG. NO. TN-KWSDRP-WBS3-CV-3009	ISSUE: P0
FILE NAME: HULIMAVU WWTP– 15MLD.dwg		A1 SIZE

TITLE: TOPOGRAPHICAL SURVEY LAYOUT FOR PROPOSED WWTP
35MLD AT ANJANAPURA BANGALORE

DWG NO: TN-KWSDRP-WBS3-CV-3010

NORTH

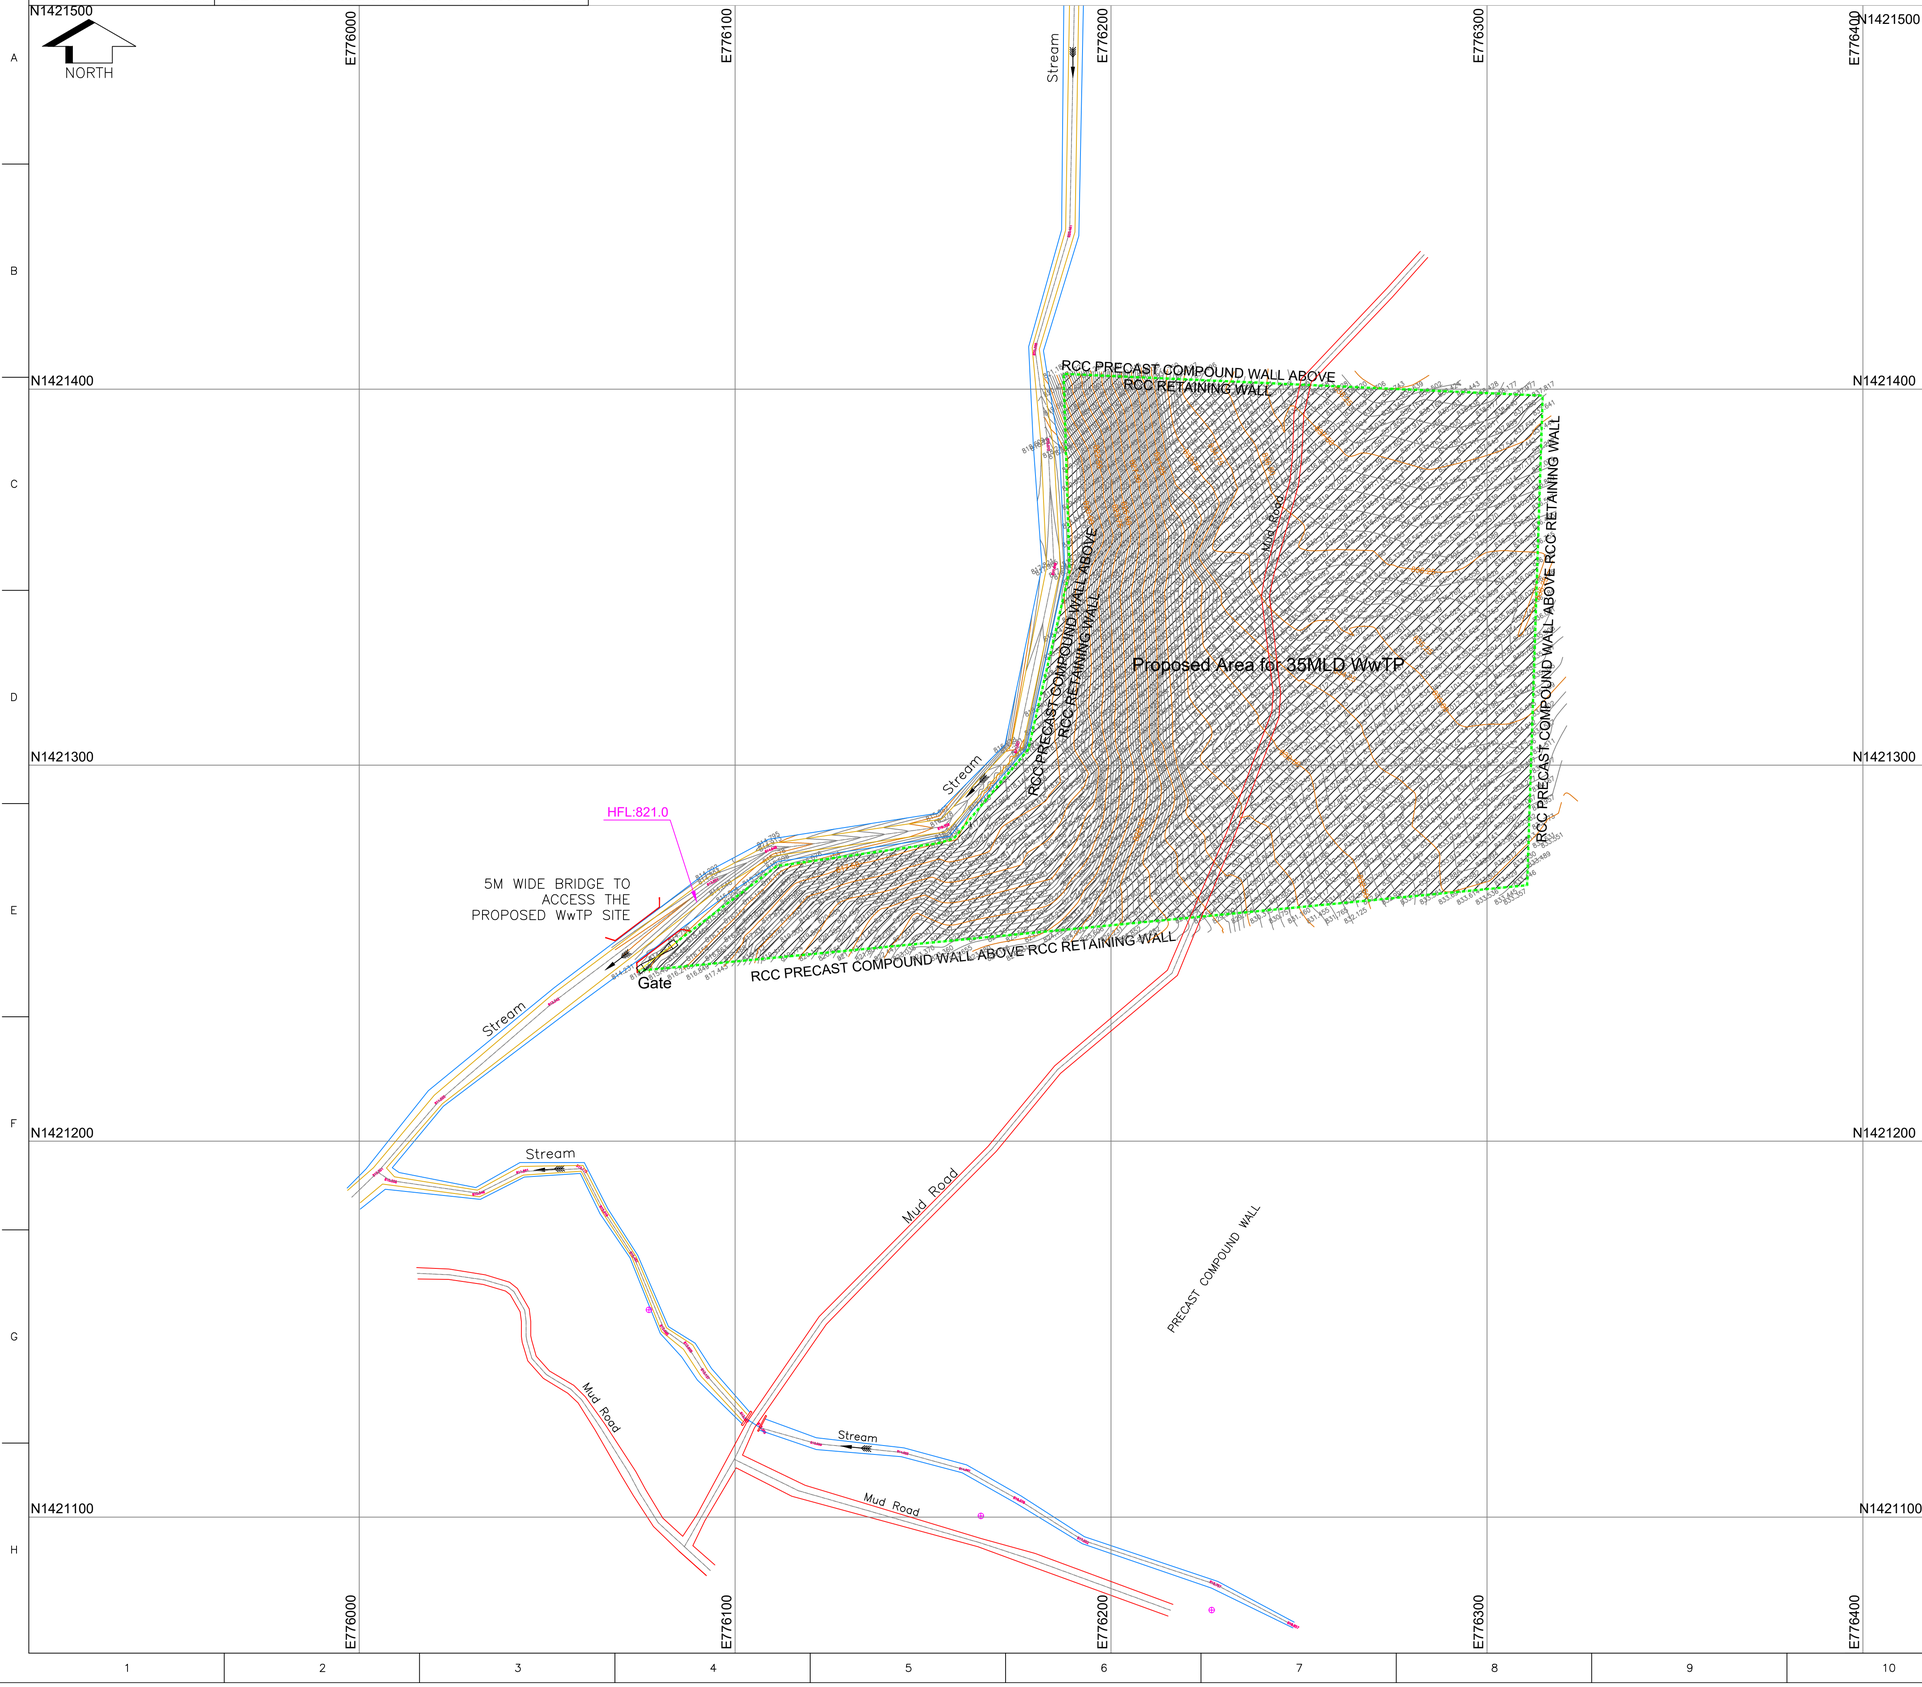

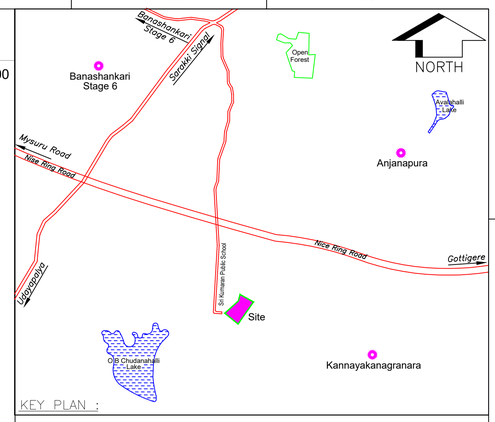

NOTES:

1. ALL LEVELS ARE IN METERS,UNLESS OTHER WISE MENTIONED.
2. ALL LEVELS ARE WITH REFERENCE TO THE GTS BENCH MARK ENGRAVED ON CENTER OF 2ND STONES ON EAST SIDE OF QUEEN VICTORIA'S STATUE LOCATED INIS TRINITY CHURCH AT TRINITY CIRCLE. 903.20M.

LEGEND

DESCRIPTION	TYPE
ASPHALT ROAD	
COVERED DRAIN	
OPEN/LINED DRAIN	
COMPOUND WALL	
FENCE	
CHAMBER	CH
TELEPHONE POLE	
ELECTRIC BOX	E
POWER LINE & POLE	
TRANSFORMER	
TREES & TREE GIRTH	0.15m
BUILDING	
RCC PRECAST COMPOUND WALL ABOVE RCC RETAINING WALL	
PROPOSED CHAIN LINK FENCING WITH GABBION	
CONTOUR WITH CONT RL	881
SPOT LEVELS	881.437
DRAIN CENTER/INVERT LEVELS	883.577
TRAVERSE POINTS	B1
BENCH MARKS	RBM1

AREA STATEMENT

Area in Sqmt	Area in Acre
20423.61	5.04

CONTRACTOR SHALL PROPOSE THE COMPLETE WWTP UNITS INCLUDING TSPS WITHIN THE AREA SHOWN IN HATCHED PORTION ACCORDINGLY MAXIMUM AREA AVAILABILITY IS ONLY 5.04 ACRES

PROPOSED AREA FOR WWTP

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: TOPOGRAPHICAL SURVEY LAYOUT FOR PROPOSED WwTP 35MLD AT ANJANAPURA BANGALORE

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: –	DWG. NO. TN-KWSDRP-WBS3-CV-3010	ISSUE: P0
FILE NAME: ANJANAPURA WWTP– 35MLD.dwg		A1 SIZE

TITLE: TOPOGRAPHICAL SURVEY FOR PROPOSED ISPS- 4MLD AT GOTTIGERE BANGALORE

DWG NO: TN-KWSDRP-WBS3-CV-3011

NORTH

E781000 E781050 E781100 E781150 E781200

N1422100 N1422050 N1422000

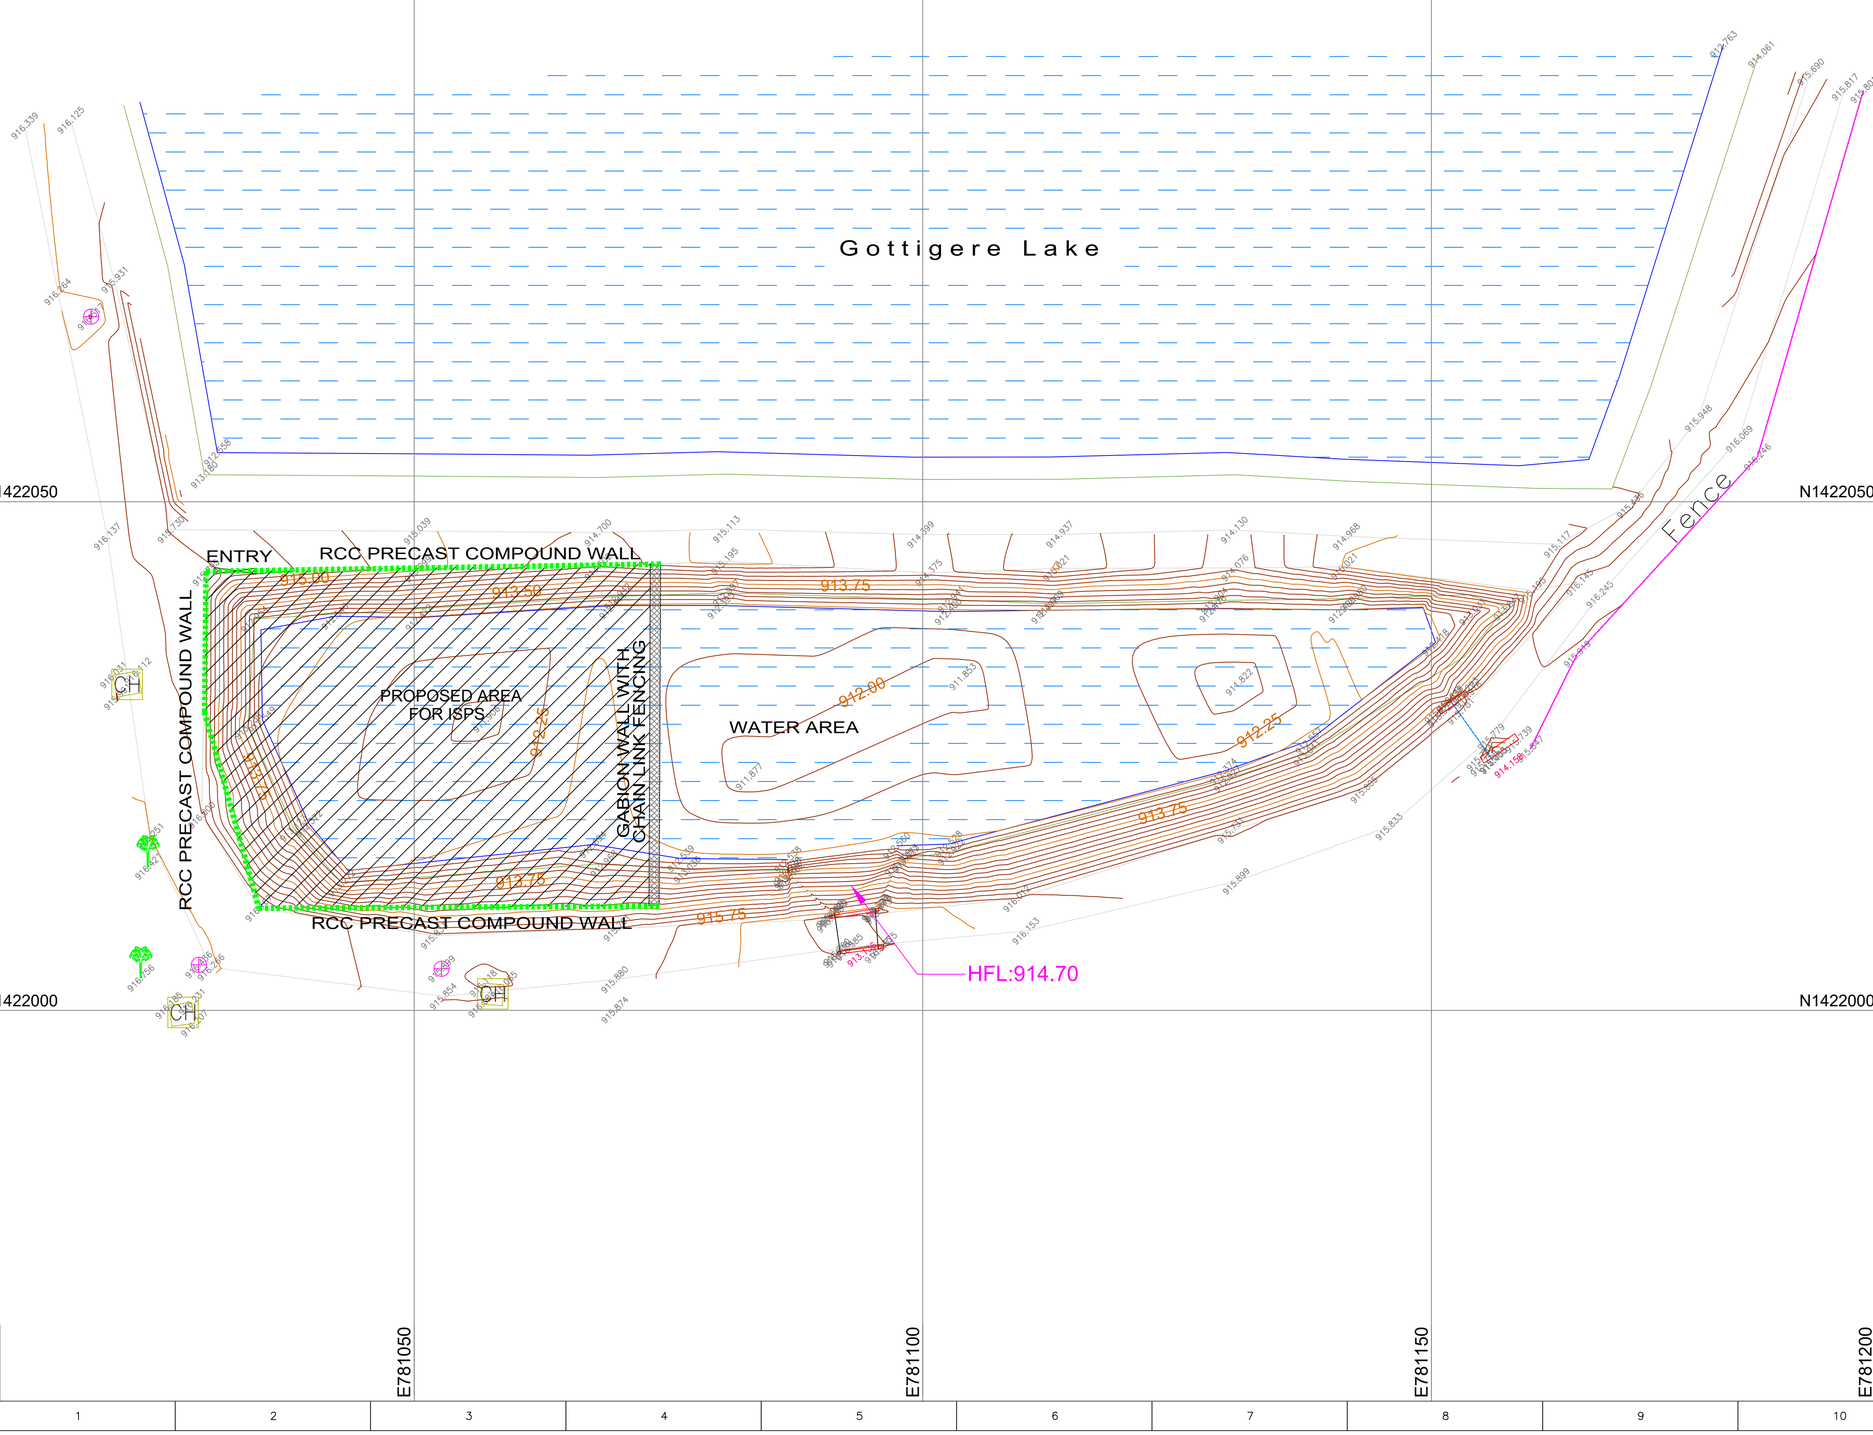

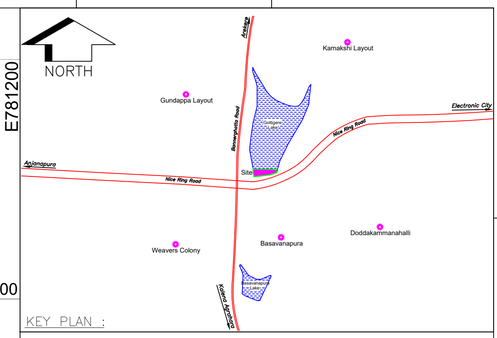

NOTE:-

1. ALL DIMENSIONS ARE IN Mts. UNLESS OTHERWISE MENTIONED.
2. ALL LEVELS ARE CARRIED FROM GTS BM (RL 903.20 M) LOCATED IN TRINITY CHURCH AT TRINITY CIRCLE.

LEGEND

DESCRIPTION	TYPE
ASPHALT ROAD	
COVERED DRAIN	
OPEN/LINED DRAIN	
COMPOUND WALL	
FENCE	
CHAMBER	CH
TELEPHONE POLE	
ELECTRIC BOX	E
POWER LINE & POLE	
TRANSFORMER	
TREES & TREE GIRTH	
BUILDING	
BOUNDARY LINE	
CONTOUR WITH CONT RL	
SPOT LEVELS	881.437
DRAIN CENTER/INVERT LEVELS	883.577
TRAVERSE POINTS	B1
BENCH MARKS	RBM1

TOTAL AREA FOR SITE

Area in Sqmt	Area in Acre
1441.09	0.356

CONTRACTOR SHALL PROPOSE THE COMPLETE ISPS UNITS WITHIN THE AREA SHOWN IN HATCHED PORTION. ACCORDINGLY MAXIMUM AREA AVAILABILITY IS ONLY 0.356 ACRES

PROPOSED AREA FOR ISPS

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
T0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: TOPOGRAPHICAL SURVEY FOR PROPOSED ISPS- 4MLD AT GOTTIGERE BANGALORE

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: –	DWG. NO. TN-KWSDRP-WBS3-CV-3011	ISSUE: T0
FILE NAME: TN-KWSDRP-WBS3-CV-3011.dwg		A1 SIZE

TITLE: TOPOGRAPHICAL SURVEY FOR PROPOSED ISPS- 1MLD AT VAKIL GARDEN LAKE BANGALORE

DWG NO: 8.TN-KWSDRP-WBS3-CV-3012

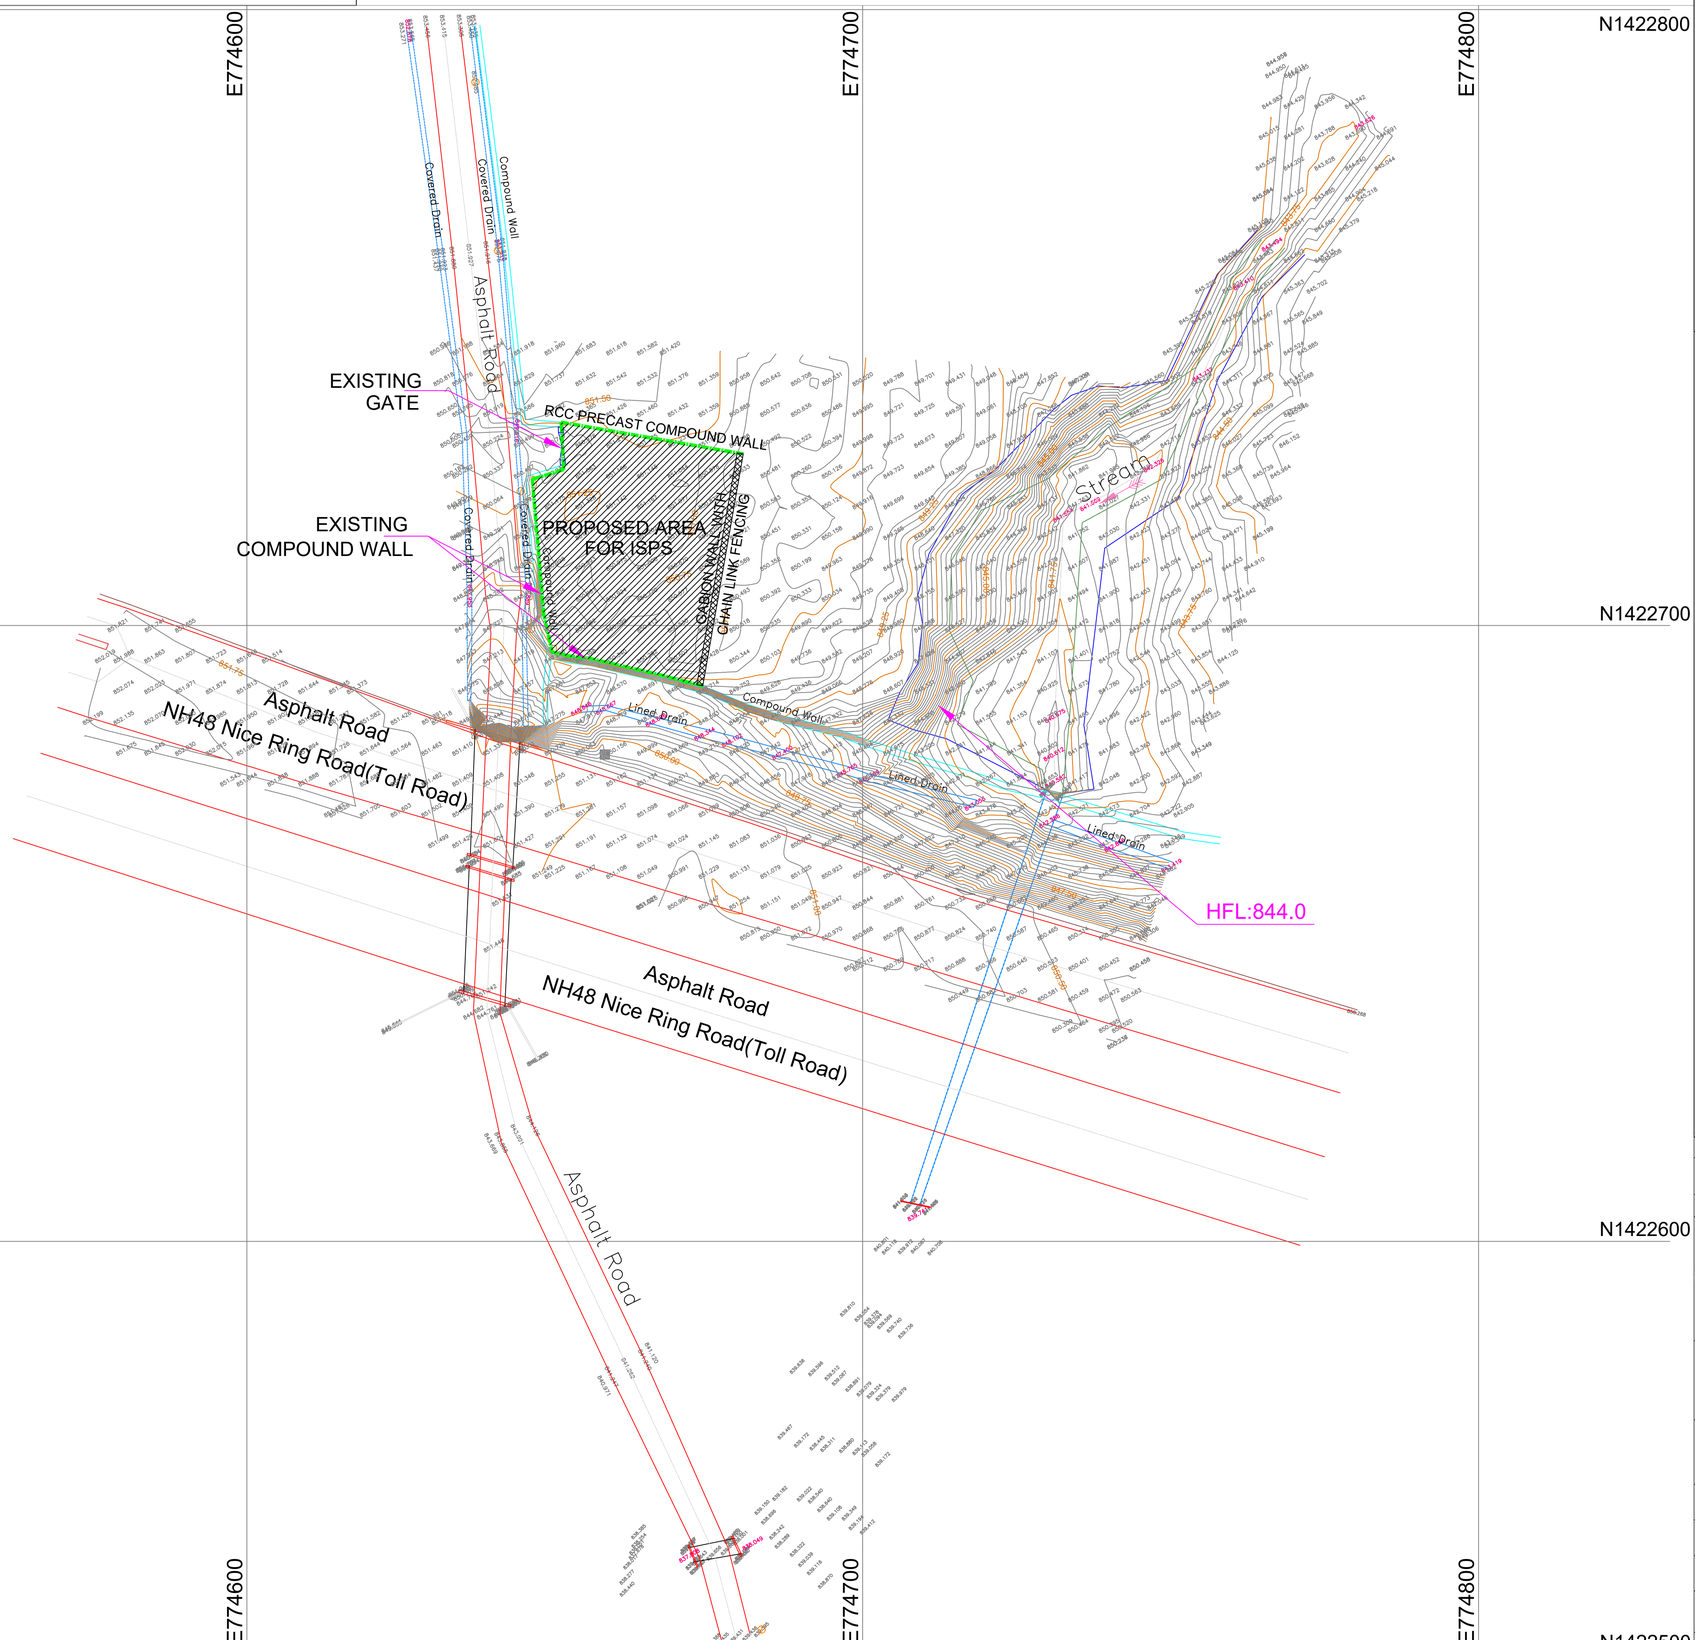

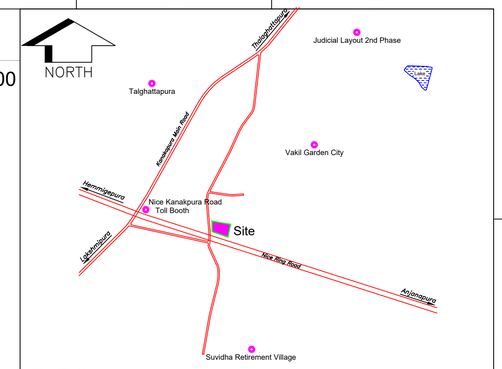

KEY PLAN :

NOTE:–
1. ALL DIMENSIONS ARE IN Mts. UNLESS OTHERWISE MENTIONED.
2. ALL LEVELS ARE CARRIED FROM GTS BM (RL 903.20 M) LOCATED IN TRINITY CHURCH AT TRINITY CIRCLE.

LEGEND

DESCRIPTION	TYPE
ASPHALT ROAD	
COVERED DRAIN	
OPEN/LINED DRAIN	
COMPOUND WALL	
FENCE	
CHAMBER	CH
TELEPHONE POLE	
ELECTRIC BOX	E
POWER LINE & POLE	
TRANSFORMER	
TREES & TREE GIRTH	815a
BUILDING	
BOUNDARY LINE	
CONTOUR WITH CONT RL	
SPOT LEVELS	881.457
DRAIN CENTER/INVERT LEVELS	883.577
TRAVERSE POINTS	B1
BENCH MARKS	RBM1

TOTAL AREA FOR SITE

Area in Sqmt	Area in Acre
1061.46	0.262

CONTRACTOR SHALL PROPOSE THE COMPLETE ISPS UNITS WITHIN THE AREA SHOWN IN HATCHED PORTION. ACCORDINGLY MAXIMUM AREA AVAILABILITY IS ONLY 0.262 ACRES

PROPOSED AREA FOR ISPS

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
T0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: TOPOGRAPHICAL SURVEY FOR PROPOSED ISPS- 1MLD AT VAKIL GARDEN LAKE BANGALORE

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: –	DWG. NO. 8.TN-KWSDRP-WBS3-CV-3012	ISSUE: T0
FILE NAME: VAKIL GARDEN LAKE ISPS– 1MLD.dwg		A1 SIZE

TITLE: TOPOGRAPHICAL SURVEY LAYOUT FOR PROPOSED WWTP 5MLD AT IBBLURU BANGALORE

DWG NO: TN-KWSDRP-WBS3-CV-3013

NORTH

E789200 E789300 E789400

N1430100 N1430000 N1429900

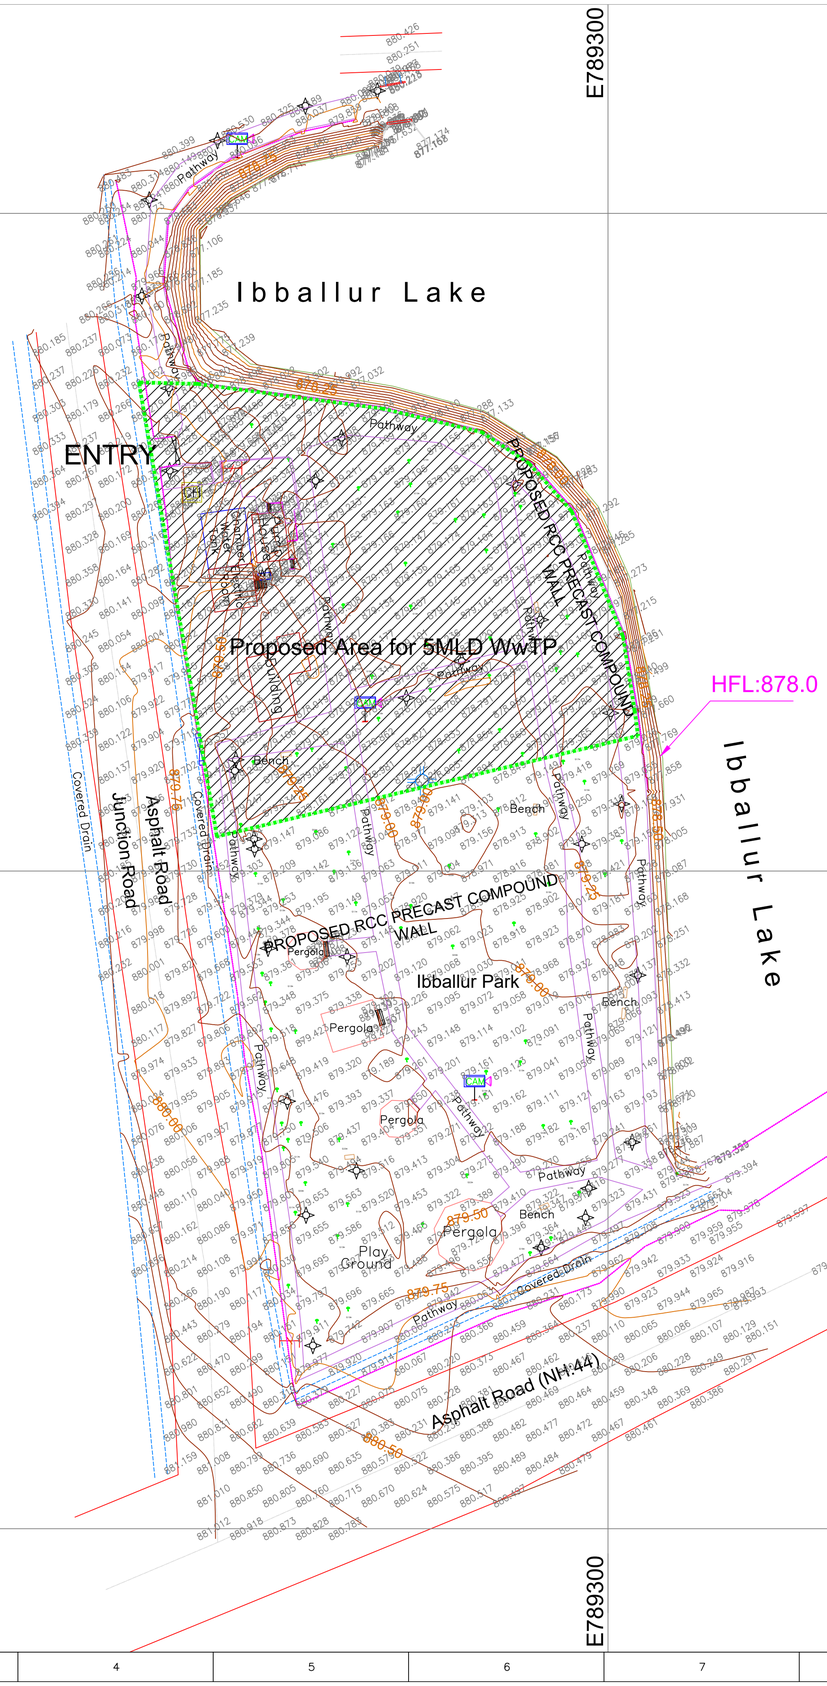

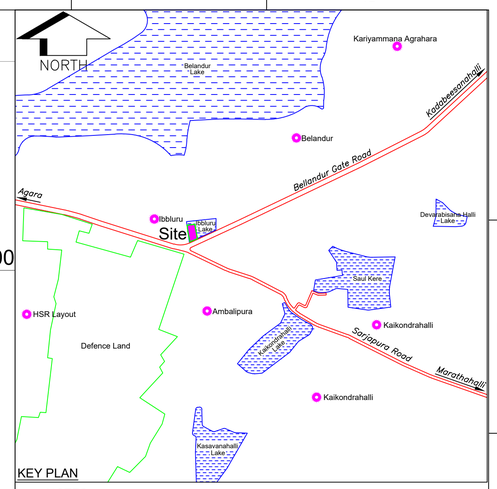

NOTES:

1. ALL LEVELS ARE IN METERS,UNLESS OTHER WISE MENTIONED.
2. ALL LEVELS ARE CARRIED FROM GTS BM (RL 903.20 M) LOCATED IN TRINITY CHURCH AT TRINITY CIRCLE.

LEGEND

DESCRIPTION	TYPE
ASPHALT ROAD	
COVERED DRAIN	
OPEN/LINED DRAIN	
COMPOUND WALL	
FENCE	
CHAMBER	CH
TELEPHONE POLE	
ELECTRIC BOX	E
POWER LINE & POLE	
TRANSFORMER	
TREES & TREE GIRTH	61.1m
BUILDING	
PRECAST COMPOUND WALL	
PROPOSED CHAIN LINK FENCING WITH GABBION	
CONTOUR WITH CONT RL	881
SPOT LEVELS	881.437
DRAIN CENTER/INVERT LEVELS	883.577
TRAVERSE POINTS	B1
BENCH MARKS	RBM1

AREA STATEMENT

Area in Sqmt	Area in Acre
3686.30	0.91

CONTRACTOR SHALL PROPOSE THE COMPLETE WWTP UNITS INCLUDING TSPS WITHIN THE AREA SHOWN IN HATCHED PORTION ACCORDINGLY MAXIMUM AREA AVAILABILITY IS ONLY 0.91 ACRES

PROPOSED AREA FOR WWTP

ISSUE	DATE	DESCRIPTION					
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV			
			BY	DES			APPD.
			CHECKED				

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-4)

TITLE: TOPOGRAPHICAL SURVEY LAYOUT FOR PROPOSED WwTP 5MLD AT IBBLURU BANGALORE

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: –	DWG. NO. TN-KWSDRP-WBS3-CV-3013	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3013-IBBLURU WWTP.dwg		A1 SIZE

TITLE: RCC PRECAST SEWER MACHINE HOLE DETAILS 1200MM DIA (TYPICAL) FOR DEPTH UPTO 3.0M

DWG NO: TN-KWSDRP-WBS3-CV-3026

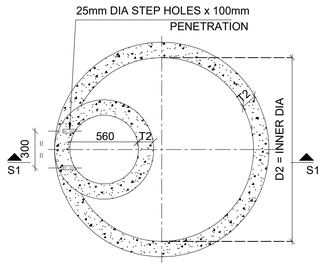

1 PLAN AT MACHINE HOLE TOP LVL
SCALE : NTS

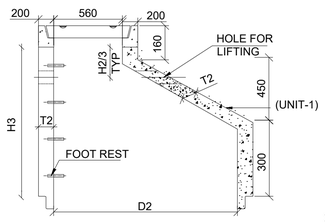

3 DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS



DETAIL OF 'Y'
TYP.JOINING DETAILS OF 1200 DIA PRECAST SEGMENT



DETAILS OF 'Z'
TYP.JOINING DETAILS OF 1200 DIA PRECAST SEGMENT

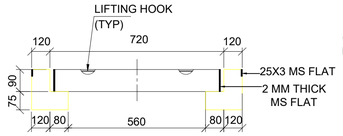

DETAIL OF 'X'
HD-20 MACHINE HOLE COVER

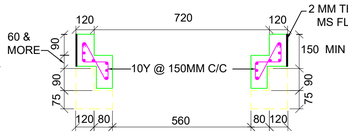

ADDITIONAL MACHINE HOLE HEIGHT TO MATCH FINISHED ROAD LEVEL



DETAILS OF BASE SLAB



DETAIL OF 'U'



TYPICAL PLASTIC ENCAPSULATED FOOT REST DETAILS

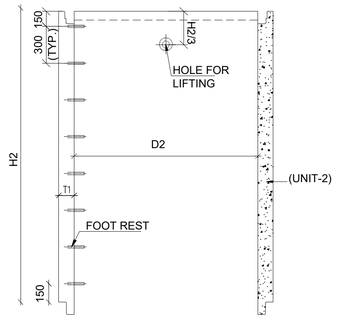

4 DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS

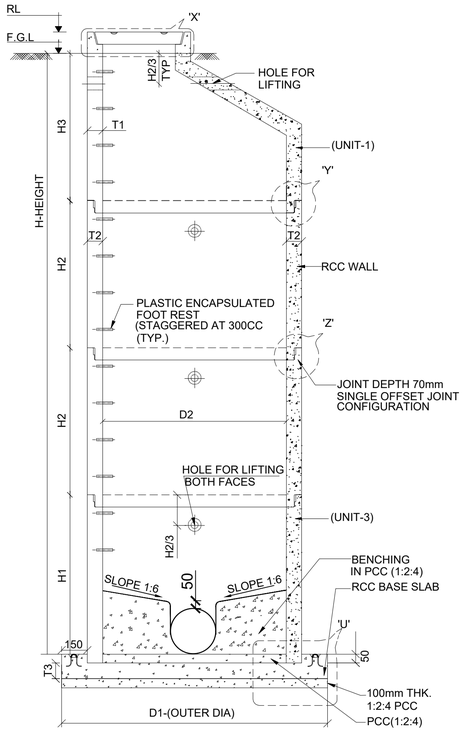

2 SECTION S1-S1
SCALE : NTS

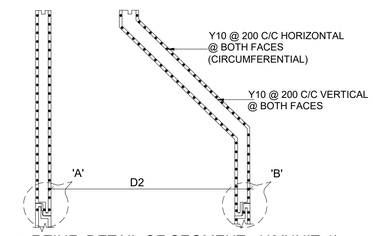

5 REINF. DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS

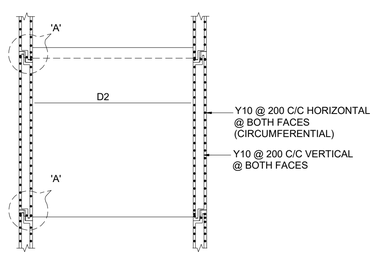

6 REINF. DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS



JOINING DETAIL - 'A'

JOINING DETAIL - 'B'

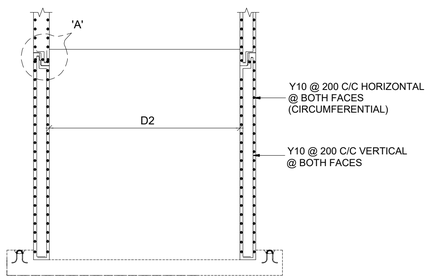

7 REINF. DETAIL OF SEGMENT - H1(UNIT-3)
SCALE : NTS



8 REINF. DETAIL OF BASE SLAB
SCALE : NTS

STANDARD DATA FOR PRECAST MACHINE HOLE								
1	**BASE SECTION**							PROVISION
a)	SIZE(DIAMETER) IN mm							1200
b)	DIA WISE DIMENSIONS							
	INNER DIA.OF BASE(D2) (mm)	WALL THK.(T1) (mm)	WALL THK.(T2) (mm)	JOINT DEPTH (mm)	BASE THK.(T3) (mm)	OUTER DIA.OF BASE(D1) (mm)	HEIGHT	
	1200	200	200	50	200	1900	UPTO 3m	
c)	AVAILABLE HEIGHT FOR BASE IN MM(H1)							300 TO 700 OR AS REQUIRED
d)	HOLES FOR SEWER CONNECTIONS							100mmØ MORE THAN OUTER Ø OF SEWER
e)	A)MAT CONCRETE THICKNESS IN MM & MIX							100mmTHICK,1:2:4 MIX
	B)CONCRETE MIX FOR WALL AND BASE							RCC M30 GRADE
f)	CONCRETE FILL FOR BENCHING							1:2:4, MIX WITH 1:6 SLOPE
g)	REINFORCEMENT							
	a)FOR BASE SLAB							AS PER RC DETAIL
	b)FOR WALL							AS PER RC DETAIL
2	**RISER SECTION**							
a)	AVAILABLE HEIGHT FOR RISER SECTION (H2)							300 TO 900 OR AS REQUIRED
b)	WALL THICKNESS IN MM							200mm
c)	JOINT THICKNESS AND JOINT MATERIAL							SAME AS BASE SECTION
d)	REINFORCEMENT IN THE WALL							AS PER DETAIL DRG.
3	**ECCENTRIC CONE SECTION**							
a)	SHAPE							ECCENTRIC CONE
b)	CONCRETE FILL AROUND SEWER							1:1.5:3MIX
c)	THICKNESS(T2)							200mm
d)	REINFORCEMENT							AS PER DETAIL DRG.
e)	TOP OPENING							560mm
f)	JOINT DEPTH							AS PER DETAIL DRG.
4	**STANDARD MACHINE HOLE FRAME AND COVER**							AS PER IS 12592-2002
a)	SHAPE							FLAT
b)	COVER SIZE							560mm
c)	SPECIFICATION							HD-20

NOTE:

1. ALL DIMENTIONS ARE IN mm AND ALL LEVELS ARE IN METER.
2. THE LIFTING HOLES SHALL BE FILLED WITH CONCRETE 1:1.5:3 MIX.
3. 3mm PVC ENCAPSULATE ON 12mm BAR, FOOT STEPS Fe 500.
4. THE NON CORE OPENING SHALL BE 100mm GREATER THAN THE OUTER DIA OF SEWER
5. SINGLE OFFSET JOINT CONFIGURATION SHALL BE ADOPTED AT THE JOINT.
6. THE JOINT SHALL BE SEALED WITH NON SHRINK GROUT/SINGLE RUBBER SEAL SHALL BE PROVIDED IN PRECAST UNITS.RUBBER GASKET SHALL BE AS PER IS 5382.
7. 150mm LIP IS OPTIONAL UNLESS OTHERWISE NOTED.
8. GRADE OF CONCRETE SHALL BE RCC M30 MIX FOR MANHOLE WALL AND FOR BASE SLAB WITH SULPHATE RESISTANCE CEMENT.
9. ALL REINFORCEMENT BARS SHALL BE HYSD CRS BARS OF GRADE Fe 500 CONFORMING TO IS:1786.
10. CLEAR COVER TO MAIN REINFORCEMENT SHALL BE:
    a)WALL SOIL SEWAGE FACE=50mm
    b)BASE SLAB =50mm
11. THIS DRAWING IS ONLY TYPICAL CONSTRUCTION DRAWING. THE CONTRACTOR HAS TO TAKE PRIOR APPROVAL TO THE PROCESS OF MANUFACTURE OF THE PRECAST MANHOLE.
12. NET SAFE BEARING CAPACITY IS ASSUMED TO BE 10 TON/Sq.m. IF LOWER SBC ENCOUNTERED, THE BASE SLAB THICKNESS SHALL BE INCREASED AS PER DIRECTION OF ENGINEER.
13. PRE CAST FRAME AND COVER AS PER IS:12592-2002.
14. LOWEST FOOT REST SHALL NOT BE MORE THAN 300mm ABOVE BENCHING.
15. FOR MINIMUM DEPTH-MANHOLES(1.25m), WHEREVER OCCURS,THE CONICAL SECTION AND THE RISER SEGMENT (H1) MAY BE CAST AS A SINGLE UNIT BASED ON THE SITE CONDITIONS.
16. PROVISION FOR INCOMING SEWERS, HOUSE SERVICE CONNECTIONS IF ANY SHALL BE PROVIDED
17. PROVISION FOR DROP (FOR DROP ARRANGEMENT) IN MH's SHALL BE PROVIDED AS PER SITE REQUIREMENT AND AS DIRECTED
18. INCASE OF HIGHER DIAMETER PIPES, PROVISION FOR THE INCOMING AND OUTGOING SEWERS MAY BE PROVIDED IN TWO PRECAST MEMEBERS OR HEIGHT OF THE BOTTOM PRECAST MEMBERS MAY BE INCREASED
19. ADDITION REINFORCEMENT AS PER APPROVED DRAWINGS IN AND ALLROUND PIPE OPENINGS SHALL BE PROVIDED
20. INTERCONNECTION WITH INCOMING & OUTGOING SEWERS INCLUDING FIXING THEM WITH RCC M30 GRADE CONCRETE
21. THE WORK SHALL BE DONE AS PER BOQ, SPECIFICATIONS AND CONTRACT PROVISIONS.

LEGEND:

FGL	-FINISHED GROUND LEVEL
RL	-ROAD LEVEL
LVL	-LEVEL
THK.	THICKNESS
TYP.	-TYPICAL
BW	-BOTH WAYS
BF	-BOTH FACES
REINF	REINFORCEMENT
DIA	DIAMETER
NTS	NOT TO SCALE
CB	CIRCULAR BEAM
RCC	REINFORCED CEMENT CONCRETE
MAX	MAXIMUM
DI	DUCTILE IRON
ADDL	ADDITIONAL
PCC	PLAIN CEMENT CONCRETE
C/C	CENTER-TO-CENTER
HFL	HIGH FLOOD LEVEL
MIN	MINIMUM
M/S	MILD STEEL

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	- -

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:

RCC PRECAST SEWER MACHINE HOLE DETAILS 1200mm DIA (TYPICAL) FOR DEPTH UPTO 3.0M

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE: (CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3026	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3026.dwg		A1 SIZE

TITLE:	DWG NO:
RCC PRECAST SEWER MACHINE HOLE DETAILS 1500MM DIA (TYPICAL) FOR DEPTH UPTO 3.0M	TN-KWSDRP-WBS3-CV-3027

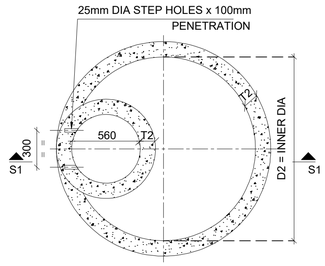

1 PLAN AT MACHINE HOLE TOP LVL
SCALE : NTS

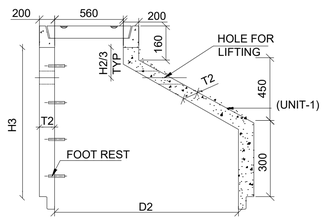

3 DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS



DETAIL OF 'Y'
TYP.JOINING DETAILS OF 1500 DIA PRECAST SEGMENT



DETAILS OF 'Z'
TYP.JOINING DETAILS OF 1500 DIA PRECAST SEGMENT

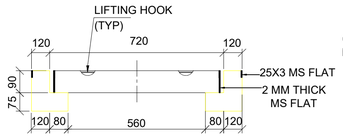

DETAIL OF 'X'
HD-20 MACHINE HOLE COVER

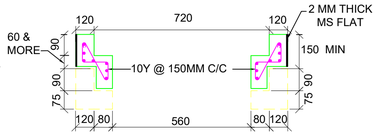

ADDITIONAL MACHINE HOLE HEIGHT TO MATCH FINISHED ROAD LEVEL



DETAILS OF BASE SLAB

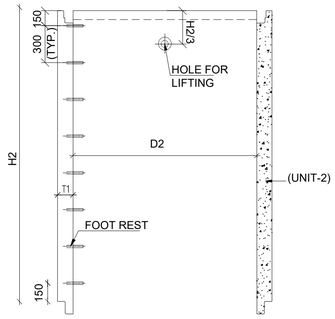

4 DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS



DETAIL OF 'U'



TYPICAL PLASTIC ENCAPSULATED FOOT REST DETAILS

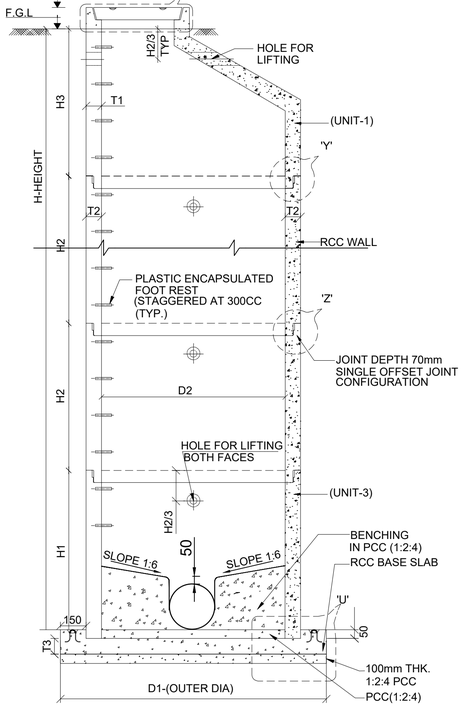

2 SECTION S1-S1
SCALE : NTS

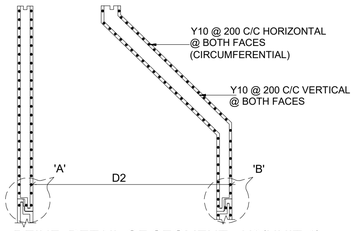

5 REINF. DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS

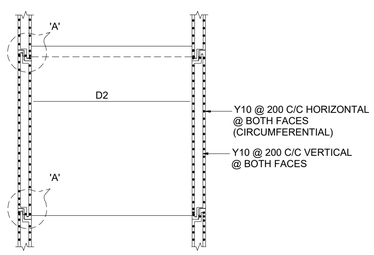

6 REINF. DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS



JOINING DETAIL - 'A'

JOINING DETAIL - 'B'

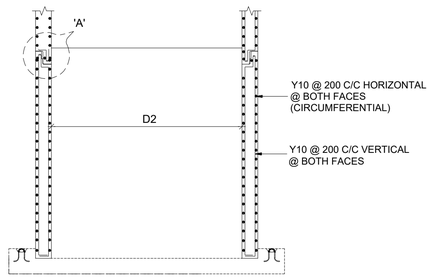

7 REINF. DETAIL OF SEGMENT - H1(UNIT-3)
SCALE : NTS



8 REINF. DETAIL OF BASE SLAB
SCALE : NTS

STANDARD DATA FOR PRECAST MANHOLE								
1	**BASE SECTION**							PROVISION
a)	SIZE(DIAMETER) IN mm							1500
b)	DIA WISE DIMENSIONS							
	INNER DIA.OF BASE(D2) (mm)	WALL THK.(T1) (mm)	WALL THK.(T2) (mm)	JOINT DEPTH (mm)	BASE THK.(T3) (mm)	OUTER DIA.OF BASE(D1) (mm)	HEIGHT	
	1500	200	200	50	250	2200	UPTO 3m	
c)	AVAILABLE HEIGHT FOR BASE IN MM(H1)							300 TO 700 OR AS REQUIRED
d)	HOLES FOR SEWER CONNECTIONS							100mmØ MORE THAN OUTER Ø OF SEWER
e)	A)MAT CONCRETE THICKNESS IN MM & MIX							100mmTHICK,1:2:4 MIX
	B)CONCRETE MIX FOR WALL AND BASE							RCC M30 GRADE
f)	CONCRETE FILL FOR BENCHING							1:2:4, MIX WITH 1:6 SLOPE
g)	REINFORCEMENT							
	a)FOR BASE SLAB							AS PER RC DETAIL
	b)FOR WALL							AS PER RC DETAIL
2	**RISER SECTION**							
a)	AVAILABLE HEIGHT FOR RISER SECTION (H2)							300 TO 900 OR AS REQUIRED
b)	WALL THICKNESS IN MM							200mm
c)	JOINT THICKNESS AND JOINT MATERIAL							SAME AS BASE SECTION
d)	REINFORCEMENT IN THE WALL							AS PER DETAIL DRG.
3	**ECCENTRIC CONE SECTION**							
a)	SHAPE							ECCENTRIC CONE
b)	CONCRETE FILL AROUND SEWER							1:1.5:3MIX
c)	THICKNESS(T2)							200mm
d)	REINFORCEMENT							AS PER DETAIL DRG.
e)	TOP OPENING							560mm
f)	JOINT DEPTH							AS PER DETAIL DRG.
4	**STANDARD** MACHINE HOLE **FRAME AND COVER**							AS PER IS 12592-2002
a)	SHAPE							FLAT
b)	COVER SIZE							560mm
c)	SPECIFICATION							HD-20

NOTE:

1. ALL DIMENTIONS ARE IN mm AND ALL LEVELS ARE IN METER.
2. THE LIFTING HOLES SHALL BE FILLED WITH CONCRETE 1:1.5:3 MIX.
3. 3mm PVC ENCAPSULATE ON 12mm BAR, FOOT STEPS Fe 500.
4. THE NON CORE OPENING SHALL BE 100mm GREATER THAN THE OUTER DIA OF SEWER
5. SINGLE OFFSET JOINT CONFIGURATION SHALL BE ADOPTED AT THE JOINT.
6. THE JOINT SHALL BE SEALED WITH NON SHRINK GROUT/SINGLE RUBBER SEAL SHALL BE PROVIDED IN PRECAST UNITS.RUBBER GASKET SHALL BE AS PER IS 5382.
7. 150mm LIP IS OPTIONAL UNLESS OTHERWISE NOTED.
8. GRADE OF CONCRETE SHALL BE RCC M30 MIX FOR MANHOLE WALL AND FOR BASE SLAB WITH SULPHATE RESISTANCE CEMENT.
9. ALL REINFORCEMENT BARS SHALL BE HYSD CRS BARS OF GRADE Fe 500 CONFORMING TO IS:1786.
10. CLEAR COVER TO MAIN REINFORCEMENT SHALL BE:
    a)WALL SOIL SEWAGE FACE=50mm
    b)BASE SLAB =50mm
11. THIS DRAWING IS ONLY TYPICAL CONSTRUCTION DRAWING. THE CONTRACTOR HAS TO TAKE PRIOR APPROVAL TO THE PROCESS OF MANUFACTURE OF THE PRECAST MANHOLE.
12. NET SAFE BEARING CAPACITY IS ASSUMED TO BE 10 TON/Sq.m. IF LOWER SBC ENCOUNTERED, THE BASE SLAB THICKNESS SHALL BE INCREASED AS PER DIRECTION OF ENGINEER.
13. PRE CAST FRAME AND COVER AS PER IS:12592-2002.
14. LOWEST FOOT REST SHALL NOT BE MORE THAN 300mm ABOVE BENCHING.
15. FOR MINIMUM DEPTH-MANHOLES(1.25m), WHEREVER OCCURS,THE CONICAL SECTION AND THE RISER SEGMENT (H1) MAY BE CAST AS A SINGLE UNIT BASED ON THE SITE CONDITIONS.
16. PROVISION FOR INCOMING SEWERS, HOUSE SERVICE CONNECTIONS IF ANY SHALL BE PROVIDED
17. PROVISION FOR DROP (FOR DROP ARRANGEMENT) IN MH's SHALL BE PROVIDED AS PER SITE REQUIREMENT AND AS DIRECTED
18. INCASE OF HIGHER DIAMETER PIPES, PROVISION FOR THE INCOMING AND OUTGOING SEWERS MAY BE PROVIDED IN TWO PRECAST MEMEBERS OR HEIGHT OF THE BOTTOM PRECAST MEMBERS MAY BE INCREASED
19. ADDITION REINFORCEMENT AS PER APPROVED DRAWINGS IN AND ALLROUND PIPE OPENINGS SHALL BE PROVIDED
20. INTERCONNECTION WITH INCOMING & OUTGOING SEWERS INCLUDING FIXING THEM WITH RCC M30 GRADE CONCRETE
21. THE WORK SHALL BE DONE AS PER BOQ, SPECIFICATIONS AND CONTRACT PROVISIONS.

LEGEND:

FGL	FINISHED GROUND LEVEL
RL	REDUCED LEVEL
LVL	LEVEL
THK	THICKNESS
TYP	TYPICAL
BW	BOTH WAYS
BF	BOTH FACES
RF/REINF	REINFORCEMENT
DIA	DIAMETER
NTS	NOT TO SCALE
CB	CIRCULAR BEAM
RCC	REINFORCED CEMENT CONCRETE
MAX	MAXIMUM
DI	DUCTILE IRON
ADDL	ADDITIONAL
PCC	PLAIN CEMENT CONCRETE
C/C	CENTER-TO-CENTER
HFL	HIGH FLOOD LEVEL
MIN	MINIMUM
M/S	MILD STEEL

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	- -

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:
RCC PRECAST SEWER MACHINE HOLE DETAILS 1500mm DIA (TYPICAL) FOR DEPTH UPTO 3.0M

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE: (CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3027	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3027.dwg		A1 SIZE

TITLE: RCC PRECAST SEWER MACHINE HOLE DETAILS 1500MM DIA (TYPICAL) FOR DEPTH UPTO 7.0M

DWG NO: TN-KWSDRP-WBS3-CV-3028

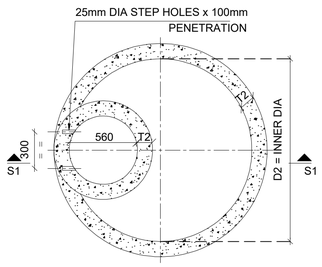

1 PLAN AT MACHINE HOLE TOP LVL
SCALE : NTS

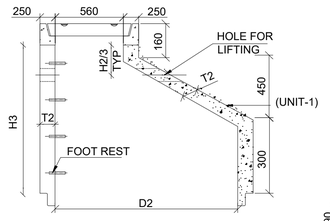

3 DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS



DETAIL OF 'Y'
TYP.JOINING DETAILS OF 1500 DIA PRECAST SEGMENT



DETAILS OF 'Z'
TYP.JOINING DETAILS OF 1500 DIA PRECAST SEGMENT

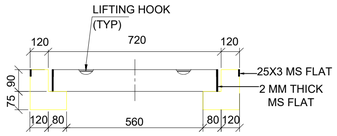

DETAIL OF 'X'
HD-20 MACHINE HOLE COVER

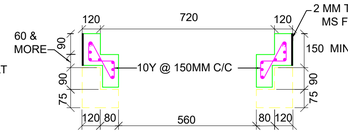

ADDITIONAL MACHINE HOLE HEIGHT TO MATCH FINISHED ROAD LEVEL



DETAILS OF BASE SLAB



DETAIL OF 'U'



TYPICAL PLASTIC ENCAPSULATED FOOT REST DETAILS

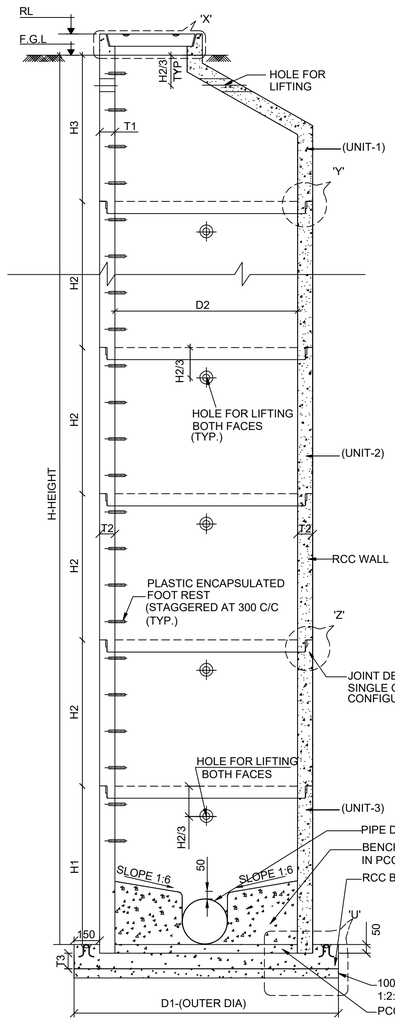

2 SECTION S1-S1
SCALE:NTS

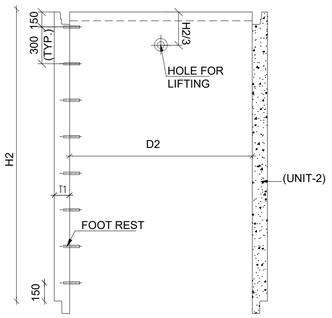

4 DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS

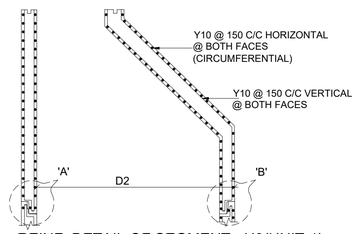

5 REINF. DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS

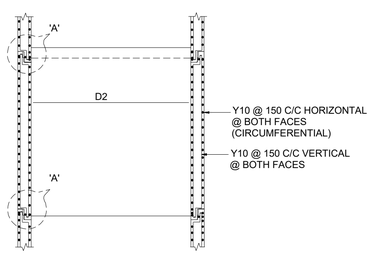

6 REINF. DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS



JOINING DETAIL - 'A'

JOINING DETAIL - 'B'

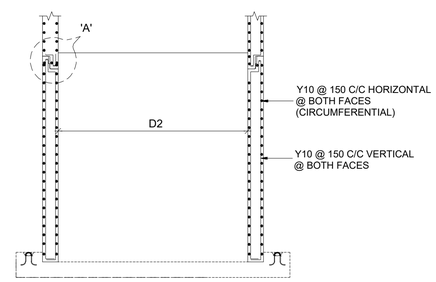

7 REINF. DETAIL OF SEGMENT - H1(UNIT-3)
SCALE : NTS



8 REINF. DETAIL OF BASE SLAB
SCALE : NTS

STANDARD DATA FOR PRECAST MACHINE HOLE								
1	**BASE SECTION**							PROVISION
a)	SIZE(DIAMETER) IN mm							1500
b)	DIA WISE DIMENSIONS							
	INNER DIA.OF BASE(D2) (mm)	WALL THK.(T1) (mm)	WALL THK.(T2) (mm)	JOINT DEPTH (mm)	BASE THK.(T3) (mm)	OUTER DIA.OF BASE(D1) (mm)	HEIGHT	
	1500	250	250	50	300	2300	UPTO 7m	
c)	AVAILABLE HEIGHT FOR BASE IN MM(H1)							300 TO 700 OR AS REQUIRED
d)	HOLES FOR SEWER CONNECTIONS							100mmØ MORE THAN OUTER Ø OF SEWER
e)	A)MAT CONCRETE THICKNESS IN MM & MIX							100mmTHICK,1:2:4 MIX
	B)CONCRETE MIX FOR WALL AND BASE							RCC M30 GRADE
f)	CONCRETE FILL FOR BENCHING							1:2:4, MIX WITH 1:6 SLOPE
g)	REINFORCEMENT							
	a)FOR BASE SLAB							AS PER RC DETAIL
	b)FOR WALL							AS PER RC DETAIL
2	**RISER SECTION**							
a)	AVAILABLE HEIGHT FOR RISER SECTION (H2)							300 TO 900 OR AS REQUIRED
b)	WALL THICKNESS IN MM							250mm
c)	JOINT THICKNESS AND JOINT MATERIAL							SAME AS BASE SECTION
d)	REINFORCEMENT IN THE WALL							AS PER DETAIL DRG.
3	**ECCENTRIC CONE SECTION**							
a)	SHAPE							ECCENTRIC CONE
b)	CONCRETE FILL AROUND SEWER							1:1.5:3MIX
c)	THICKNESS(T2)							250mm
d)	REINFORCEMENT							AS PER DETAIL DRG.
e)	TOP OPENING							560mm
f)	JOINT DEPTH							AS PER DETAIL DRG.
4	**STANDARD MACHINE HOLE FRAME AND COVER**							AS PER IS 12592-2002
a)	SHAPE							FLAT
b)	COVER SIZE							560mm
c)	SPECIFICATION							HD-20

NOTE:

1. ALL DIMENTIONS ARE IN mm AND ALL LEVELS ARE IN METER.
2. THE LIFTING HOLES SHALL BE FILLED WITH CONCRETE 1:1.5:3 MIX.
3. 3mm PVC ENCAPSULATE ON 12mm BAR, FOOT STEPS Fe 500.
4. THE NON CORE OPENING SHALL BE 100mm GREATER THAN THE OUTER DIA OF SEWER
5. SINGLE OFFSET JOINT CONFIGURATION SHALL BE ADOPTED AT THE JOINT.
6. THE JOINT SHALL BE SEALED WITH NON SHRINK GROUT/SINGLE RUBBER SEAL SHALL BE PROVIDED IN PRECAST UNITS.RUBBER GASKET SHALL BE AS PER IS 5382.
7. 150mm LIP IS OPTIONAL UNLESS OTHERWISE NOTED.
8. GRADE OF CONCRETE SHALL BE RCC M30 MIX FOR MANHOLE WALL AND FOR BASE SLAB WITH SULPHATE RESISTANCE CEMENT.
9. ALL REINFORCEMENT BARS SHALL BE HYSD CRS BARS OF GRADE Fe 500 CONFORMING TO IS:1786.
10. CLEAR COVER TO MAIN REINFORCEMENT SHALL BE:
    a)WALL SOIL SEWAGE FACE=50mm
    b)BASE SLAB =50mm
11. THIS DRAWING IS ONLY TYPICAL CONSTRUCTION DRAWING. THE CONTRACTOR HAS TO TAKE PRIOR APPROVAL TO THE PROCESS OF MANUFACTURE OF THE PRECAST MANHOLE.
12. NET SAFE BEARING CAPACITY IS ASSUMED TO BE 10 TON/Sq.m. IF LOWER SBC ENCOUNTERED, THE BASE SLAB THICKNESS SHALL BE INCREASED AS PER DIRECTION OF ENGINEER.
13. PRE CAST FRAME AND COVER AS PER IS:12592-2002.
14. LOWEST FOOT REST SHALL NOT BE MORE THAN 300mm ABOVE BENCHING.
15. FOR MINIMUM DEPTH-MANHOLES(1.25m), WHEREVER OCCURS,THE CONICAL SECTION AND THE RISER SEGMENT (H1) MAY BE CAST AS A SINGLE UNIT BASED ON THE SITE CONDITIONS.
16. PROVISION FOR INCOMING SEWERS, HOUSE SERVICE CONNECTIONS IF ANY SHALL BE PROVIDED
17. PROVISION FOR DROP (FOR DROP ARRANGEMENT) IN MH's SHALL BE PROVIDED AS PER SITE REQUIREMENT AND AS DIRECTED
18. INCASE OF HIGHER DIAMETER PIPES, PROVISION FOR THE INCOMING AND OUTGOING SEWERS MAY BE PROVIDED IN TWO PRECAST MEMEBERS OR HEIGHT OF THE BOTTOM PRECAST MEMBERS MAY BE INCREASED
19. ADDITION REINFORCEMENT AS PER APPROVED DRAWINGS IN AND ALLROUND PIPE OPENINGS SHALL BE PROVIDED
20. INTERCONNECTION WITH INCOMING & OUTGOING SEWERS INCLUDING FIXING THEM WITH RCC M30 GRADE CONCRETE
21. THE WORK SHALL BE DONE AS PER BOQ, SPECIFICATIONS AND CONTRACT PROVISIONS.

LEGEND:

FGL	-FINISHED GROUND LEVEL
RL	-ROAD LEVEL
LVL	-LEVEL
THK.	THICKNESS
TYP.	-TYPICAL
BW	-BOTH WAYS
BF	-BOTH FACES
REINF	REINFORCEMENT
DIA	DIAMETER
NTS	NOT TO SCALE
CB	CIRCULAR BEAM
RCC	REINFORCED CEMENT CONCRETE
MAX	MAXIMUM
DI	DUCTILE IRON
ADDL	ADDITIONAL
PCC	PLAIN CEMENT CONCRETE
C/C	CENTER-TO-CENTER
HFL	HIGH FLOOD LEVEL
MIN	MINIMUM
M/S	MILD STEEL

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	- - -

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: RCC PRECAST SEWER MACHINE HOLE DETAILS 1500mm DIA (TYPICAL) FOR DEPTH UPTO 7.0M

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE: (CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3028	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3028.dwg		A1 SIZE

TITLE:	RCC PRECAST SEWER MACHINE HOLE DETAILS 1800MM DIA (TYPICAL) FOR DEPTH UPTO 3.0M	DWG NO:	TN-KWSDRP-WBS3-CV-3029

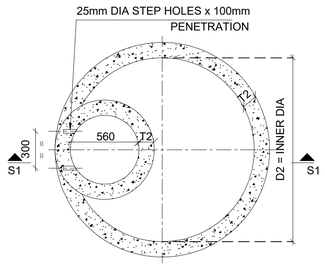

1 PLAN AT MACHINE HOLE TOP LVL
SCALE : NTS

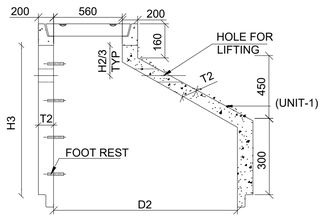

3 DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS



DETAIL OF 'Y'
TYP.JOINING DETAILS OF 1800 DIA PRECAST SEGMENT



DETAILS OF 'Z'
TYP.JOINING DETAILS OF 1800 DIA PRECAST SEGMENT

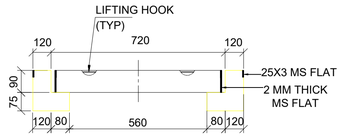

DETAIL OF 'X'
HD-20 MACHINE HOLE COVER

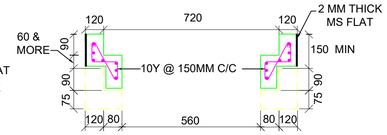

ADDITIONAL MACHINE HOLE HEIGHT TO MATCH FINISHED ROAD LEVEL



DETAILS OF BASE SLAB

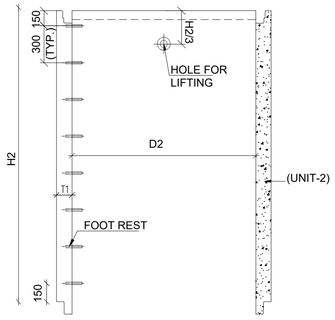

4 DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS



DETAIL OF 'U'



TYPICAL PLASTIC ENCAPSULATED FOOT REST DETAILS

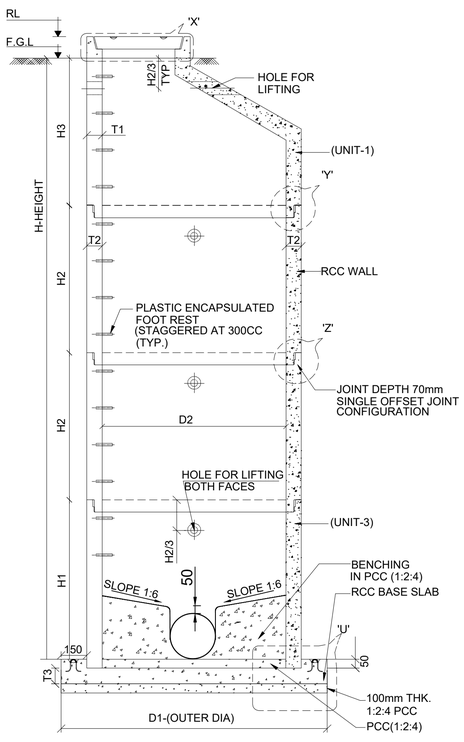

2 SECTION S1-S1
SCALE : NTS

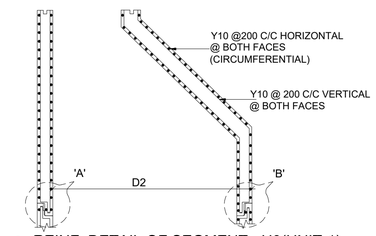

5 REINF. DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS

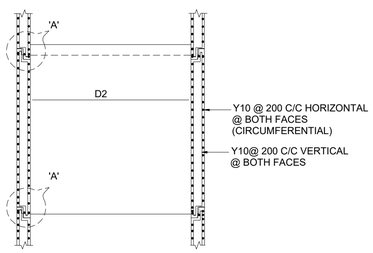

6 REINF. DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS



JOINING DETAIL - 'A'

JOINING DETAIL - 'B'

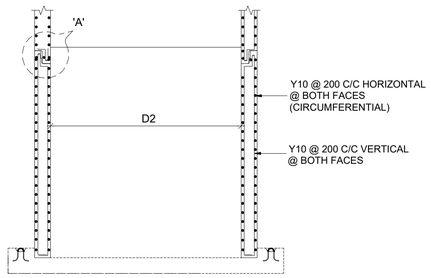

7 REINF. DETAIL OF SEGMENT - H1(UNIT-3)
SCALE : NTS



8 REINF. DETAIL OF BASE SLAB
SCALE : NTS

STANDARD DATA FOR PRECAST MACHINE HOLE								
1	**BASE SECTION**							PROVISION
a)	SIZE(DIAMETER) IN mm							1800
b)	DIA WISE DIMENSIONS							
	INNER DIA.OF BASE(D2) (mm)	WALL THK.(T1) (mm)	WALL THK.(T2) (mm)	JOINT DEPTH (mm)	BASE THK.(T3) (mm)	OUTER DIA.OF BASE(D1) (mm)	HEIGHT	
	1800	200	200	50	250	2500	UPTO 3m	
c)	AVAILABLE HEIGHT FOR BASE IN MM(H1)							300 TO 700 OR AS REQUIRED
d)	HOLES FOR SEWER CONNECTIONS							100mmØ MORE THAN OUTER Ø OF SEWER
e)	A)MAT CONCRETE THICKNESS IN MM & MIX							100mmTHICK,1:2:4 MIX
	B)CONCRETE MIX FOR WALL AND BASE							RCC M30 GRADE
f)	CONCRETE FILL FOR BENCHING							1:2:4, MIX WITH 1:6 SLOPE
g)	REINFORCEMENT							
	a)FOR BASE SLAB							AS PER RC DETAIL
	b)FOR WALL							AS PER RC DETAIL
2	**RISER SECTION**							
a)	AVAILABLE HEIGHT FOR RISER SECTION (H2)							300 TO 900 OR AS REQUIRED
b)	WALL THICKNESS IN MM							200mm
c)	JOINT THICKNESS AND JOINT MATERIAL							SAME AS BASE SECTION
d)	REINFORCEMENT IN THE WALL							AS PER DETAIL DRG.
3	**ECCENTRIC CONE SECTION**							
a)	SHAPE							ECCENTRIC CONE
b)	CONCRETE FILL AROUND SEWER							1:1.5:3MIX
c)	THICKNESS(T2)							200mm
d)	REINFORCEMENT							AS PER DETAIL DRG.
e)	TOP OPENING							560mm
f)	JOINT DEPTH							AS PER DETAIL DRG.
4	**STANDARD** MACHINE HOLE **FRAME AND COVER**							AS PER IS 12592-2002
a)	SHAPE							FLAT
b)	COVER SIZE							560mm
c)	SPECIFICATION							HD-20

NOTE:

1. ALL DIMENTIONS ARE IN mm AND ALL LEVELS ARE IN METER.
2. THE LIFTING HOLES SHALL BE FILLED WITH CONCRETE 1:1.5:3 MIX.
3. 3mm PVC ENCAPSULATE ON 12mm BAR, FOOT STEPS Fe 500.
4. THE NON CORE OPENING SHALL BE 100mm GREATER THAN THE OUTER DIA OF SEWER
5. SINGLE OFFSET JOINT CONFIGURATION SHALL BE ADOPTED AT THE JOINT.
6. THE JOINT SHALL BE SEALED WITH NON SHRINK GROUT/SINGLE RUBBER SEAL SHALL BE PROVIDED IN PRECAST UNITS.RUBBER GASKET SHALL BE AS PER IS 5382.
7. 150mm LIP IS OPTIONAL UNLESS OTHERWISE NOTED.
8. GRADE OF CONCRETE SHALL BE RCC M30 MIX FOR MANHOLE WALL AND FOR BASE SLAB WITH SULPHATE RESISTANCE CEMENT.
9. ALL REINFORCEMENT BARS SHALL BE HYSD CRS BARS OF GRADE Fe 500 CONFORMING TO IS:1786.
10. CLEAR COVER TO MAIN REINFORCEMENT SHALL BE:
    a)WALL SOIL SEWAGE FACE=50mm
    b)BASE SLAB =50mm
11. THIS DRAWING IS ONLY TYPICAL CONSTRUCTION DRAWING. THE CONTRACTOR HAS TO TAKE PRIOR APPROVAL TO THE PROCESS OF MANUFACTURE OF THE PRECAST MANHOLE.
12. NET SAFE BEARING CAPACITY IS ASSUMED TO BE 10 TON/Sq.m. IF LOWER SBC ENCOUNTERED, THE BASE SLAB THICKNESS SHALL BE INCREASED AS PER DIRECTION OF ENGINEER.
13. PRE CAST FRAME AND COVER AS PER IS:12592-2002.
14. LOWEST FOOT REST SHALL NOT BE MORE THAN 300mm ABOVE BENCHING.
15. FOR MINIMUM DEPTH-MANHOLES(1.25m), WHEREVER OCCURS,THE CONICAL SECTION AND THE RISER SEGMENT (H1) MAY BE CAST AS A SINGLE UNIT BASED ON THE SITE CONDITIONS.
16. PROVISION FOR INCOMING SEWERS, HOUSE SERVICE CONNECTIONS IF ANY SHALL BE PROVIDED
17. PROVISION FOR DROP (FOR DROP ARRANGEMENT) IN MH's SHALL BE PROVIDED AS PER SITE REQUIREMENT AND AS DIRECTED
18. INCASE OF HIGHER DIAMETER PIPES, PROVISION FOR THE INCOMING AND OUTGOING SEWERS MAY BE PROVIDED IN TWO PRECAST MEMEBERS OR HEIGHT OF THE BOTTOM PRECAST MEMBERS MAY BE INCREASED
19. ADDITION REINFORCEMENT AS PER APPROVED DRAWINGS IN AND ALLROUND PIPE OPENINGS SHALL BE PROVIDED
20. INTERCONNECTION WITH INCOMING & OUTGOING SEWERS INCLUDING FIXING THEM WITH RCC M30 GRADE CONCRETE
21. THE WORK SHALL BE DONE AS PER BOQ, SPECIFICATIONS AND CONTRACT PROVISIONS.

LEGEND:

FGL	-FINISHED GROUND LEVEL
RL	-ROAD LEVEL
LVL	-LEVEL
THK	THICKNESS
TYP.	-TYPICAL
BW	-BOTH WAYS
BF	-BOTH FACES
REINF	REINFORCEMENT
DIA	DIAMETER
NTS	NOT TO SCALE
CB	CIRCULAR BEAM
RCC	REINFORCED CEMENT CONCRETE
MAX	MAXIMUM
DI	DUCTILE IRON
ADDL	ADDITIONAL
PCC	PLAIN CEMENT CONCRETE
C/C	CENTER-TO-CENTER
HFL	HIGH FLOOD LEVEL
MIN	MINIMUM
M/S	MILD STEEL

ISSUE	DATE	DESCRIPTION					
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	-	-	
			BY	CIVIL	-	-	APPD.
			CHECKED				

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:
RCC PRECAST SEWER MACHINE HOLE DETAILS 1800mm DIA (TYPICAL) FOR DEPTH UPTO 3.0M

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE: (CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3029	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3029.dwg		A1 SIZE

TITLE: RCC PRECAST SEWER MACHINE HOLE DETAILS 1800MM DIA (TYPICAL) FOR DEPTH UPTO 6.0M

DWG NO: TN-KWSDRP-WBS3-CV-3030

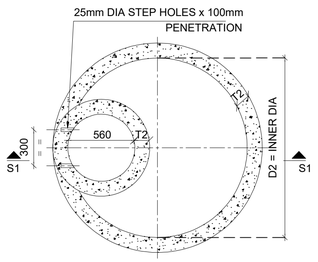

1 PLAN AT MACHINE HOLE TOP LVL
SCALE : NTS

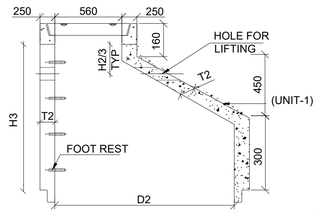

3 DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS



DETAIL OF 'Y'
TYP.JOINING DETAILS OF 1800 DIA PRECAST SEGMENT



DETAILS OF 'Z'
TYP.JOINING DETAILS OF 1800 DIA PRECAST SEGMENT

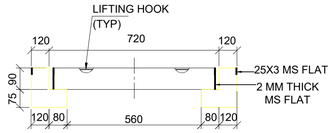

DETAIL OF 'X'
HD-20 MACHINE HOLE COVER

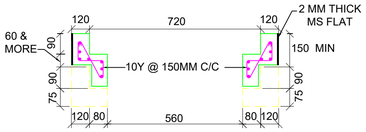

ADDITIONAL MACHINE HEIGHT TO MATCH FINISHED ROAD LEVEL



DETAILS OF BASE SLAB



DETAIL OF 'U'



TYPICAL PLASTIC ENCAPSULATED FOOT REST DETAILS

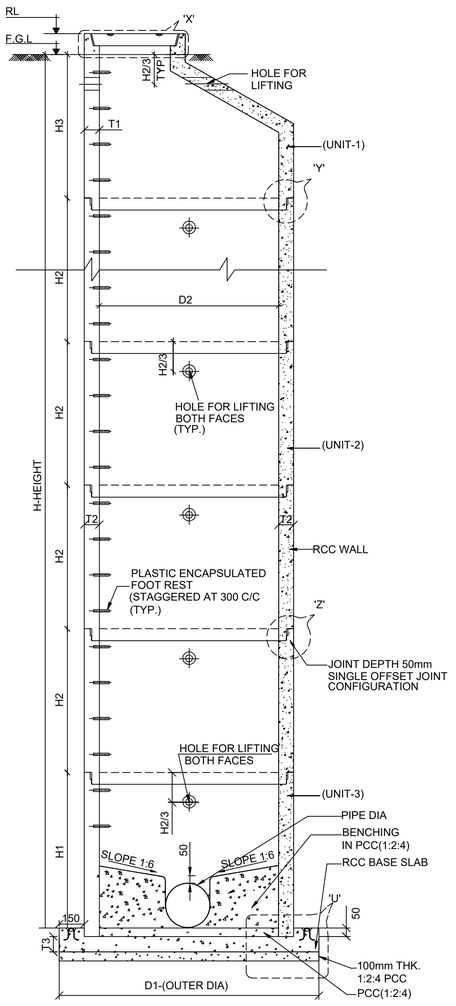

2 SECTION S1-S1
SCALE:NTS

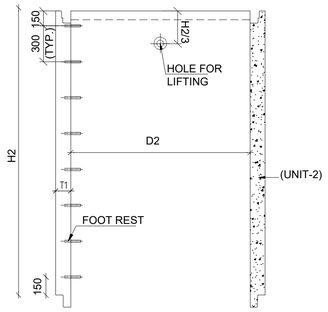

4 DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS

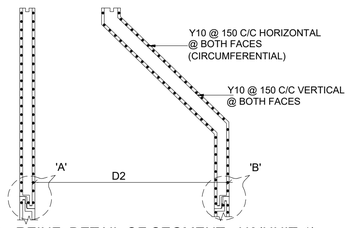

5 REINF. DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS

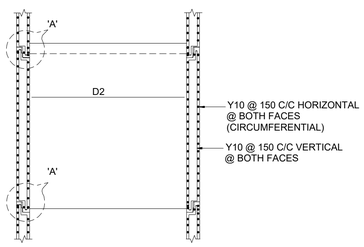

6 REINF. DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS



JOINING DETAIL - 'A'

JOINING DETAIL - 'B'

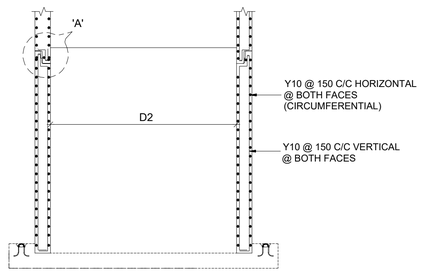

7 REINF. DETAIL OF SEGMENT - H1(UNIT-3)
SCALE : NTS



8 REINF. DETAIL OF BASE SLAB
SCALE : NTS

STANDARD DATA FOR PRECAST MACHINE HOLE							
1	**BASE SECTION**						PROVISION
a)	SIZE(DIAMETER) IN mm						1800
b)	DIA WISE DIMENSIONS						
	INNER DIA.OF BASE(D2) (mm)	WALL THK.(T1) (mm)	WALL THK.(T2) (mm)	JOINT DEPTH (mm)	BASE THK.(T3) (mm)	OUTER DIA.OF BASE(D1) (mm)	HEIGHT
	1800	250	250	50	300	2600	UPTO 6m
c)	AVAILABLE HEIGHT FOR BASE IN MM(H1)						300 TO 700 OR AS REQUIRED
d)	HOLES FOR SEWER CONNECTIONS						100mmØ MORE THAN OUTER Ø OF SEWER
e)	A)MAT CONCRETE THICKNESS IN MM & MIX						100mmTHICK,1:2:4 MIX
	B)CONCRETE MIX FOR WALL AND BASE						RCC M30 GRADE
f)	CONCRETE FILL FOR BENCHING						1:2:4, MIX WITH 1:6 SLOPE
g)	REINFORCEMENT						
	a)FOR BASE SLAB						AS PER RC DETAIL
	b)FOR WALL						AS PER RC DETAIL
2	**RISER SECTION**						
a)	AVAILABLE HEIGHT FOR RISER SECTION (H2)						300 TO 900 OR AS REQUIRED
b)	WALL THICKNESS IN MM						250mm
c)	JOINT THICKNESS AND JOINT MATERIAL						SAME AS BASE SECTION
d)	REINFORCEMENT IN THE WALL						AS PER DETAIL DRG.
3	**ECCENTRIC CONE SECTION**						
a)	SHAPE						ECCENTRIC CONE
b)	CONCRETE FILL AROUND SEWER						1:1.5:3MIX
c)	THICKNESS(T2)						250mm
d)	REINFORCEMENT						AS PER DETAIL DRG.
e)	TOP OPENING						560mm
f)	JOINT DEPTH						AS PER DETAIL DRG.
4	**STANDARD** MACHINE HOLE **FRAME AND COVER**						AS PER IS 12592-2002
a)	SHAPE						FLAT
b)	COVER SIZE						560mm
c)	SPECIFICATION						HD-20

NOTE:

1. ALL DIMENTIONS ARE IN mm AND ALL LEVELS ARE IN METER.
2. THE LIFTING HOLES SHALL BE FILLED WITH CONCRETE 1:1.5:3 MIX.
3. 3mm PVC ENCAPSULATE ON 12mm BAR, FOOT STEPS Fe 500.
4. THE NON CORE OPENING SHALL BE 100mm GREATER THAN THE OUTER DIA OF SEWER.
5. SINGLE OFFSET JOINT CONFIGURATION SHALL BE ADOPTED AT THE JOINT.
6. THE JOINT SHALL BE SEALED WITH NON SHRINK GROUT/SINGLE RUBBER SEAL SHALL BE PROVIDED IN PRECAST UNITS.RUBBER GASKET SHALL BE AS PER IS 5382.
7. 150mm LIP IS OPTIONAL UNLESS OTHERWISE NOTED.
8. GRADE OF CONCRETE SHALL BE RCC M30 MIX FOR MANHOLE WALL AND FOR BASE SLAB WITH SULPHATE RESISTANCE CEMENT.
9. ALL REINFORCEMENT BARS SHALL BE HYSD CRS BARS OF GRADE Fe 500 CONFORMING TO IS:1786.
10. CLEAR COVER TO MAIN REINFORCEMENT SHALL BE:
    a)WALL SOIL SEWAGE FACE=50mm
    b)BASE SLAB =50mm
11. THIS DRAWING IS ONLY TYPICAL CONSTRUCTION DRAWING. THE CONTRACTOR HAS TO TAKE PRIOR APPROVAL TO THE PROCESS OF MANUFACTURE OF THE PRECAST MANHOLE.
12. NET SAFE BEARING CAPACITY IS ASSUMED TO BE 10 TON/Sq.m. IF LOWER SBC ENCOUNTERED, THE BASE SLAB THICKNESS SHALL BE INCREASED AS PER DIRECTION OF ENGINEER.
13. PRE CAST FRAME AND COVER AS PER IS:12592-2002.
14. LOWEST FOOT REST SHALL NOT BE MORE THAN 300mm ABOVE BENCHING.
15. FOR MINIMUM DEPTH-MANHOLES(1.25m), WHEREVER OCCURS,THE CONICAL SECTION AND THE RISER SEGMENT (H1) MAY BE CAST AS A SINGLE UNIT BASED ON THE SITE CONDITIONS.
16. PROVISION FOR INCOMING SEWERS, HOUSE SERVICE CONNECTIONS IF ANY SHALL BE PROVIDED
17. PROVISION FOR DROP (FOR DROP ARRANGEMENT) IN MH's SHALL BE PROVIDED AS PER SITE REQUIREMENT AND AS DIRECTED
18. INCASE OF HIGHER DIAMETER PIPES, PROVISION FOR THE INCOMING AND OUTGOING SEWERS MAY BE PROVIDED IN TWO PRECAST MEMEBERS OR HEIGHT OF THE BOTTOM PRECAST MEMBERS MAY BE INCREASED
19. ADDITION REINFORCEMENT AS PER APPROVED DRAWINGS IN AND ALLROUND PIPE OPENINGS SHALL BE PROVIDED
20. INTERCONNECTION WITH INCOMING & OUTGOING SEWERS INCLUDING FIXING THEM WITH RCC M30 GRADE CONCRETE
21. THE WORK SHALL BE DONE AS PER BOQ, SPECIFICATIONS AND CONTRACT PROVISIONS.

LEGEND:

FGL	FINISHED GROUND LEVEL
RL	REDUCED LEVEL
LVL	LEVEL
THK	THICKNESS
TYP	TYPICAL
BW	BOTH WAYS
BF	BOTH FACES
RF/REINF	REINFORCEMENT
DIA	DIAMETER
NTS	NOT TO SCALE
CB	CIRCULAR BEAM
RCC	REINFORCED CEMENT CONCRETE
MAX	MAXIMUM
DI	DUCTILE IRON
ADDL	ADDITIONAL
PCC	PLAIN CEMENT CONCRETE
C/C	CENTER-TO-CENTER
HFL	HIGH FLOOD LEVEL
MIN	MINIMUM
M/S	MILD STEEL

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	- - -

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:
RCC PRECAST SEWER MACHINE HOLE DETAILS 1800mm DIA (TYPICAL) FOR DEPTH UPTO 6.0M

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE: (CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: AS SHOWN	DWG. NO. TN-KWSDRP-WBS3-CV-3030	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3030.dwg		A1 SIZE

TITLE: RCC PRECAST SEWER MACHINE HOLE DETAILS 1800MM DIA (TYPICAL) FOR DEPTH UPTO 8.0M

DWG NO: TN-KWSDRP-WBS3-CV-3031

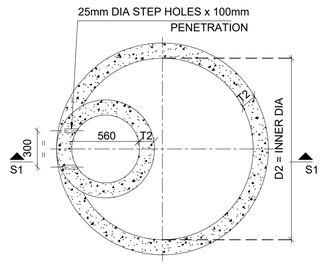

1 PLAN AT MACHINE HOLE TOP LVL
SCALE : NTS

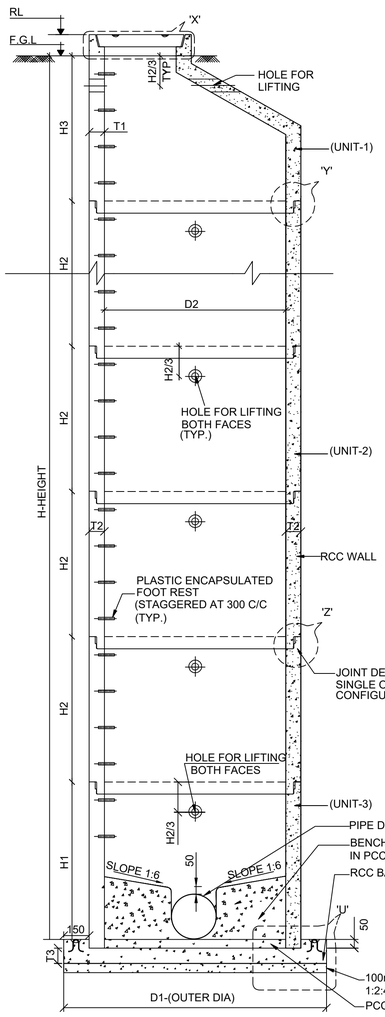

2 SECTION S1-S1
SCALE:NTS

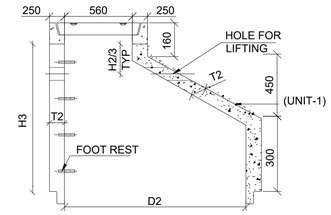

3 DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS

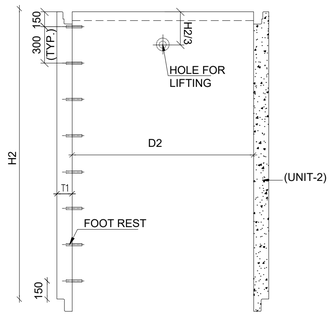

4 DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS

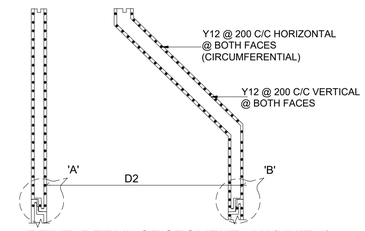

5 REINF. DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS

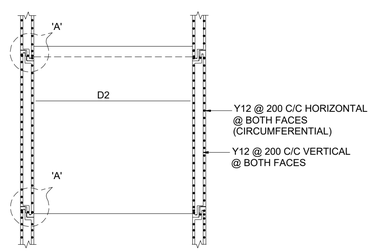

6 REINF. DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS



DETAIL OF 'Y'
TYP.JOINING DETAILS OF 1800 DIA PRECAST SEGMENT



DETAILS OF 'Z'
TYP.JOINING DETAILS OF 1800 DIA PRECAST SEGMENT

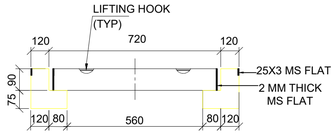

DETAIL OF 'X'
HD-20 MACHINE HOLE COVER

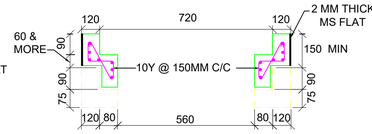

ADDITIONAL MACHINE HOLE HEIGHT TO MATCH FINISHED ROAD LEVEL



DETAILS OF BASE SLAB



DETAIL OF 'U'



TYPICAL PLASTIC ENCAPSULATED FOOT REST DETAILS



JOINING DETAIL - 'A'

JOINING DETAIL - 'B'

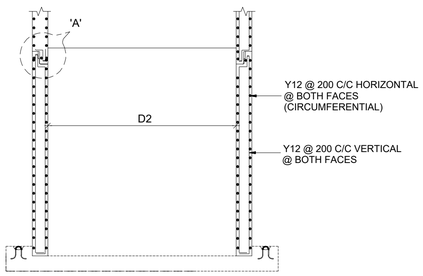

7 REINF. DETAIL OF SEGMENT - H1(UNIT-3)
SCALE : NTS



8 REINF. DETAIL OF BASE SLAB
SCALE : NTS

STANDARD DATA FOR PRECAST MACHINE HOLE							
1	**BASE SECTION**						PROVISION
a)	SIZE(DIAMETER) IN mm						1800
b)	DIA WISE DIMENSIONS						
	INNER DIA.OF BASE(D2) (mm)	WALL THK.(T1) (mm)	WALL THK.(T2) (mm)	JOINT DEPTH (mm)	BASE THK.(T3) (mm)	OUTER DIA.OF BASE(D1) (mm)	HEIGHT
	1800	250	250	50	350	2600	UPTO 8m
c)	AVAILABLE HEIGHT FOR BASE IN MM(H1)						300 TO 700 OR AS REQUIRED
d)	HOLES FOR SEWER CONNECTIONS						100mmØ MORE THAN OUTER Ø OF SEWER
e)	A)MAT CONCRETE THICKNESS IN MM & MIX						100mmTHICK,1:2:4 MIX
	B)CONCRETE MIX FOR WALL AND BASE						RCC M30 GRADE
f)	CONCRETE FILL FOR BENCHING						1:2:4, MIX WITH 1:6 SLOPE
g)	REINFORCEMENT						
	a)FOR BASE SLAB						AS PER RC DETAIL
	b)FOR WALL						AS PER RC DETAIL
2	**RISER SECTION**						
a)	AVAILABLE HEIGHT FOR RISER SECTION (H2)						300 TO 900 OR AS REQUIRED
b)	WALL THICKNESS IN MM						250mm
c)	JOINT THICKNESS AND JOINT MATERIAL						SAME AS BASE SECTION
d)	REINFORCEMENT IN THE WALL						AS PER DETAIL DRG.
3	**ECCENTRIC CONE SECTION**						
a)	SHAPE						ECCENTRIC CONE
b)	CONCRETE FILL AROUND SEWER						1:1.5:3MIX
c)	THICKNESS(T2)						250mm
d)	REINFORCEMENT						AS PER DETAIL DRG.
e)	TOP OPENING						560mm
f)	JOINT DEPTH						AS PER DETAIL DRG.
4	**STANDARD** MACHINE HOLE **FRAME AND COVER**						AS PER IS 12592-2002
a)	SHAPE						FLAT
b)	COVER SIZE						560mm
c)	SPECIFICATION						HD-20

NOTE:

1. ALL DIMENTIONS ARE IN mm AND ALL LEVELS ARE IN METER.
2. THE LIFTING HOLES SHALL BE FILLED WITH CONCRETE 1:1.5:3 MIX.
3. 3mm PVC ENCAPSULATE ON 12mm BAR, FOOT STEPS Fe 500.
4. THE NON CORE OPENING SHALL BE 100mm GREATER THAN THE OUTER DIA OF SEWER
5. SINGLE OFFSET JOINT CONFIGURATION SHALL BE ADOPTED AT THE JOINT.
6. THE JOINT SHALL BE SEALED WITH NON SHRINK GROUT/SINGLE RUBBER SEAL SHALL BE PROVIDED IN PRECAST UNITS.RUBBER GASKET SHALL BE AS PER IS 5382.
7. 150mm LIP IS OPTIONAL UNLESS OTHERWISE NOTED.
8. GRADE OF CONCRETE SHALL BE RCC M30 MIX FOR MANHOLE WALL AND FOR BASE SLAB WITH SULPHATE RESISTANCE CEMENT.
9. ALL REINFORCEMENT BARS SHALL BE HYSD CRS BARS OF GRADE Fe 500 CONFORMING TO IS:1786.
10. CLEAR COVER TO MAIN REINFORCEMENT SHALL BE:
    a)WALL SOIL SEWAGE FACE=50mm
    b)BASE SLAB =50mm
11. THIS DRAWING IS ONLY TYPICAL CONSTRUCTION DRAWING. THE CONTRACTOR HAS TO TAKE PRIOR APPROVAL TO THE PROCESS OF MANUFACTURE OF THE PRECAST MANHOLE.
12. NET SAFE BEARING CAPACITY IS ASSUMED TO BE 10 TON/Sq.m. IF LOWER SBC ENCOUNTERED, THE BASE SLAB THICKNESS SHALL BE INCREASED AS PER DIRECTION OF ENGINEER.
13. PRE CAST FRAME AND COVER AS PER IS:12592-2002.
14. LOWEST FOOT REST SHALL NOT BE MORE THAN 300mm ABOVE BENCHING.
15. FOR MINIMUM DEPTH-MANHOLES(1.25m), WHEREVER OCCURS,THE CONICAL SECTION AND THE RISER SEGMENT (H1) MAY BE CAST AS A SINGLE UNIT BASED ON THE SITE CONDITIONS.
16. PROVISION FOR INCOMING SEWERS, HOUSE SERVICE CONNECTIONS IF ANY SHALL BE PROVIDED
17. PROVISION FOR DROP (FOR DROP ARRANGEMENT) IN MH's SHALL BE PROVIDED AS PER SITE REQUIREMENT AND AS DIRECTED
18. INCASE OF HIGHER DIAMETER PIPES, PROVISION FOR THE INCOMING AND OUTGOING SEWERS MAY BE PROVIDED IN TWO PRECAST MEMEBERS OR HEIGHT OF THE BOTTOM PRECAST MEMBERS MAY BE INCREASED
19. ADDITION REINFORCEMENT AS PER APPROVED DRAWINGS IN AND ALLROUND PIPE OPENINGS SHALL BE PROVIDED
20. INTERCONNECTION WITH INCOMING & OUTGOING SEWERS INCLUDING FIXING THEM WITH RCC M30 GRADE CONCRETE
21. THE WORK SHALL BE DONE AS PER BOQ, SPECIFICATIONS AND CONTRACT PROVISIONS.

LEGEND:

FGL	FINISHED GROUND LEVEL
RL	REDUCED LEVEL
LVL	LEVEL
THK	THICKNESS
TYP	TYPICAL
BW	BOTH WAYS
BF	BOTH FACES
RF/REINF	REINFORCEMENT
DIA	DIAMETER
NTS	NOT TO SCALE
CB	CIRCULAR BEAM
RCC	REINFORCED CEMENT CONCRETE
MAX	MAXIMUM
DI	DUCTILE IRON
ADDL	ADDITIONAL
PCC	PLAIN CEMENT CONCRETE
C/C	CENTER-TO-CENTER
HFL	HIGH FLOOD LEVEL
MIN	MINIMUM
M/S	MILD STEEL

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	- -

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:
RCC PRECAST SEWER MACHINE HOLE DETAILS 1800mm DIA (TYPICAL) FOR DEPTH UPTO 8.0M

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE: (CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3031	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3031.dwg		A1 SIZE

TITLE: RCC PRECAST SEWER MACHINE HOLE DETAILS 1800MM DIA (TYPICAL) FOR DEPTH UPTO 10.0M

DWG NO: TN-KWSDRP-WBS3-CV-3032

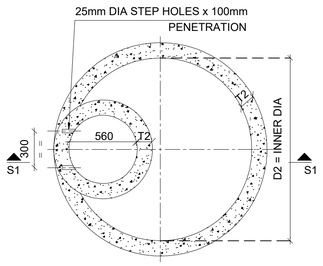

1 PLAN AT MACHINE HOLE TOP LVL
SCALE : NTS

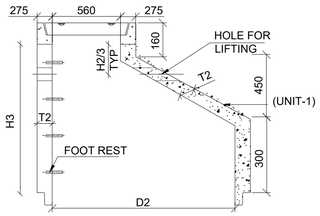

3 DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS



DETAIL OF 'Y'
TYP.JOINING DETAILS OF 1800 DIA PRECAST SEGMENT



DETAILS OF 'Z'
TYP.JOINING DETAILS OF 1800 DIA PRECAST SEGMENT

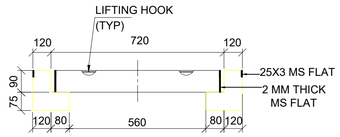

DETAIL OF 'X'
HD-20 MACHINE HOLE COVER

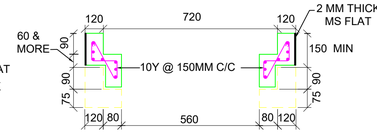

ADDITIONAL MACHINE HOLE HEIGHT TO MATCH FINISHED ROAD LEVEL



DETAILS OF BASE SLAB

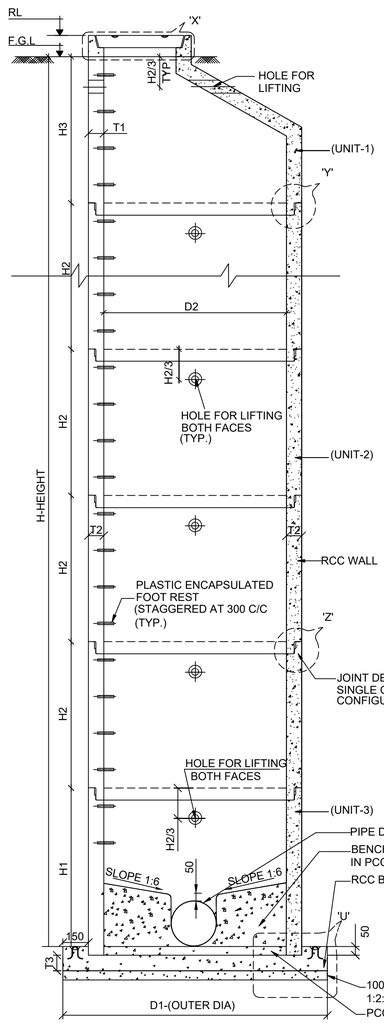

2 SECTION S1-S1
SCALE:NTS

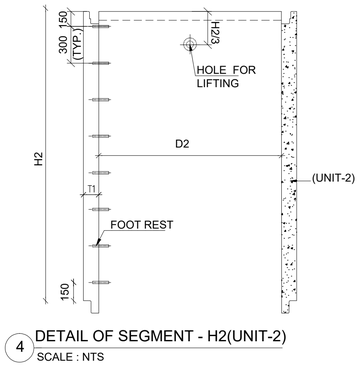

4 DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS



DETAIL OF 'U'



TYPICAL PLASTIC ENCAPSULATED FOOT REST DETAILS

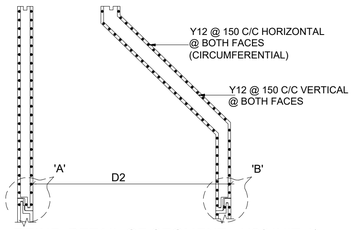

5 REINF. DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS

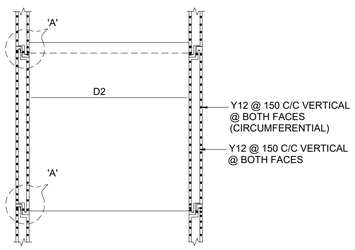

6 REINF. DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS



JOINING DETAIL - 'A'

JOINING DETAIL - 'B'

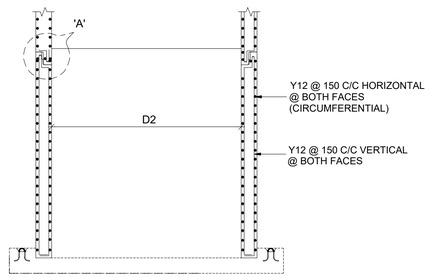

7 REINF. DETAIL OF SEGMENT - H1(UNIT-3)
SCALE : NTS

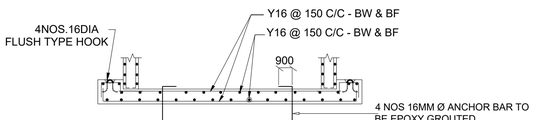

8 REINF. DETAIL OF BASE SLAB
SCALE : NTS

STANDARD DATA FOR PRECAST MACHINE HOLE								
1	**BASE SECTION**							PROVISION
a)	SIZE(DIAMETER) IN mm							1800
b)	DIA WISE DIMENSIONS							
	INNER DIA.OF BASE(D2) (mm)	WALL THK.(T1) (mm)	WALL THK.(T2) (mm)	JOINT DEPTH (mm)	BASE THK.(T3) (mm)	OUTER DIA.OF BASE(D1) (mm)	HEIGHT	
	1800	275	275	50	350	2650	UPTO 10m	
c)	AVAILABLE HEIGHT FOR BASE IN MM(H1)							300 TO 700 OR AS REQUIRED
d)	HOLES FOR SEWER CONNECTIONS							100mmØ MORE THAN OUTER Ø OF SEWER
e)	A)MAT CONCRETE THICKNESS IN MM & MIX							100mmTHICK,1:2:4 MIX
	B)CONCRETE MIX FOR WALL AND BASE							RCC M30 GRADE
f)	CONCRETE FILL FOR BENCHING							1:2:4, MIX WITH 1:6 SLOPE
g)	REINFORCEMENT							
	a)FOR BASE SLAB							AS PER RC DETAIL
	b)FOR WALL							AS PER RC DETAIL
2	**RISER SECTION**							
a)	AVAILABLE HEIGHT FOR RISER SECTION (H2)							300 TO 900 OR AS REQUIRED
b)	WALL THICKNESS IN MM							275mm
c)	JOINT THICKNESS AND JOINT MATERIAL							SAME AS BASE SECTION
d)	REINFORCEMENT IN THE WALL							AS PER DETAIL DRG.
3	**ECCENTRIC CONE SECTION**							
a)	SHAPE							ECCENTRIC CONE
b)	CONCRETE FILL AROUND SEWER							1:1.5:3MIX
c)	THICKNESS(T2)							275mm
d)	REINFORCEMENT							AS PER DETAIL DRG.
e)	TOP OPENING							560mm
f)	JOINT DEPTH							AS PER DETAIL DRG.
4	**STANDARD** MACHINE HOLE **FRAME AND COVER**							AS PER IS 12592-2002
a)	SHAPE							FLAT
b)	COVER SIZE							560mm
c)	SPECIFICATION							HD-20

NOTE:

1. ALL DIMENTIONS ARE IN mm AND ALL LEVELS ARE IN METER.
2. THE LIFTING HOLES SHALL BE FILLED WITH CONCRETE 1:1.5:3 MIX.
3. 3mm PVC ENCAPSULATE ON 12mm BAR, FOOT STEPS Fe 500.
4. THE NON CORE OPENING SHALL BE 100mm GREATER THAN THE OUTER DIA OF SEWER
5. SINGLE OFFSET JOINT CONFIGURATION SHALL BE ADOPTED AT THE JOINT.
6. THE JOINT SHALL BE SEALED WITH NON SHRINK GROUT/SINGLE RUBBER SEAL SHALL BE PROVIDED IN PRECAST UNITS.RUBBER GASKET SHALL BE AS PER IS 5382.
7. 150mm LIP IS OPTIONAL UNLESS OTHERWISE NOTED.
8. GRADE OF CONCRETE SHALL BE RCC M30 MIX FOR MANHOLE WALL AND FOR BASE SLAB WITH SULPHATE RESISTANCE CEMENT.
9. ALL REINFORCEMENT BARS SHALL BE HYSD CRS BARS OF GRADE Fe 500 CONFORMING TO IS:1786.
10. CLEAR COVER TO MAIN REINFORCEMENT SHALL BE:
    a)WALL SOIL SEWAGE FACE=50mm
    b)BASE SLAB =50mm
11. THIS DRAWING IS ONLY TYPICAL CONSTRUCTION DRAWING. THE CONTRACTOR HAS TO TAKE PRIOR APPROVAL TO THE PROCESS OF MANUFACTURE OF THE PRECAST MANHOLE.
12. NET SAFE BEARING CAPACITY IS ASSUMED TO BE 10 TON/Sq.m. IF LOWER SBC ENCOUNTERED, THE BASE SLAB THICKNESS SHALL BE INCREASED AS PER DIRECTION OF ENGINEER.
13. PRE CAST FRAME AND COVER AS PER IS:12592-2002.
14. LOWEST FOOT REST SHALL NOT BE MORE THAN 300mm ABOVE BENCHING.
15. FOR MINIMUM DEPTH-MANHOLES(1.25m), WHEREVER OCCURS,THE CONICAL SECTION AND THE RISER SEGMENT (H1) MAY BE CAST AS A SINGLE UNIT BASED ON THE SITE CONDITIONS.
16. PROVISION FOR INCOMING SEWERS, HOUSE SERVICE CONNECTIONS IF ANY SHALL BE PROVIDED
17. PROVISION FOR DROP (FOR DROP ARRANGEMENT) IN MH's SHALL BE PROVIDED AS PER SITE REQUIREMENT AND AS DIRECTED
18. INCASE OF HIGHER DIAMETER PIPES, PROVISION FOR THE INCOMING AND OUTGOING SEWERS MAY BE PROVIDED IN TWO PRECAST MEMEBERS OR HEIGHT OF THE BOTTOM PRECAST MEMBERS MAY BE INCREASED
19. ADDITION REINFORCEMENT AS PER APPROVED DRAWINGS IN AND ALLROUND PIPE OPENINGS SHALL BE PROVIDED
20. INTERCONNECTION WITH INCOMING & OUTGOING SEWERS INCLUDING FIXING THEM WITH RCC M30 GRADE CONCRETE
21. THE WORK SHALL BE DONE AS PER BOQ, SPECIFICATIONS AND CONTRACT PROVISIONS.

LEGEND:

FGL	FINISHED GROUND LEVEL
RL	REDUCED LEVEL
LVL	LEVEL
THK	THICKNESS
TYP	TYPICAL
BW	BOTH WAYS
BF	BOTH FACES
RF/REINF	REINFORCEMENT
DIA	DIAMETER
NTS	NOT TO SCALE
CB	CIRCULAR BEAM
RCC	REINFORCED CEMENT CONCRETE
MAX	MAXIMUM
DI	DUCTILE IRON
ADDL	ADDITIONAL
PCC	PLAIN CEMENT CONCRETE
C/C	CENTER-TO-CENTER
HFL	HIGH FLOOD LEVEL
MIN	MINIMUM
M/S	MILD STEEL

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	- -

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS (WORKS - A) AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS (WORKS - B) HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: RCC PRECAST SEWER MACHINE HOLE DETAILS 1800mm DIA (TYPICAL) FOR DEPTH UPTO 10.0M

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE: (CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3032	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3032.dwg		A1 SIZE

TITLE: STANDARD DETAILS OF R.C.C CAST IN-SITU MACHINE HOLE 1200MM,1500MM,1800MM DIA UPTO 3.0M 1500MM,1800MM DIA UPTO 6M DEPTH (TYPICAL)

DWG NO: TN-KWSDRP-WBS3-CV-3033



1 PLAN AT MACHINE HOLE TOP LVL
SCALE : NTS

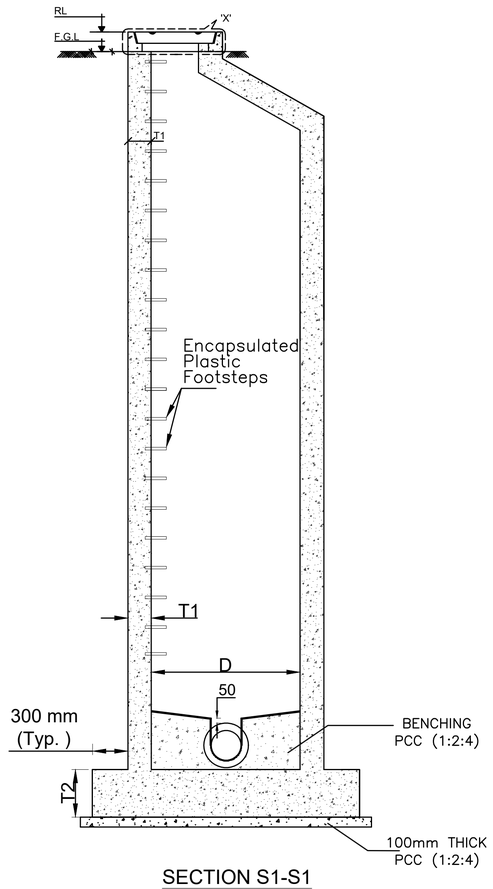

SECTION S1-S1
SECTIONAL DETAILS OF MACHINE HOLE

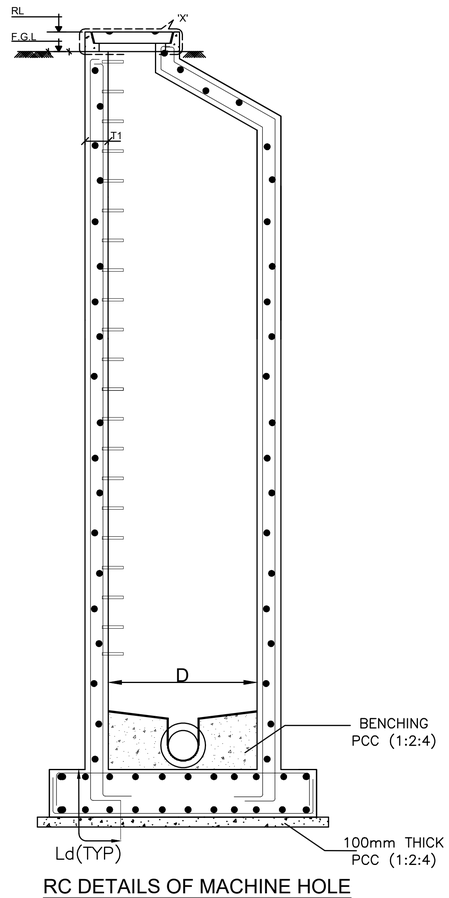

RC DETAILS OF MACHINE HOLE

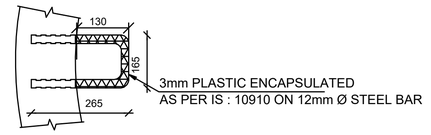

TYPICAL PLASTIC ENCAPSULATED
FOOT REST DETAILS

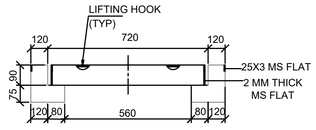

DETAIL OF 'X'
HD-20 MACHINE HOLE COVER

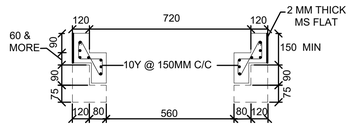

ADDITIONAL MACHINE HOLE HEIGHT
TO MATCH FINISHED ROAD LEVEL

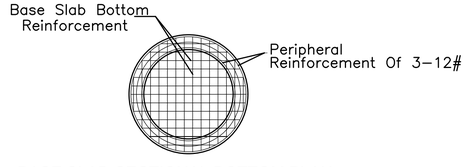

BASE SLAB-SECTIONAL BOTTOM PLAN

NOTE:

1. ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.
2. NO DIMENSION SHALL BE SCALED FROM THE DRAWING.
3. ALL DRAWINGS ARE INTERRELATED AND SHALL BE READ IN CONJUNCTION WITH ONE ANOTHER.
4. GRADE OF CONCRETE MIX SHALL BE M30 CONFIRMING TO I.S 456-2000.
5. ONLY SULPHATE RESISTING CEMENT CONFIRMING TO IS:12330:1988 SHALL BE USED FOR ALL CONCRETING WORKS.
6. ALL REINFORCEMENT BARS SHALL BE HYSD CRS BARS OF GRADE Fe 500 CONFIRMING TO IS:1786.
7. ANY CHANGE IN SBC OF SOIL LESS THAN 12 TON THE DESIGN OF FOUNDATION SHALL BE REVISED AS PER ACTUAL SBC.
8. TOP OF MANHOLE COVER SHALL BE FLUSH WITH FINISHED ROAD LEVEL AND AS DIRECTED BY ENGINEER.
9. PROVISION FOR INCOMING SEWERS, HOUSE SERVICE CONNECTIONS IF ANY SHALL BE PROVIDED.
10. #, ₹ DENOTES HYSD BARS
11. 3mm PVC ENCAPSULATED 12mm BAR, FOOT STEPS IN Fe 500
12. PROVISION FOR DROP (FOR DROP ARRANGEMENT) IN MH's SHALL BE PROVIDED AS PER SITE REQUIREMENT AND AS DIRECTED
13. ADDITION REINFORCEMENT AS PER APPROVED DRAWINGS IN AND ALLROUND PIPE OPENINGS SHALL BE PROVIDED
14. INTERCONNECTION WITH INCOMING & OUTGOING SEWERS INCLUDING FIXING THEM WITH RCC M30 GRADE CONCRETE
15. THE WORK SHALL BE DONE AS PER SPECIFICATIONS.
16. DEVELOPMENT LENGTH Ld = 46D WHERE D IS DIAMETER OF BAR.

TABLE - 1
DIMENSION DETAILS OF MACHINE HOLE

SL.No	(Dia of Manhole) in 'mm'	(Wall height) in 'mm'	(Wall thickness) in 'mm'	(Base Slab thickness) in 'mm'
	D	H	T1	T2
1	1200	Upto 3000	200	200
2	1500	Upto 3000	200	200
3	1800	Upto 3000	200	200
4	1500	Upto 6000	250	300
5	1800	Upto 6000	250	300

TABLE - 2
REINFORCEMENT DETAILS OF MACHINE HOLE

SL.No	(Dia of Manhole) in 'mm'	(Wall height) in 'mm'	Base Slab Reinforcement (Bothways-Top & Bottom)	Wall Reinforcement	
				Hoop Reinforcement	Longitudinal Reinforcement
	D	H			
1	1200	Upto 3000	Y10@200c/c	Y10@200c/c	Y10@200c/c
2	1500	Upto 3000	Y10@200c/c	Y10@200c/c	Y10@200c/c
3	1800	Upto 3000	Y12@200c/c	Y12@200c/c	Y12@200c/c
4	1500	Upto 6000	Y12@150c/c	Y12@150c/c	Y12@150c/c
5	1800	Upto 6000	Y12@150c/c	Y12@150c/c	Y12@150c/c

LEGEND:

FGL	FINISHED GROUND LEVEL
RL	REDUCED LEVEL
LVL	LEVEL
THK	THICKNESS
TYP	TYPICAL
BW	BOTH WAYS
BF	BOTH FACES
RF/REINF	REINFORCEMENT
DIA	DIAMETER
NTS	NOT TO SCALE
CB	CIRCULAR BEAM
RCC	REINFORCED CEMENT CONCRETE
MAX	MAXIMUM
DI	DUCTILE IRON
ADDL	ADDITIONAL
PCC	PLAIN CEMENT CONCRETE
C/C	CENTER-TO-CENTER
HFL	HIGH FLOOD LEVEL
MIN	MINIMUM
M/S	MILD STEEL

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	– –

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: STANDARD DETAILS OF R.C.C CAST IN-SITU MACHINE HOLE
1200mm,1500mm,1800mm DIA UPTO 3.0m
1500mm,1800mm DIA UPTO 6m DEPTH (TYPICAL)

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3033	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3033.dwg		A1 SIZE

TITLE: RCC CAST IN SITU MACHINE HOLE 1200MM, 1500MM & 1800MM DIA UPTO 3.0M 6M DEPTH (TYPICAL)

DWG NO: TN-KWSDRP-WBS3-CV-3034



1 PLAN AT MACHINE HOLE TOP LVL
SCALE : NTS

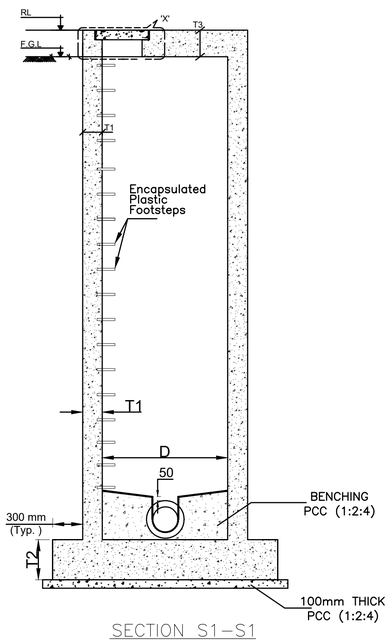

SECTION S1–S1
SECTIONAL DETAILS OF MACHINE HOLE

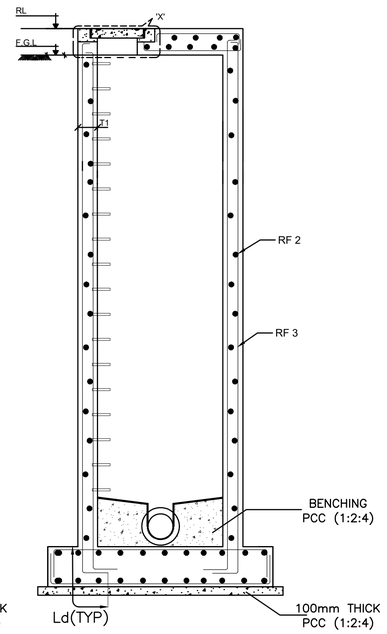

RC DETAILS OF MACHINE HOLE

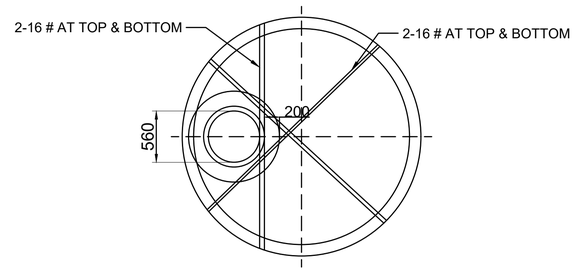

ADDITIONAL REINFORCEMENT DETAIL AROUND MACHINE HOLE OPENING

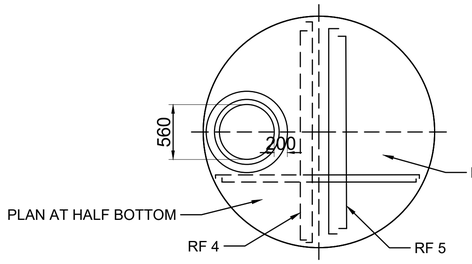

MACHINE HOLE TOP SLAB

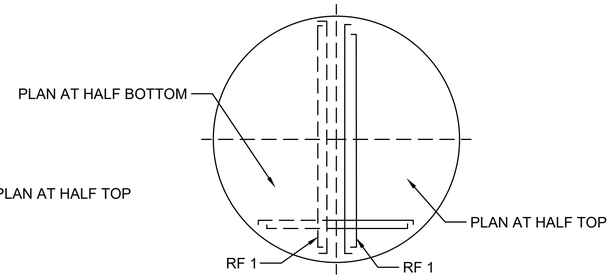

MACHINE HOLE BOTTOM RAFT SLAB

TABLE - 2

REINFORCEMENT DETAILS OF MACHINE HOLE

SL.No	(Dia of Manhole) in 'mm'	(Wall height) in 'mm'	Base Slab Reinforcement (Bothways-Top & Bottom)	Wall Reinforcement		Top Slab Reinforcement	
				Hoop Reinforcement	Longitudinal Reinforcement (Vertical)	Bothways Bottom	Bothways Top
	D	H	RF1	RF2	RF3	RF4	RF5
1	1200	Upto 3000	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y16@125c/c	Y10@125c/c
2	1500	Upto 3000	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y16@125c/c	Y10@125c/c
3	1800	Upto 3000	Y12@200c/c	Y12@200c/c	Y12@200c/c	Y16@100c/c	Y10@100c/c
4	1500	Upto 6000	Y12@150c/c	Y12@150c/c	Y12@150c/c	Y16@125c/c	Y10@125c/c
5	1800	Upto 6000	Y12@150c/c	Y12@150c/c	Y12@150c/c	Y16@100c/c	Y10@100c/c

TABLE - 1

DIMENSION DETAILS OF MACHINE HOLE

SL.No	(Dia of Manhole) in 'mm'	(Wall height) in 'mm'	(Wall thickness) in 'mm'	(Base Slab thickness) in 'mm'	Top Slab Thickness
	D	H	T1	T2	T3
1	1200	Upto 3000	200	200	300
2	1500	Upto 3000	200	200	300
3	1800	Upto 3000	200	200	300
4	1500	Upto 6000	300	300	300
5	1800	Upto 6000	300	300	300

NOTE:

1. ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.
2. NO DIMENSION SHALL BE SCALED FROM THE DRAWING.
3. ALL DRAWINGS ARE INTERRELATED AND SHALL BE READ IN CONJUNCTION WITH ONE ANOTHER.
4. GRADE OF CONCRETE MIX SHALL BE M30 CONFIRMING TO I.S 456–2000.
5. ONLY SULPHATE RESISTING CEMENT CONFIRMING TO IS:12330:1988 SHALL BE USED FOR ALL CONCRETING WORKS.
6. ALL REINFORCEMENT BARS SHALL BE HYSD CRS BARS OF GRADE Fe 500 CONFIRMING TO IS:1786.
7. ANY CHANGE IN SBC OF SOIL LESS THAN 12 TON THE DESIGN OF FOUNDATION SHALL BE REVISED AS PER ACTUAL SBC.
8. TOP OF MANHOLE COVER SHALL BE FLUSH WITH FINISHED ROAD LEVEL AND AS DIRECTED BY ENGINEER.
9. PROVISION FOR INCOMING SEWERS, HOUSE SERVICE CONNECTIONS IF ANY SHALL BE PROVIDED.
10. #, DENOTES HYSD BARS
11. 3mm PVC ENCAPSULATED 12mm BAR, FOOT STEPS IN Fe 500
12. PROVISION FOR DROP (FOR DROP ARRANGEMENT) IN MH's SHALL BE PROVIDED AS PER SITE REQUIREMENT AND AS DIRECTED
13. ADDITION REINFORCEMENT AS PER APPROVED DRAWINGS IN AND ALLROUND PIPE OPENINGS SHALL BE PROVIDED
14. INTERCONNECTION WITH INCOMING & OUTGOING SEWERS INCLUDING FIXING THEM WITH RCC M30 GRADE CONCRETE
15. THE WORK SHALL BE DONE AS PER SPECIFICATIONS.
16. DEVELOPMENT LENGTH Ld = 46D WHERE D IS DIAMETER OF BAR.

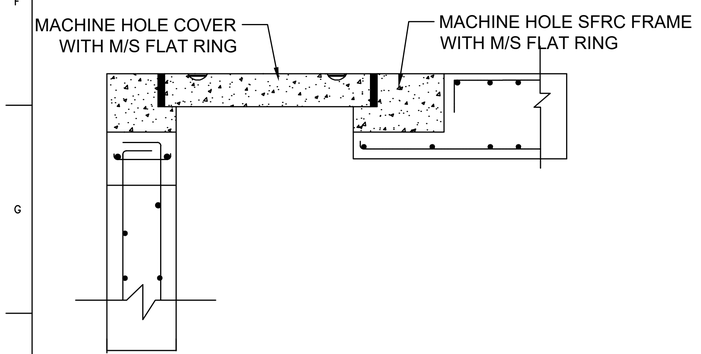

RCC MACHINE HOLE COVER AND FRAME

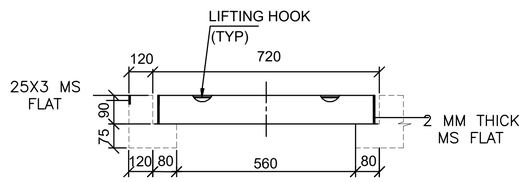

DETAIL OF 'X'
HD-20 MACHINE HOLE COVER

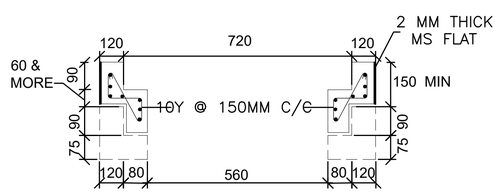

ADDITIONAL MACHINE HOLE HEIGHT TO MATCH FINISHED ROAD LEVEL



TYPICAL PLASTIC ENCAPSULATED FOOT REST DETAILS

LEGEND:

FGL	FINISHED GROUND LEVEL
RL	REDUCED LEVEL
LVL	LEVEL
THK	THICKNESS
TYP	TYPICAL
BW	BOTH WAYS
BF	BOTH FACES
RF/REINF	REINFORCEMENT
DIA	DIAMETER
NTS	NOT TO SCALE
CB	CIRCULAR BEAM
RCC	REINFORCED CEMENT CONCRETE
MAX	MAXIMUM
DI	DUCTILE IRON
ADDL	ADDITIONAL
PCC	PLAIN CEMENT CONCRETE
C/C	CENTER-TO-CENTER
HFL	HIGH FLOOD LEVEL
MIN	MINIMUM
M/S	MILD STEEL

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	– –

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: RCC CAST IN SITU MACHINE HOLE 1200MM, 1500MM & 1800MM DIA UPTO 3.0M 6M DEPTH (TYPICAL)

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3034	ISSUE: P0
FILE NAME: TN–KWSDRP–WBS3–CV–3034.dwg		A1 SIZE

TITLE: RCC PRECAST SEWER MACHINE HOLE DETAILS FOR 1200, 1500 & 1800 DIA (VERTICAL WALL)

DWG NO: TN-KWSDRP-WBS3-CV-3035

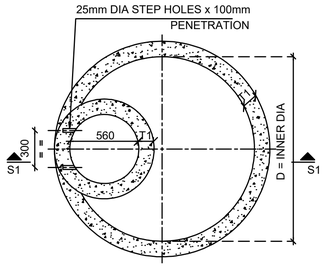

1 PLAN AT MACHINE HOLE TOP LVL
SCALE : NTS

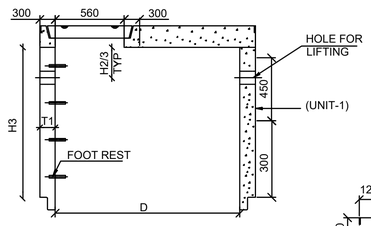

3 DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS



DETAILS OF 'Z'
TYP.JOINING DETAILS OF PRECAST SEGMENT (REFER PRECAST DRAWINGS 1002 TO 1012 FOR DETAILS)



DETAIL OF 'X'
HD-20 MACHINE HOLE COVER

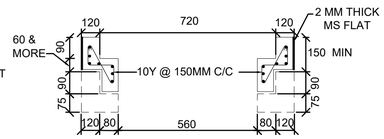

ADDITIONAL MACHINE HOLE HEIGHT TO MATCH FINISHED ROAD LEVEL



DETAILS OF BASE SLAB

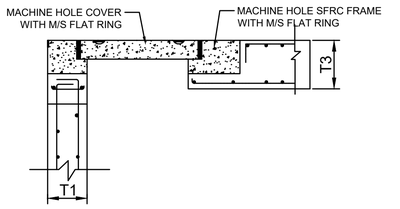

RCC MACHINE HOLE COVER AND FRAME

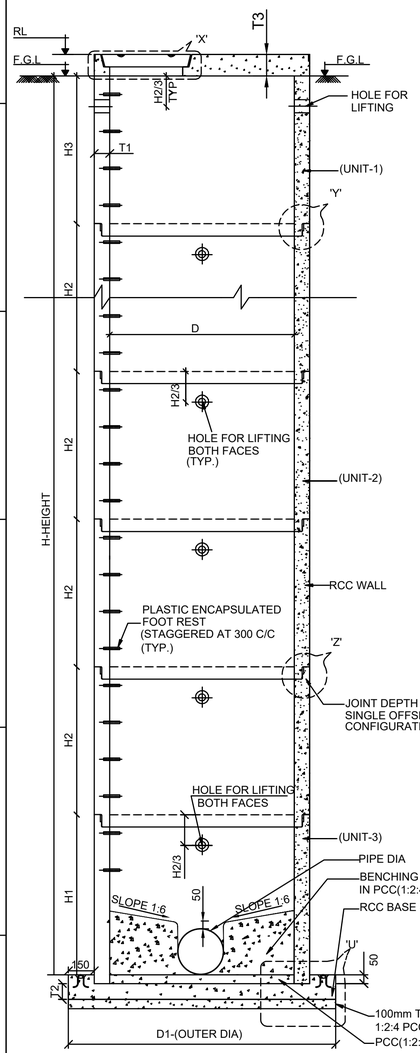

2 SECTION S1-S1
SCALE:NTS

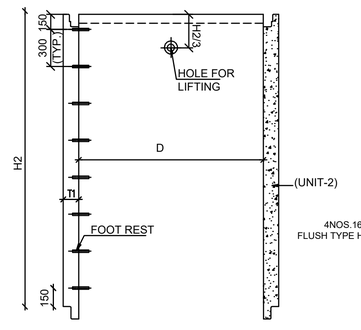

4 DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS



DETAIL OF 'U'



TYPICAL PLASTIC ENCAPSULATED FOOT REST DETAILS

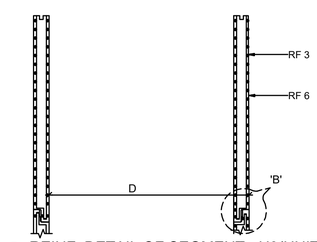

5 REINF. DETAIL OF SEGMENT - H3(UNIT-1)
SCALE : NTS



6 REINF. DETAIL OF SEGMENT - H2(UNIT-2)
SCALE : NTS



JOINING DETAIL - 'A'

JOINING DETAIL - 'B'

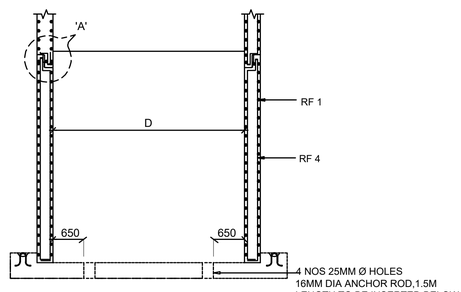

7 REINF. DETAIL OF SEGMENT - H1(UNIT-3)
SCALE : NTS



8 REINF. DETAIL OF BASE SLAB
SCALE : NTS



ADDITIONAL REINFORCEMENT DETAIL AROUND MACHINE HOLE OPENING

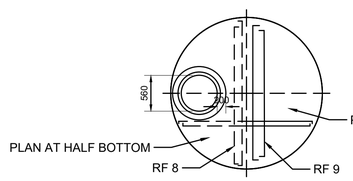

MACHINE HOLE TOP SLAB

DIMENSION DETAILS OF MACHINE HOLE

SL.No	(Dia of Manhole) in 'mm'	(Wall height) in 'mm'	(Wall thickness) in 'mm'	Joint Depth	Base Slab thickness in 'mm'	Over Dia	TOP Slab thickness in 'mm'
	D	H1	T1		T2	D1	T3
1	1200	Upto 3000	200	50	200	1900	300
2	1500	Upto 3000	200	50	250	2200	300
3	1500	Upto 7000	250	50	300	2300	300
4	1800	Upto 3000	200	50	300	2500	300
5	1800	Upto 6000	250	50	300	2600	300
6	1800	Upto 8000	250	50	350	2600	300
7	1800	Upto 10000	275	50	350	2650	300

STANDARD DATA FOR PRECAST MACHINE HOLE		
1	**DETAILS OF MANHOLE**	PROVISION
a)	AVAILABLE HEIGHT FOR BASE IN MM(H1)	300 TO 700 OR AS REQUIRED
b)	HOLES FOR SEWER CONNECTIONS	100mmØ MORE THAN OUTER Ø OF SEWER
c)	A)MAT CONCRETE THICKNESS IN MM & MIX	100mmTHICK,1:2:4 MIX
	B)CONCRETE MIX FOR WALL AND BASE	RCC M30 GRADE
d)	CONCRETE FILL FOR BENCHING	1:2:4, MIX WITH 1:6 SLOPE
e)	REINFORCEMENT	
	a)FOR BASE SLAB	AS PER RC DETAIL
	b)FOR WALL	AS PER RC DETAIL
2	**RISER SECTION**	
a)	AVAILABLE HEIGHT FOR RISER SECTION (H2)	300 TO 900 OR AS REQUIRED
b)	WALL THICKNESS IN MM	200mm
c)	JOINT THICKNESS AND JOINT MATERIAL	SAME AS BASE SECTION
d)	REINFORCEMENT IN THE WALL	AS PER DETAIL DRG.
3	**STANDARD MANHOLE FRAME AND COVER**	AS PER IS 12592-2002
a)	SHAPE	FLAT
b)	COVER SIZE	560mm
c)	SPECIFICATION	HD-20

NOTE:

1. ALL DIMENTIONS ARE IN mm AND ALL LEVELS ARE IN METER.
2. THE LIFTING HOLES SHALL BE FILLED WITH CONCRETE 1:1.5:3 MIX.
3. 3mm PVC ENCAPSULATE ON 12mm BAR, FOOT STEPS Fe 500.
4. THE NON CORE OPENING SHALL BE 100mm GREATER THAN THE OUTER DIA OF SEWER.
5. SINGLE OFFSET JOINT CONFIGURATION SHALL BE ADOPTED AT THE JOINT.
6. THE JOINT SHALL BE SEALED WITH NON SHRINK GROUT/SINGLE RUBBER SEAL SHALL BE PROVIDED IN PRECAST UNITS.RUBBER GASKET SHALL BE AS PER IS 5382.
7. 150mm LIP IS OPTIONAL UNLESS OTHERWISE NOTED.
8. GRADE OF CONCRETE SHALL BE RCC M30 MIX FOR MANHOLE WALL AND FOR BASE SLAB WITH SULPHATE RESISTANCE CEMENT.
9. ALL REINFORCEMENT BARS SHALL BE HYSD CRS BARS OF GRADE Fe 500 CONFORMING TO IS:1786.
10. CLEAR COVER TO MAIN REINFORCEMENT SHALL BE:
    a)WALL SOIL SEWAGE FACE=50mm
    b)BASE SLAB =50mm
11. THIS DRAWING IS ONLY TYPICAL CONSTRUCTION DRAWING. THE CONTRACTOR HAS TO TAKE PRIOR APPROVAL TO THE PROCESS OF MANUFACTURE OF THE PRECAST MANHOLE.
12. NET SAFE BEARING CAPACITY IS ASSUMED TO BE 10 TON/Sq.m. IF LOWER SBC ENCOUNTERED, THE BASE SLAB THICKNESS SHALL BE INCREASED AS PER DIRECTION OF ENGINEER.
13. PRE CAST FRAME AND COVER AS PER IS:12592-2002.
14. LOWEST FOOT REST SHALL NOT BE MORE THAN 300mm ABOVE BENCHING.
15. FOR MINIMUM DEPTH-MANHOLES(1.25m), WHEREVER OCCURS,THE CONICAL SECTION AND THE RISER SEGMENT (H1) MAY BE CAST AS A SINGLE UNIT BASED ON THE SITE CONDITIONS.
16. PROVISION FOR INCOMING SEWERS, HOUSE SERVICE CONNECTIONS IF ANY SHALL BE PROVIDED
17. PROVISION FOR DROP (FOR DROP ARRANGEMENT) IN MH's SHALL BE PROVIDED AS PER SITE REQUIREMENT AND AS DIRECTED
18. INCASE OF HIGHER DIAMETER PIPES, PROVISION FOR THE INCOMING AND OUTGOING SEWERS MAY BE PROVIDED IN TWO PRECAST MEMEBERS OR HEIGHT OF THE BOTTOM PRECAST MEMBERS MAY BE INCREASED
19. ADDITION REINFORCEMENT AS PER APPROVED DRAWINGS IN AND ALLROUND PIPE OPENINGS SHALL BE PROVIDED
20. INTERCONNECTION WITH INCOMING & OUTGOING SEWERS INCLUDING FIXING THEM WITH RCC M30 GRADE CONCRETE
21. THE WORK SHALL BE DONE AS PER BOQ, SPECIFICATIONS AND CONTRACT PROVISIONS.
22. *REFER RELEVANT PRECAST SECTION FROM DRAWING No. 1002 TO 1012 FOR SECTIONAL DETAILS.

LEGEND:

FGL	FINISHED GROUND LEVEL	NTS	NOT TO SCALE
RL	REDUCED LEVEL	CB	CIRCULAR BEAM
LVL	LEVEL	RCC	REINFORCED CEMENT CONCRETE
THK	THICKNESS	MAX	MAXIMUM
TYP	TYPICAL	DI	DUCTILE IRON
BW	BOTH WAYS	ADDL	ADDITIONAL
BF	BOTH FACES	PCC	PLAIN CEMENT CONCRETE
RF/REINF	REINFORCEMENT	C/C	CENTER-TO-CENTER
DIA	DIAMETER	HFL	HIGH FLOOD LEVEL
		MIN	MINIMUM
		M/S	MILD STEEL

REINFORCEMENT DETAILS OF MACHINE HOLE

SL.No	(Dia of Manhole) in 'mm'	(Wall height) in 'mm'	HOOP			VERTICAL R/F				Top Slab Reinforcement	
			H1	H2	H3	H1	H2	H3	Base Slab Reinforcement (Bothways-Top & Bottom)	Bothways Bottom	Bothways Top
	D	H	RF1	RF2	RF3	RF4	RF5	RF6	RF7	RF8	RF9
1	1200	Upto 3000	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y16@125c/c	Y16@125c/c
2	1500	Upto 3000	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y16@125c/c	Y16@125c/c
3	1500	Upto 7000	Y10@150c/c	Y10@150c/c	Y10@150c/c	Y10@150c/c	Y10@150c/c	Y10@150c/c	Y12@200c/c	Y16@125c/c	Y16@125c/c
4	1800	Upto 3000	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y12@200c/c	Y16@100c/c	Y10@100c/c
5	1800	Upto 6000	Y10@150c/c	Y10@150c/c	Y10@150c/c	Y10@150c/c	Y10@150c/c	Y10@150c/c	Y12@200c/c	Y16@100c/c	Y10@100c/c
6	1800	Upto 8000	Y12@200c/c	Y12@200c/c	Y12@200c/c	Y12@200c/c	Y12@200c/c	Y12@200c/c	Y16@200c/c	Y16@100c/c	Y10@100c/c
7	1800	Upto 10000	Y12@150c/c	Y12@150c/c	Y12@150c/c	Y12@150c/c	Y12@150c/c	Y12@150c/c	Y16@150c/c	Y16@100c/c	Y10@100c/c

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	- -

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: RCC PRECAST SEWER MACHINE HOLE DETAILS FOR 1200, 1500 & 1800 DIA (VERTICAL WALL)

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE: (CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3035	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3035.dwg		A1 SIZE

TITLE: STANDARD DETAILS OF R.C.C CAST IN-SITU MACHINE HOLE 1200MM,1500MM,1800MMDIA UPTO 3M DEPTH 1500MM,1800MMUPTO 6M DEPTH (TYPICAL) WITH VENTILATION SHAFT

DWG NO: TN-KWSDRP-WBS3-CV-3036

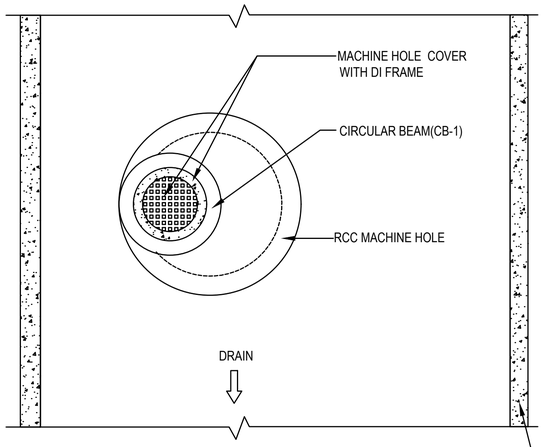

PLAN OF MAN HOLE INSIDE THE DRAIN (RCC)

(SCALE 1:30)

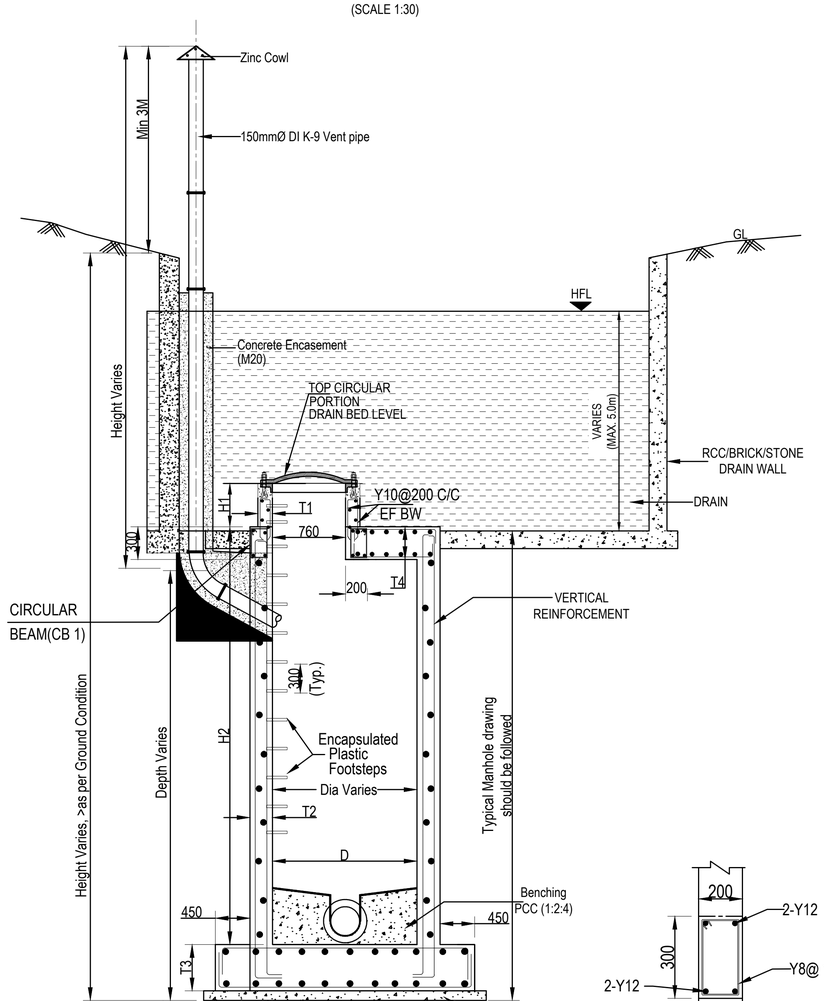

SECTIONAL DETAILS OF MANHOLE INSIDE THE DRAIN (RCC)

(SCALE 1:30)

VALID FOR 3 TO 6M BELOW DRAIN

TABLE - 1

DIMENSION DETAILS OF MACHINE HOLE

SL.No	(DIA OF MACHINE HOLE) in 'mm'	(Wall height) in 'mm'	(Wall thickness in 'mm'	(Wall thickness) in 'mm'	(Base Slab thickness) in 'mm'	(Roof Slab thickness) in 'mm'
	D	H2	T1	T2	T3	T4
1	1200	upto 3000	150	200	200	300
2	1500					
3	1800					
5	1500	3000 to 6000	150	300	300	300
6	1800					

TABLE - 2

REINFORCEMENT DETAILS OF MACHINE HOLE

SL.No	(DIA OF MACHINE HOLE) in 'mm'	(Wall height) in 'mm'	Base Slab Reinforcement (a)	Wall Reinforcement			Roof Slab Reinforcement (a)
				Hoop Reinforcement (c)		Longitudinal Reinforcement (b)	
				upto half the height (h) from the bottom	Top half the height (h)		
	D	H2					
1	1200	upto 3000	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c
2	1500		Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c	Y10@200c/c
3	1800		Y12@200 c/c	Y12@200 c/c	Y12@200 c/c	Y12@200c/c	Y12@200 c/c
4	1500	3000 to 6000	Y12@150c/c	Y12@150c/c	Y12@150c/c	Y12@150c/c	T12@150c/c
5	1800		Y12@150c/c	Y12@150c/c	Y12@150c/c	Y12@150c/c	Y12@125c/c

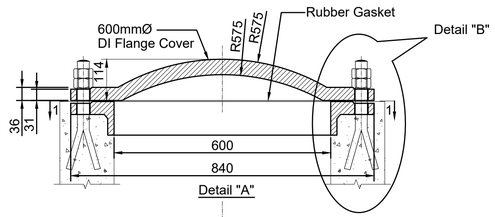

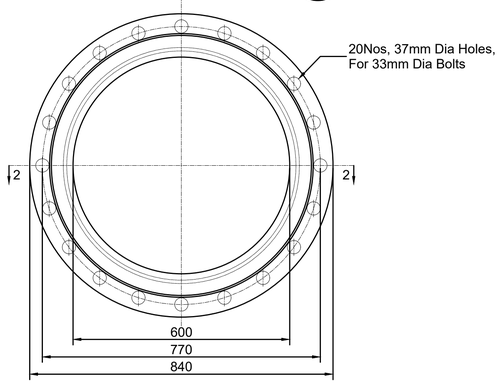

Section 1-1

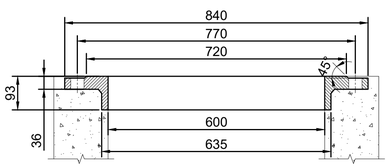

Section 2-2

(SCALE 1:5)



CIRCULAR BEAM (CB 1)

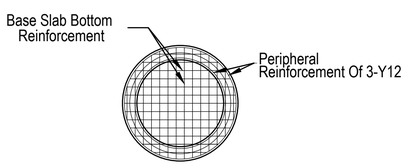

BASE SLAB-SECTIONAL BOTTOM PLAN



Detail "B"

(SCALE 1:4)



Bolt Details

(SCALE 1:2)

NOTE:

1. ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.
2. NO DIMENSION SHALL BE SCALED FROM THE DRAWING.
3. ALL DRAWINGS ARE INTERRELATED AND SHALL BE READ IN CONJUNCTION WITH ONE ANOTHER.
4. GRADE OF CONCRETE MIX SHALL BE M30 CONFIRMING TO I.S 456–2000.
5. ONLY SULPHATE RESISTING CEMENT CONFIRMING TO IS:12330:1988 SHALL BE USED FOR ALL CONCRETING WORKS.
6. ALL REINFORCEMENT BARS SHALL BE HYSD CRS BARS OF GRADE Fe 500 CONFIRMING TO IS:1786.
7. ANY CHANGE IN SBC OF SOIL LESS THAN 12 TON THE DESIGN OF FOUNDATION SHALL BE REVISED AS PER ACTUAL SBC.
8. TOP OF MACHINE HOLE COVER SHALL BE FLUSH WITH FINISHED ROAD LEVEL AND AS DIRECTED BY ENGINEER.
9. IF THE SEWER ROUTE IS PARALLEL TO NALLA/DRAIN/LAKE THEN THE TOP OF MACHINE HOLES SHOULD BE ATLEAST 0.2 m ABOVE THE HFL OF THE NALLA/DRAIN/LAKE OR AS DIRECTED BY THE ENGINEER.
10. WHEREVER THE SEWER ROUTE IS INSIDE THE NALLA, DRAIN BED LEVEL SHALL BE TAKEN FOR THE DESIGN AND THE DEPTH OF MH SHALL BE AS DIRECTED BY THE ENGINEER.
11. H1 IS 1500MM FOR MACHINE HOLE HEIGHT UP TO 3000 MM AND 3000 MM FOR MACHINE HOLE HEIGHT FROM 3000 MM TO 10000 MM OR AS PER SITE CONDTION.
12. PROVISION FOR INCOMING SEWERS, HOUSE SERVICE CONNECTIONS IF ANY SHALL BE PROVIDED.
13. Y DENOTES HYSD BARS
14. 3mm PVC ENCAPSULATE ON 12mm BAR, FOOT STEPS Fe 500
15. PROVISION FOR DROP (FOR DROP ARRANGEMENT) IN MH's SHALL BE PROVIDED AS PER SITE REQUIREMENT AND AS DIRECTED
16. IN CASE OF MACHINE HOLES IN DRAIN/NALLAH, FIXING OF THE TOP OF THE COVER SHALL BE WITH REINFORCEMENT RODS ANCHORD WITH HOOKS ON THE WALLS FOR PROTECTING AGAINST UPLIFT/LIFTING OF THE COVER
17. ADDITIONAL REINFORCEMENT AS PER APPROVED DRAWINGS IN AND ALLROUND PIPE OPENINGS SHALL BE PROVIDED
18. INTERCONNECTION WITH INCOMING & OUTGOING SEWERS INCLUDING FIXING THEM WITH RCC M30 GRADE CONCRETE
19. IN CASE OF CAST IN–SITU MACHINE HOLE TO BE CONSTRUCTED IN ROAD, MACHINE HOLE SHALL BE CONSTRUCTED WITHOUT TOP CIRCULAR PORTION.
20. THE WORK SHALL BE DONE AS PER BOQ, SPECIFICATIONS AND CONTRACT PROVISIONS.
21. GAP TO MATCH FORMWORK AT SITE (50–75mm).
22. VENTILATING SHAFT WILL BE PROVIDED AS PER SITE CONDITION & AS DIRECTED BY ENGINEER.
23. VERTICAL SHAFT CAN BE INSIDE/OUTSIDE THE SWD DEPENDS ON SITE CONDITION & UPON APPROVAL OF ENGINEER.

LEGEND:

FGL	FINISHED GROUND LEVEL
RL	REDUCED LEVEL
LVL	LEVEL
THK	THICKNESS
TYP	TYPICAL
BW	BOTH WAYS
BF	BOTH FACES
RF/REINF	REINFORCEMENT
DIA	DIAMETER
NTS	NOT TO SCALE
CB	CIRCULAR BEAM
RCC	REINFORCED CEMENT CONCRETE
MAX	MAXIMUM
DI	DUCTILE IRON
ADDL	ADDITIONAL
PCC	PLAIN CEMENT CONCRETE
C/C	CENTER-TO-CENTER
HFL	HIGH FLOOD LEVEL
MIN	MINIMUM
M/S	MILD STEEL

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV / CIVIL	- / -

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS (WORKS - A) AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS (WORKS - B) HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: STANDARD DETAILS OF R.C.C CAST IN-SITU MACHINE HOLE 1200mm,1500mm,1800mmDIA UPTO 3m DEPTH 1500mm,1800mmUPTO 6m DEPTH (TYPICAL) WITH VENTILATION SHAFT

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE: (CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3036	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3036.dwg		A1 SIZE

TITLE: PLAN & SECTION OF BRICK MASONRY MACHINE HOLE FOR 1.2 M DIA, 2M & 6M DEPTH

DWG NO: TN-KWSDRP-WBS3-CV-3037

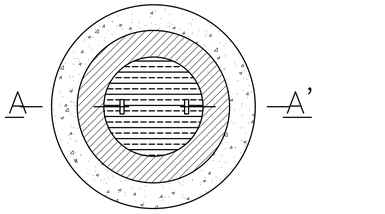

PLAN

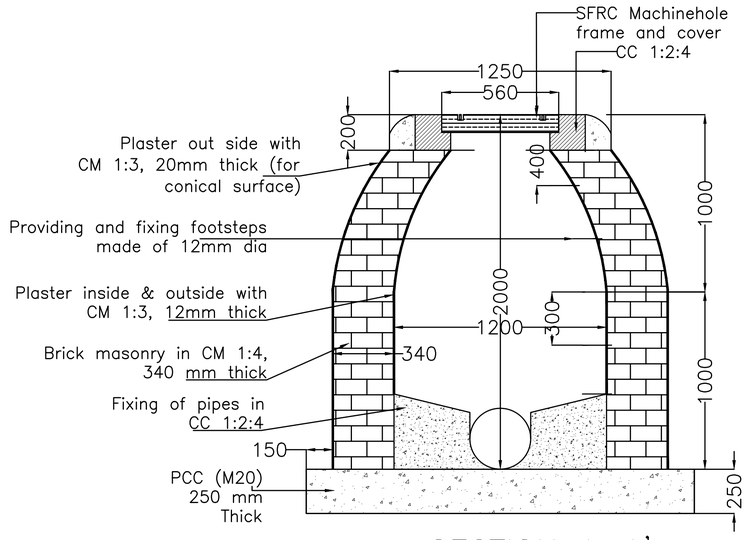

SECTION A–A'

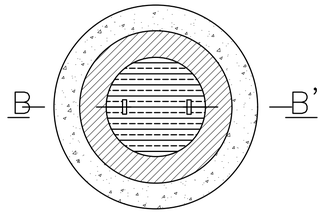

PLAN

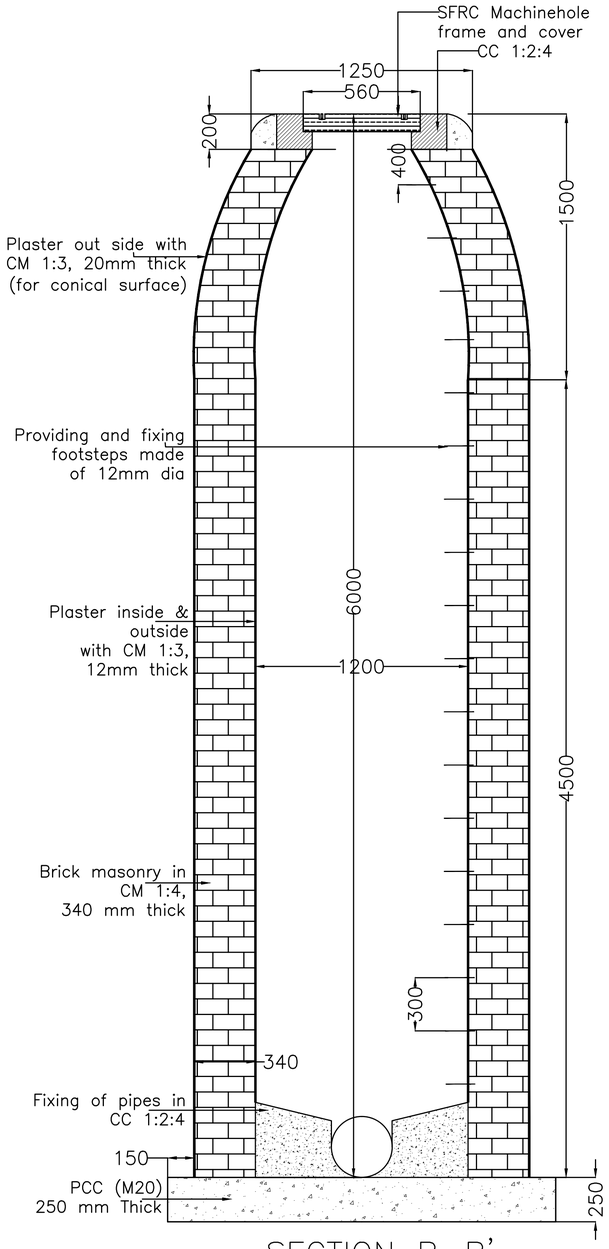

SECTION B–B'

NOTES:

1. **All levels are in MM, Unless Other Wise Mentioned.**
2. **All Levels Are With Reference To The Gts Bench Mark Engraved On Centre Of 2nd Stones** On East Side Of Queen Victoria's Statue In Cubbon Park, Bangalore. Its Value Is 912.266m.
3. All the Co–ordinates are based on UTM WGS–84.

DRAWING / DOCUMENT REVIEW STATUS

Date of Receipt .....

A. Approved, manufacture / construction may commence.
B. Acceptable subject to changes indicated, resubmit for approval but manufacture/ construction may commence.
C. Amend as per the comments indicated and resubmit for approval.
D. Comments noted in letter/memo attached to forwarding transmittal Nr..... dated ..... Amend as comments indicated resubmit for approval.
E. Amend as comments indicated resubmit for record.
F. Comments noted in letter/memo attached to forwarding transmittal Nr. ..... dated..... Amend as comments indicated resubmit for record.
G. Drawing of this category is for information and hence not required to be approved.
H. Returned without review.

Approval of drawings / documents does not absolve Contractor / Vendor from any responsibilities for their accuracy or for the design, performance and safety of the Plant / Works or any other obligations under the contract and Indian Statutory Laws nor does it limit the Employer?s right under the contract.

LEGEND:

CM	CEMENT MOTAR
SFRC	STEEL FIBER REINFORCED CONCRETE
CC	CEMENT CONCRETE
PCC	PLAIN CEMENT CONCRETE

ISSUE	DATE	DESCRIPTION					
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	–	–	
			BY	CIVIL	-	-	APPD.
			CHECKED				

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: PLAN & SECTION OF BRICK MASONRY MACHINE HOLE FOR 1.2 m DIA, 2m & 6m DEPTH

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3037	ISSUE: P0
FILE NAME: TN–KWSDRP–WBS3–CV–3037.dwg		A1 SIZE

TITLE: PLAN & SECTION OF BRICK MASONRY MACHINE HOLE FOR 1.5 M DIA, 2M & 6M DEPTH

DWG NO: TN-KWSDRP-WBS3-CV-3038

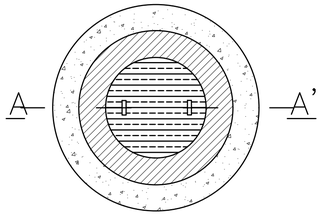

PLAN

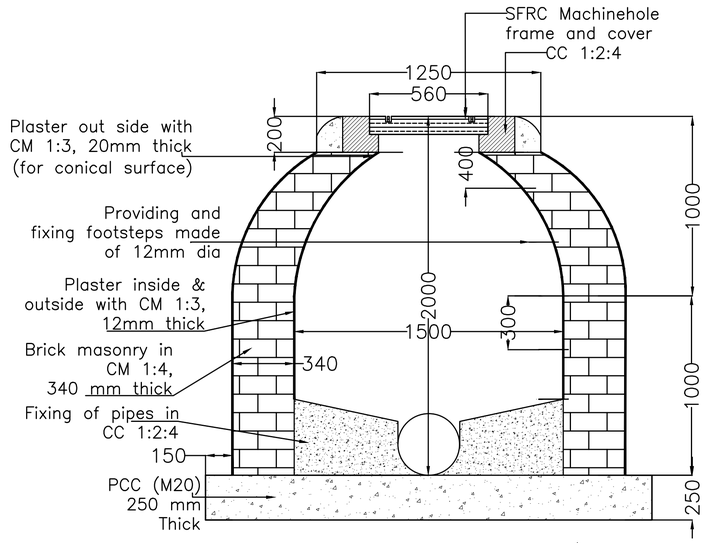

SECTION A–A'

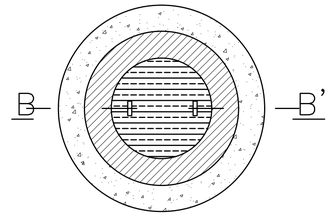

PLAN

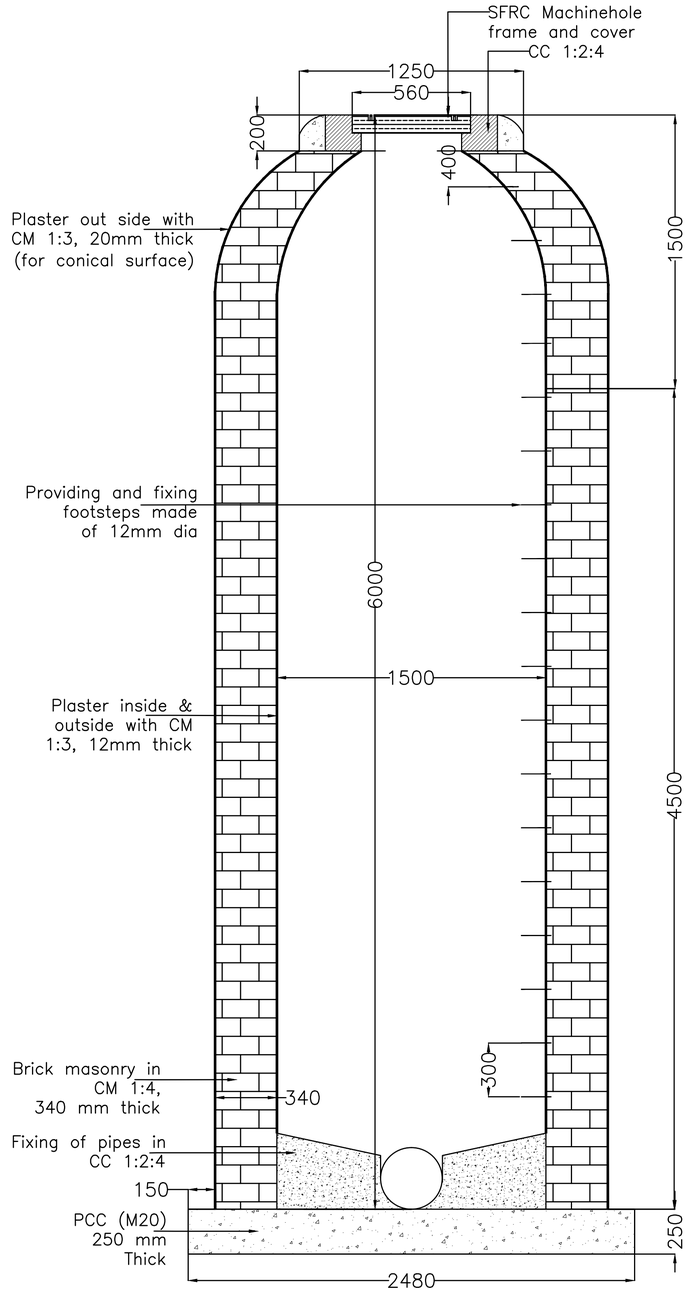

SECTION B–B'

NOTES:

1. All levels are in MM, Unless Other Wise Mentioned.
2. All Levels Are With Reference To The Gts Bench Mark Engraved On Centre Of 2nd Stones On East Side Of Queen Victoria's Statue In Cubbon Park, Bangalore. Its Value Is 912.266m.
3. All the Co–ordinates are based on UTM WGS–84.

DRAWING / DOCUMENT REVIEW STATUS

Date of Receipt .....

A. Approved, manufacture / construction may commence.
B. Acceptable subject to changes indicated, resubmit for approval but manufacture/ construction may commence.
C. Amend as per the comments indicated and resubmit for approval.
D. Comments noted in letter/memo attached to forwarding transmittal Nr..... dated ..... Amend as comments indicated resubmit for approval.
E. Amend as comments indicated resubmit for record.
F. Comments noted in letter/memo attached to forwarding transmittal Nr. ..... dated..... Amend as comments indicated resubmit for record.
G. Drawing of this category is for information and hence not required to be approved.
H. Returned without review.

Approval of drawings / documents does not absolve Contractor / Vendor from any responsibilities for their accuracy or for the design, performance and safety of the Plant / Works or any other obligations under the contract and Indian Statutory Laws nor does it limit the Employer?s right under the contract.

LEGEND:

CM	CEMENT MOTAR
SFRC	STEEL FIBER REINFORCED CONCRETE
CC	CEMENT CONCRETE
PCC	PLAIN CEMENT CONCRETE

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04 2025	FOR TENDER PURPOSE	SGS	MKV	–

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: PLAN & SECTION OF BRICK MASONRY MACHINE HOLE FOR 1.5 m DIA, 2m & 6m DEPTH

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3038	ISSUE: P0
FILE NAME: TN–KWSDRP–WBS3–CV–3038.dwg		A1 SIZE

TITLE: TYPICAL DRAWING OF PIPE BEDDING/ENCASING

DWG NO: TN-KWSDRP-WBS3-CV-3039

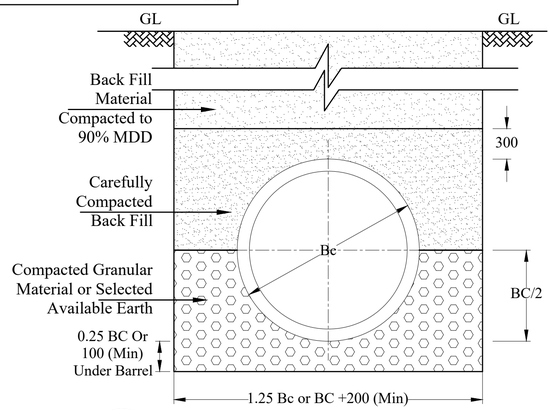

1 COMPACTED GRANULAR BEDDING(GRB) CLASS-B

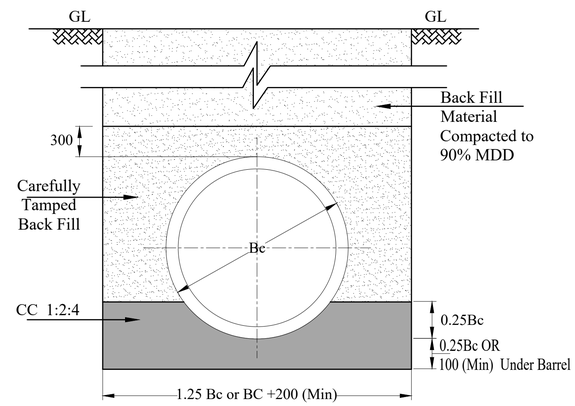

2 PLAIN CONCRETE CRADLE BEDDING/BEDDING UNDER LINED DRAIN CLASS-Ab

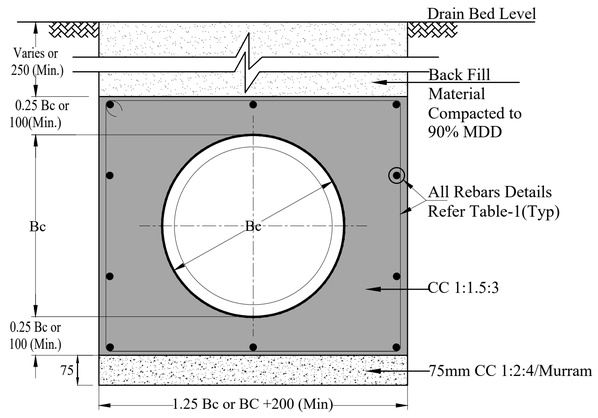

3 BEDDING / ENCASING/UNDER UNLINED DRAIN CLASS-Ae

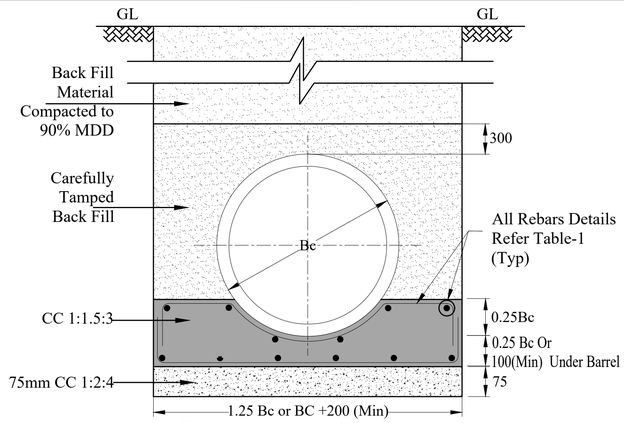

4 RCC CRADLE BEDDING CLASS-Ac

NOTES

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. CONCRETE GRADE SHALL BE AS PER BOQ PROVISIONS.
3. STEEL FOR REINFORCEMENT SHALL BE HIGH YIELD STRENGTH DEFORMED BARS OF GRADE FE500 CONFORMING TO IS-1786.
4. REINFORCEMENT WHERE SPLICED SHALL HAVE A MINIMUM LAP OF 50 X BAR DIAMETER. LAPS SHALL BE STAGGERED.
5. CLEAR COVER TO REINFORCEMENT BEDDING SHALL BE 50MM.
6. THE FIGURE SHOWS TYPICAL ARRANGEMENT OF REINFORCEMENT FOR EXACT DETAILS REFER TABLE 1.
7. THE WORK SHALL BE DONE AS PER BOQ, SPECIFICATIONS AND CONTRACT PROVISIONS.
8. IN MAJOR ROADS AND ROAD CROSSINGS,TRENCH FILLING WITH QUARRY DUST CAN BE ADOPTED AND SHALL BE AS PER SITE REQUIREMENT OR AS DIRECTED BY ENGINEER.
9. THE THICKNESS OF QUARRY DUST SHALL NOT EXCEED 1m BELOW THE ROAD SURFACE.

ABBREVIATIONS

1. GL - GROUND LEVEL
2. Thk - THICK
3. Min - MINIMUM
4. Typ - TYPICAL
5. Bc - BARREL OUTER DIAMETER
6. C/C - CENTER TO CENTER
7. RCC - REINFORCED CEMENT CONCRETE
8. PCC - PLAIN CEMENT CONCRETE
9. MDD - MAXIMUM DRY DENSITY
10. WMM - WET MIX MACADAM
11. SWD - STORM WATER DRAIN
12. FRL - FINISHED ROAD LEVEL
13. GSB - GRANULAR SUB BASE
14. GRB -GRANULAR BEDDING

TABLE -1: REINFORCEMENT DETAILS FOR BEDDING/ENCASING

Barrel Internal Dia	Barrel Outer Dia (Bc)	CLASS - Ac			CLASS - Ae			
		Dia of rods	Top bars (Both Ways)	Bottom bars (BothWays)	Dia of rods	Top bars (Both Ways)	Bottom bars (BothWays)	Side Bars
			Spacing	Spacing		Spacing	Spacing	Spacing
300	380	10	200	150	10	250	250	250
350	500	10	200	150	10	250	250	250
400	550	10	200	150	10	250	250	250
450	600	10	200	150	10	250	250	250
500	650	10	200	150	10	250	250	250
600	770	10	200	150	10	250	250	250
700	870	10	200	150	10	250	250	250
800	990	10	200	150	10	250	250	250
900	1100	10	150	150	10	250	250	250
1000	1230	10	150	150	10	250	250	250
1100	1330	10	150	150	12	250	250	250
1200	1440	10	150	150	12	250	250	250
1400	1670	10	150	150	12	250	250	250

SL.NO.	TYPE OF BEDDING/ENCASING	APPLICATION CONDITIONS
1.	CLASS B	In firm, hard or dense soil/rocky strata for depths up to 6m cover.
2.	CLASS Ab	To be provided in loose soil, with depth of cover between 1m and 6m.(not to be adopted on hard or dense soil)
3.	CLASS Ae	1.For drain and road crossings 2.For sewer pipes laid in drains/nallah where cover over pipe is less than 1m
4.	CLASS Ac	1.For sewer pipes laid where cover over pipe is more than 6m/As per site conditions. 2.For sewer pipes laid along or across lake beds.

ISSUE	DATE	DESCRIPTION	BY	CIVIL	-	-	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	–	–	
			CHECKED				

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: TYPICAL DRAWING OF PIPE BEDDING/ENCASING

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3039	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3039.dwg		A1 SIZE

TITLE: TYPICAL CROSS SECTIONS FOR RESTORATION OF ASPHALT & CONCRETE ROADS

DWG NO: TN-KWSDRP-WBS3-CV-3040

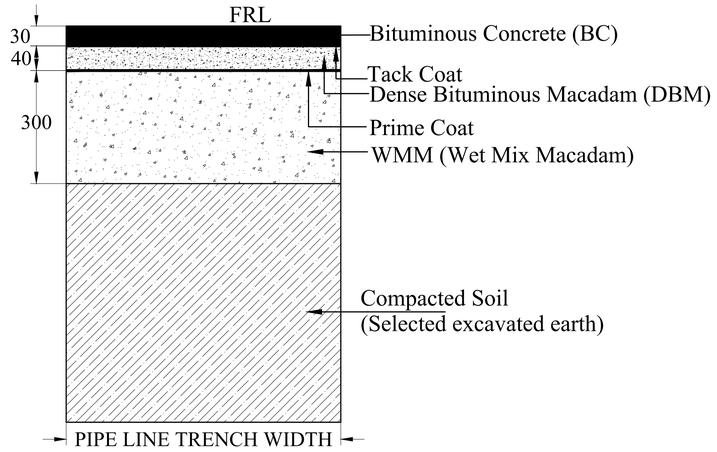

TYPICAL CROSS SECTION OF ASPHALT ROAD RESTORATION
(FOR ROAD WIDTH LESS THAN 40FT.)

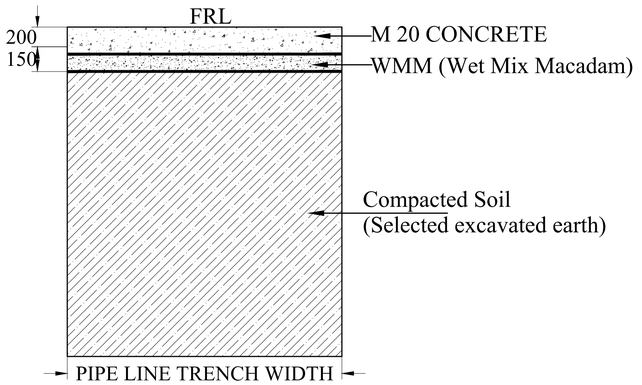

TYPICAL CROSS SECTION OF
CONCRETE ROAD

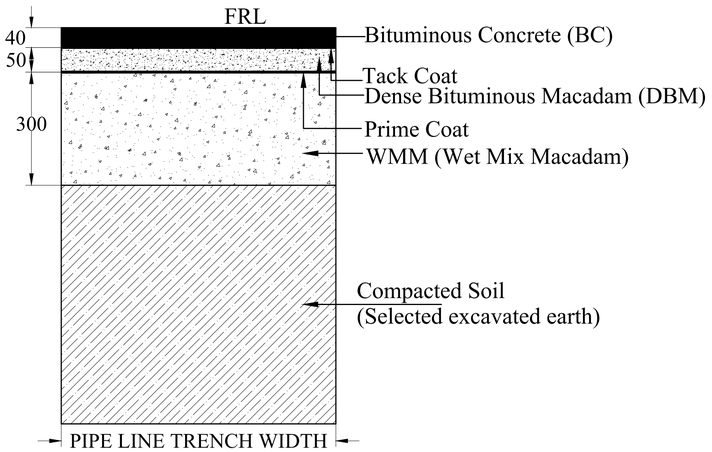

TYPICAL CROSS SECTION OF ASPHALT ROAD RESTORATION
(FOR ROAD WIDTH MORE THAN 40FT.)

NOTES

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. CONCRETE GRADE SHALL BE AS PER BOQ PROVISIONS.
3. THE WORK SHALL BE DONE AS PER BOQ, SPECIFICATIONS AND CONTRACT PROVISIONS.

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MKV	–
			CIVIL	-	-

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: TYPICAL CROSS SECTIONS FOR RESTORATION OF ASPHALT & CONCRETE ROADS

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: MKV	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3040	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS1-CV-3040		A1 SIZE

RAW SEWAGE

INLET CHAMBER

TRASH SCREEN

COARSE SCREEN

TROLLY

SCREENED MATERIAL FOR DISPOSAL

TROLLY

SCREENED MATERIAL FOR DISPOSAL

OVERFLOW BYPASS

BYPASS

WET WELL

SCREENED MATERIAL FOR DISPOSAL

TROLLY

INLET CHAMBER

FINE SCREENS CHANNEL

GRIT DISPOSAL

TROLLY

GRIT WASHING

BYPASS

VORTEX GRIT CHAMBER

PARSHALL FLUME

PROCESS AIR

BIOLOGICAL PROCESS WITH NITRIFICATION DENITRIFICATION & PHOSPHORUS REMOVAL (EA/IFAS/MBBR/SBR)

ALUM DOSING

DISC FILTER BYPASS

CHLORINE

DISC FILTER

BACK WASH

BACK WASH RETURN

CHLORINE CONTACT TANK

OUTFALL STRUCTURE

FINAL DISPOSAL

TREATED WATER STORAGE

TO DISC FILTER BACKWASH

TO PLANT UTILITIES

FOR TANKER FILLING

SEPTIC TANK

WASTE WATER FROM ADMIN BUILDING

WAS

SCUM PIT

CENTRIFUGE FEED SUMP

POLYMER DOSING

CENTRIFUGE

CAKE HOPPER AND CONVEYOR

TROLLY

SLUDGE FOR DISPOSAL

DRAIN

PLAN DRAIN SUMP

DRAIN FROM ALL PROCESS BUILDINGS

FROM PUBLIC WATER SUPPLY

BREAK TANK

OVER HEAD TANK

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	SLK	– –

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS (WORKS - A) AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS (WORKS - B) HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:
5MLD WWTP AT IBLUR
PROCESS FLOW DIAGRAM

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: SLK	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3052	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3052 to 55.dwg		A1 SIZE

TITLE: 5MLD WWTP AT IBLUR
PROCESS FLOW DIAGRAM

DWG NO: TN-KWSDRP-WBS3-CV-3052

TITLE: 10MLD WWTP AT U M KAVAL
PROCESS FLOW DIAGRAM

DWG NO: TN-KWSDRP-WBS3-CV-3053

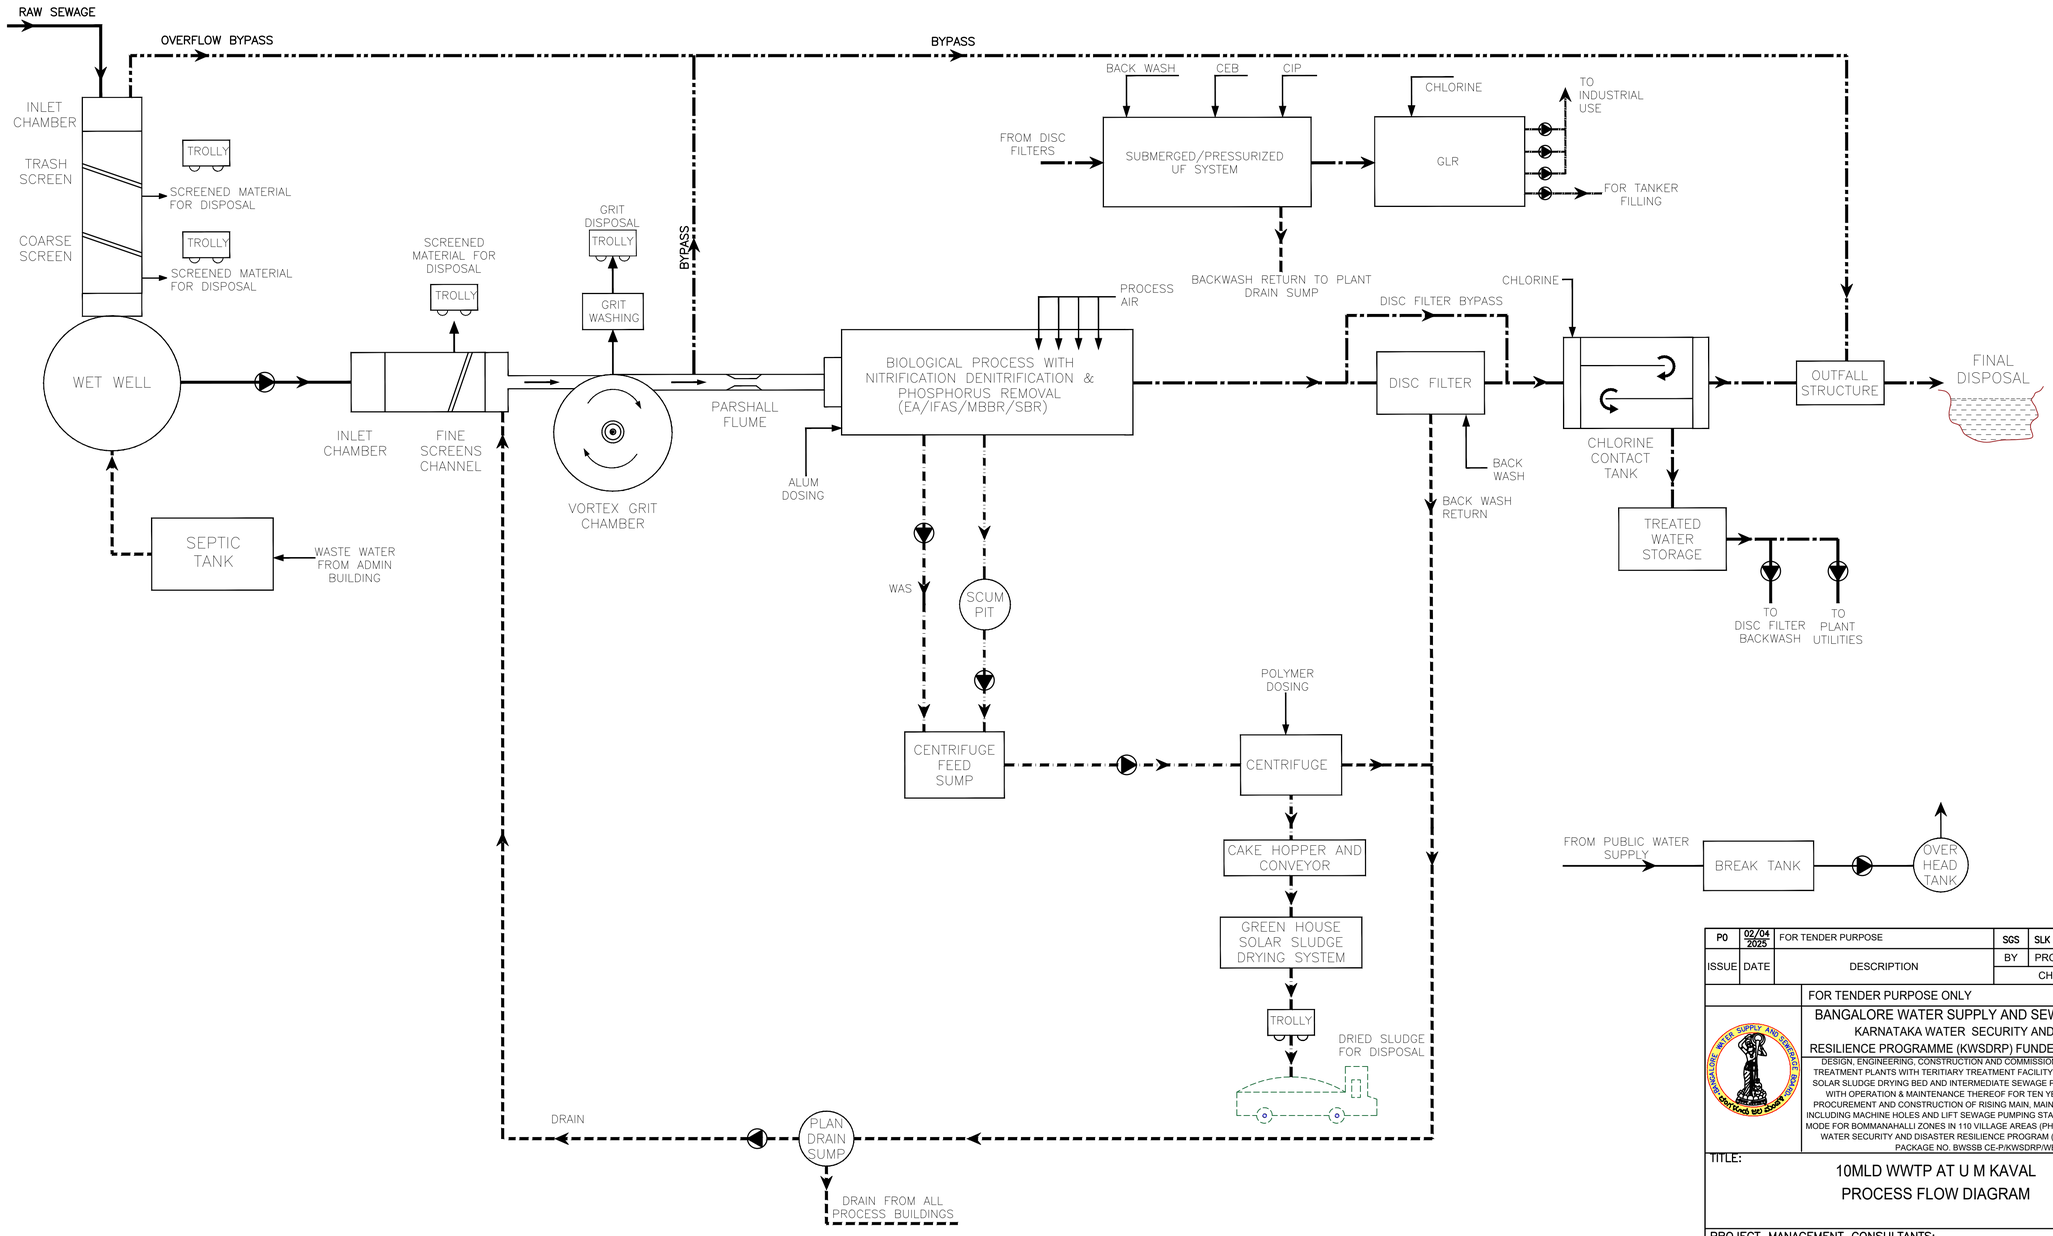

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	SLK	– –

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: 10MLD WWTP AT U M KAVAL
PROCESS FLOW DIAGRAM

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: SLK	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3053	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3052 to 55.dwg		A1 SIZE

TITLE: 15MLD WWTP AT HULIMAVU
PROCESS FLOW DIAGRAM

DWG NO: TN-KWSDRP-WBS3-CV-3054

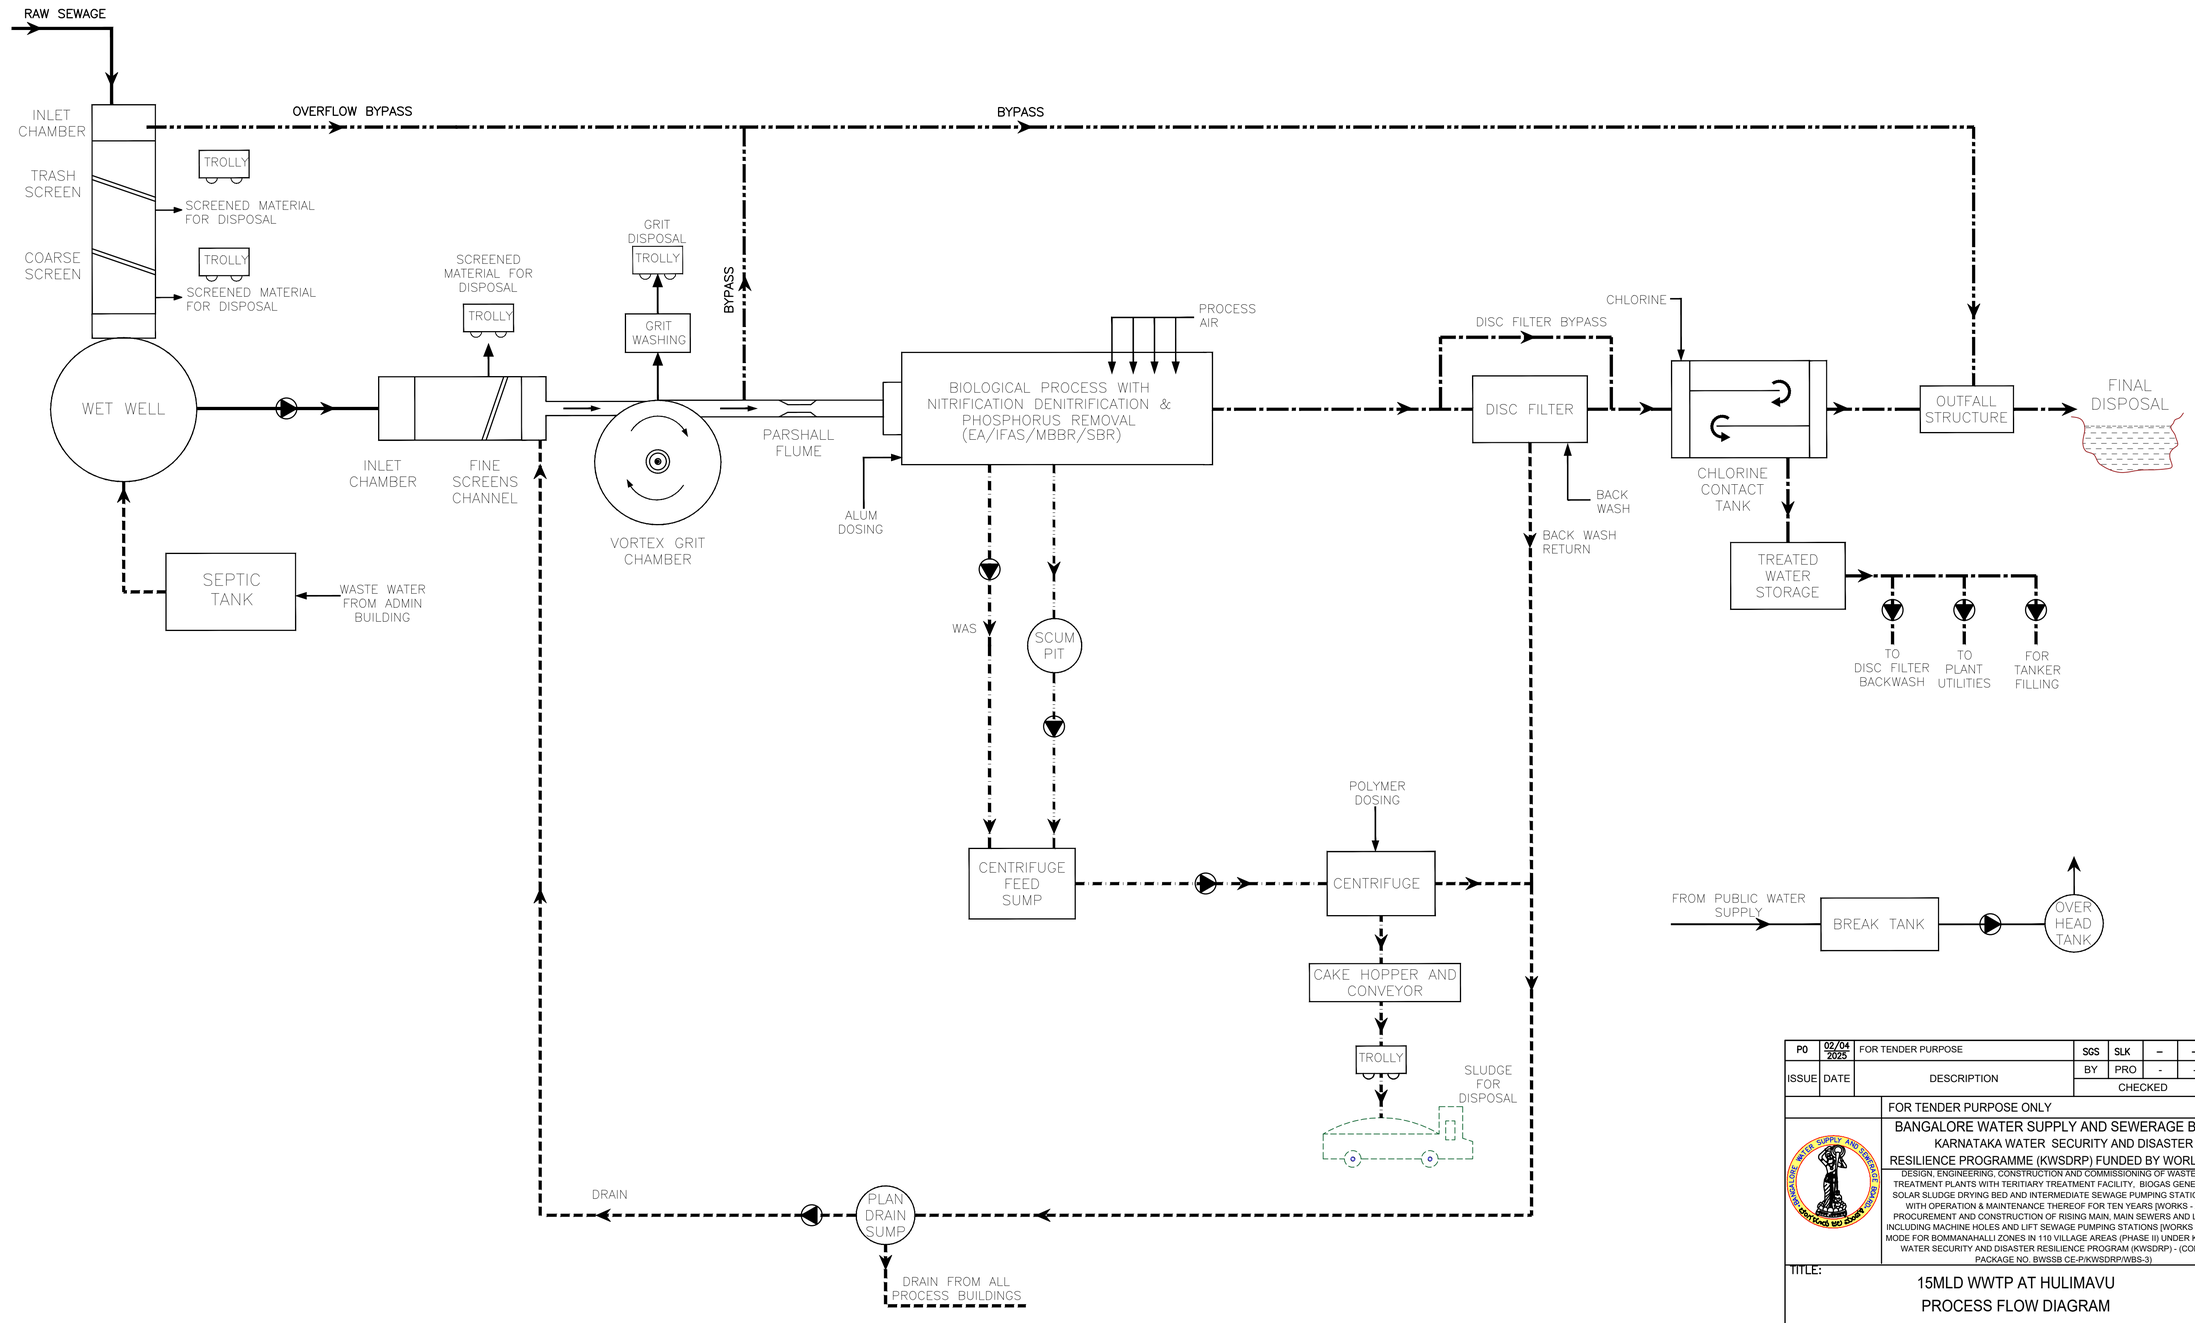

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	SLK	– –

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS (WORKS - A) AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: 15MLD WWTP AT HULIMAVU
PROCESS FLOW DIAGRAM

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: SLK	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3054	ISSUE: P0

FILE NAME: TN-KWSDRP-WBS3-CV-3052 to 55.dwg — A1 SIZE

TITLE: 35MLD WWTP AT ANJANAPURA
PROCESS FLOW DIAGRAM

DWG NO: TN-KWSDRP-WBS3-CV-3055

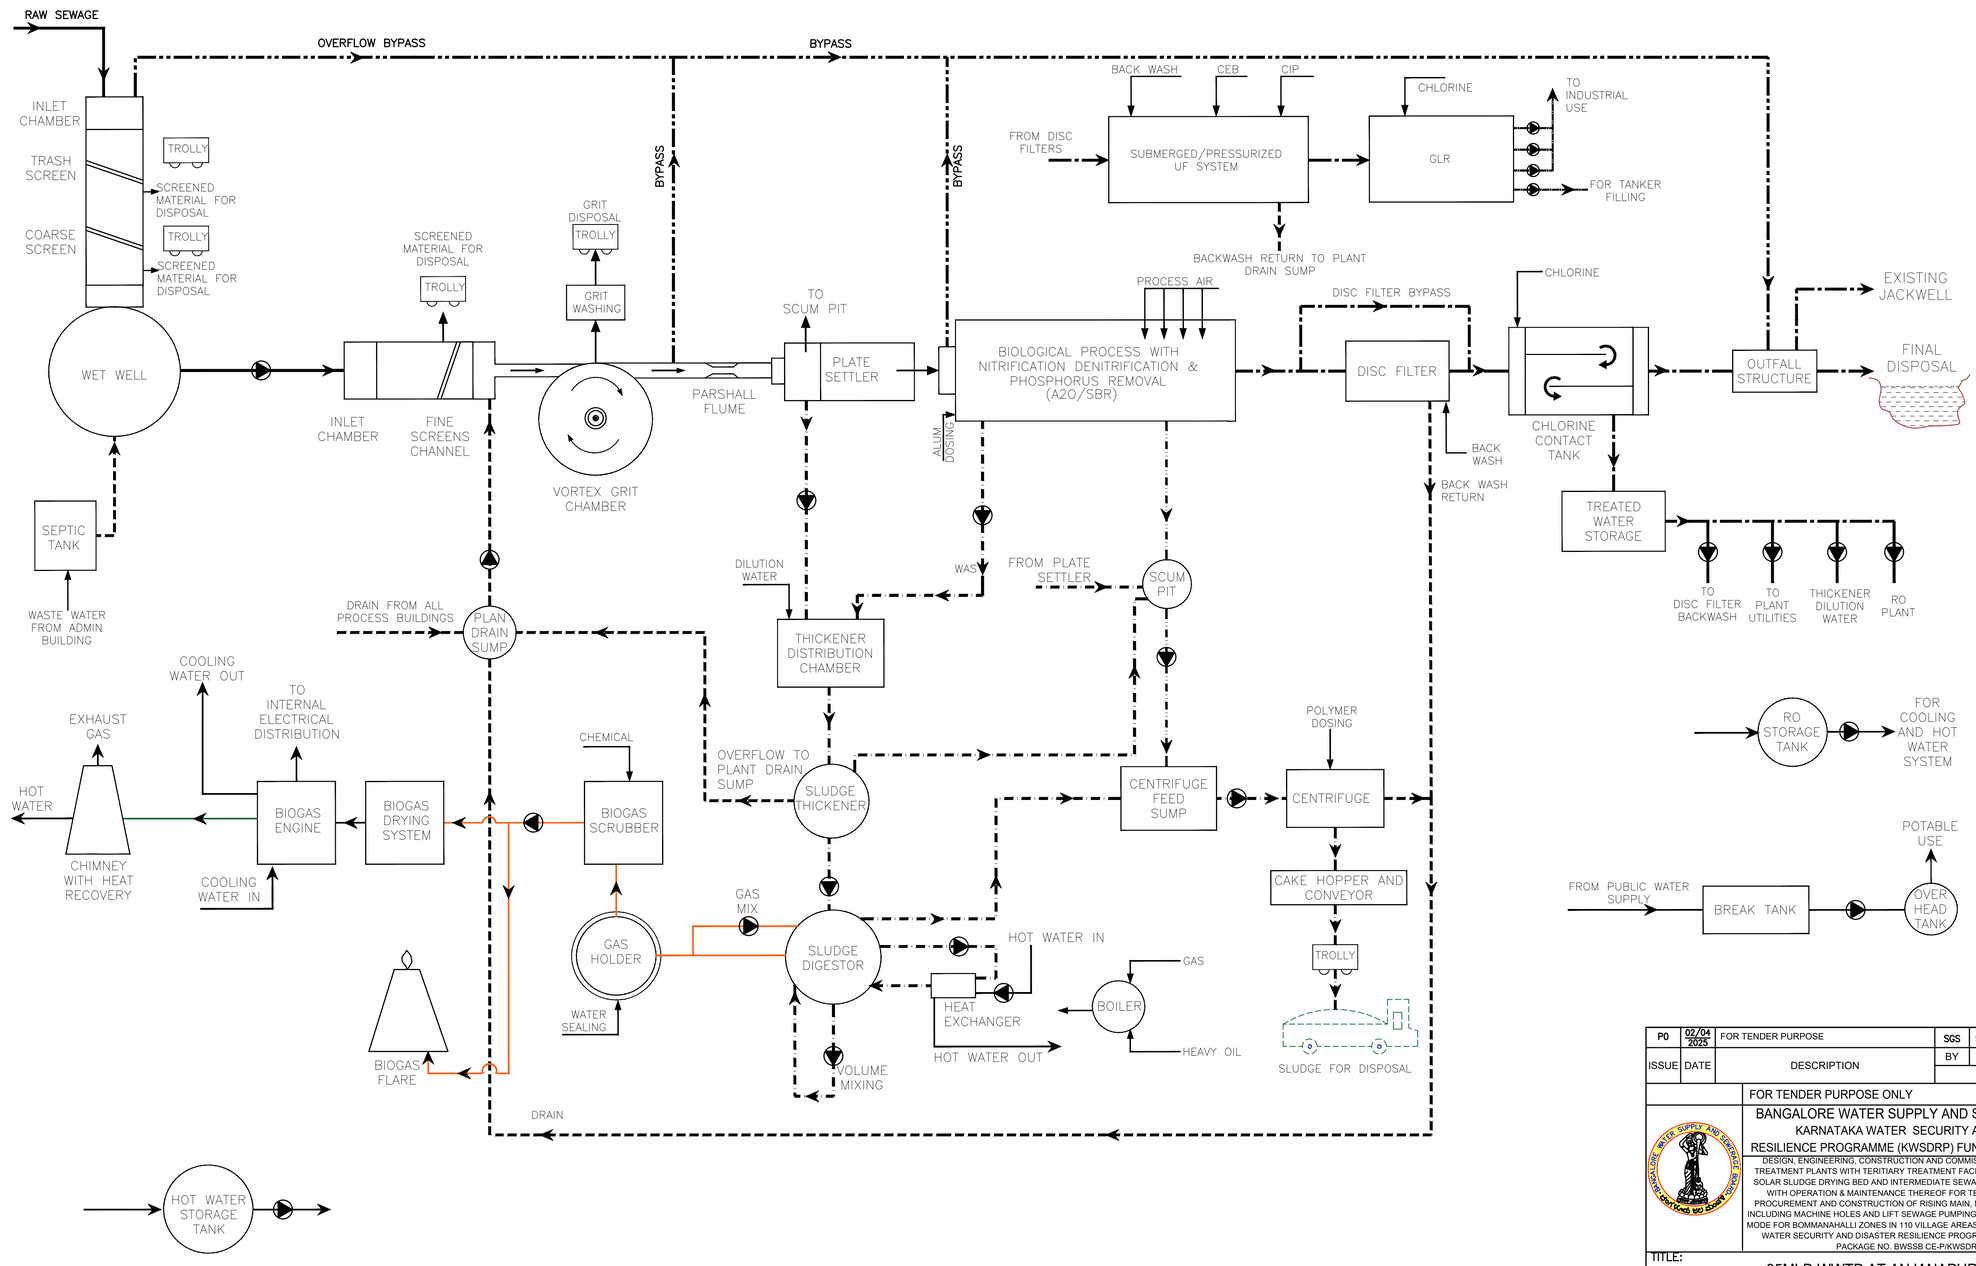

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	SLK	– –

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: 35MLD WWTP AT ANJANAPURA
PROCESS FLOW DIAGRAM

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: SLK	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: CV
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-CV-3055	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-CV-3052 to 55.dwg		A1 SIZE

TITLE: ELECTRICAL SINGLE LINE DIAGRAM FOR ELECTRICAL WORKS AT WASTE WATER TREATMENT PLANT (WWTP) - TYPICAL

DWG NO: TN-KWSDRP-WBS3-EL-4001

INCOMERS FROM THE FROM NEAREST KPTCL/BESCOM SUBSTATION

11kV Al. CONDUCTOR, XLPE, ARM. UNDER GROUND CABLE

3 WAY RMU (DAS)
11kV, 630A, 350 MVA
(2 OD + 1VL)
(AS PER BESCOM SPECS.)

11kV, 630A ISOLATOR+ES

11kV, 630A ISOLATOR+ES

11kV, 630A VCB

11kV, AL ARMOURED XLPE CABLE

METERING CUBICLE
11KV, 3 CT & 3 PT
(AS PER BESCOM SPECS.)

TTB TVM

BESCOM'S SCOPE

PROPOSED WORKS UNDER CONTRACTOR'S SCOPE

11KV OUTDOOR VCB PANEL

11kV VCB

11kV, AL ARMOURED XLPE UNEARTHED CABLE

11kV METAL ENCLOSED SWITCHBOARD
LOC: 11kV HT ROOM

TO OUTGOING R Y B
27 59 VSS+DV MCB MCB

BUS PT
11kV/110V/110V
CL.-0.5 (METERING)
CL.-3P (PROTECTION)

11kV, 3PH, _____A, 50HZ, TP, CU BUSBAR, ____kA FOR 1SEC

Line PT
11kV/110V/110V
CL.-0.5 (METERING)
CL.-3P (PROTECTION)

METERING CT CL:0.5

PROTECTION CT CL:5P20

NUM RELAY 51,51N,50BF 27,59

11kV VCB INCOMER

86 95 94

SA

MCB VSS+DV R Y B

(ON I/C FEEDER)
TNC ES L-O-R
BON BOFF T TCH SC
DCF RC BS BT ACF

(ON O/G FEEDER)
TNC ES L-O-R
BON BOFF T TCH SC
DCF RC BS BT ACF

WTI OTI BR PR

11kV VCB 86 95 94

FROM BUS PT

METERING CT CL:0.5

PROTECTION CT CL:5P20

NUM RELAY 51,51N,50BF 51NS,50,50N

11kV, AL ARMOURED XLPE UNEARTHED CABLE

TR-1, 11kV/433V, ONAN, Z=% _____ KVA, AS PER IS:1180, DYN11, OUTDOOR PLINTH MOUNTED WITH WTI, OTI, BR, MOG, OSR PRV WITH TAP CHANGER INDICATION WITH +5% TO -15% TAPS IN STEPS OF 2.5%

51NS ON INDOOR SWITCHGEAR

NON - SEGREGATED TPN ALUMINIUM BUSDUCT, 415V, ___A, TPN/4P ___KA/1 SEC

415V PCC
LOC: SUB-STATION BUILDING

ON MCCB
ON OFF TRIP

ON ACB
BON BOFF
TCH SC T RC

MCB R Y B
METERING CT CL.-0.5
MFM
TO PLC (RS485)

EDO,ACB,TPN WITH MICROPROCESSOR RELEASE FOR O/C, E/F, UV & S/C

INCOMER-1 NC

415V, 3PH, 50HZ, TPN, CU BUSBAR ___KA FOR 1SEC

BUS-1 R Y B

I/L

NO

BUSCOUPLER SAME AS INCOMER

MCB

BUS-2

INCOMER-2 NC

EDO,ACB,TPN WITH MICROPROCESSOR RELEASE FOR O/C, E/F, UV & S/C

DG ROOM
415V DG SET WITH AMF CONTROL PANEL WITH ACB

G

1.1kV XLPE AL ARMOURED CABLE

DG INCOMER NO

FUSE 415/230V AC TR MCB DP

TPN MCCB

TPN ACB

KVAr APFCR

1.1kV XLPE CU/AL ARMOURED CABLE

FOR FEEDERS CONTROL SUPPLY

RTCC PANEL

BATTERY CHARGER

AIR BLOWER MCC

MLDB

EFDB SS BLDG

EFDB DG BLDG.

SPARE

CAPACITOR BANK WITH APFC

CHLORINE MCC

RAS MCC

TSPS MCC

CENTRIFUGE MCC

HEADWORKS MCC

SPARE 2 Nos

LEGENDS:-

R	RELAYING
I	METERING
50	INSTANTANEOUS PHASE OVER CURRENT RELAY SUFFIX N- GROUND
51	INVERSE DEFINITE MINIMUM TIME OVER CURRENT RELAY SUFFIX N- GROUND, SUFFIX NS-STANDBY EARTH
95	TRIP CIRCUIT SUPERVISION RELAY
94	ANTI-PUMPING RELAY
27	UNDER VOLTAGE RELAY
86	LOCKOUT RELAY (HAND RESET)
PRV	PRESSURE RELEASE VALVE
50BF	BREAKER FAIL

- 3-PH DISTRIBUTION TRANSFORMER
- CURRENT TRANSFORMER
- POTENTIAL TRANSFORMER
- CABLE TERMINATION
- 415V DRAW OUT TYPE AIR CIRCUIT BREAKER
- 11KV DRAW OUT TYPE VACUUM CIRCUIT BREAKER
- 415V MOULDED CASE CIRCUIT BREAKER
- 415V MINIATURE CIRCUIT BREAKER
- BCS BREAKER CONTROL SWITCH
- INDICATING LAMP
- M MOTOR
- STAR-DELTA STARTERS WITH SINGLE PHASE PREVENTOR AND MPR
- DIRECT ONLINE STARTERS WITH SINGLE PHASE PREVENTOR AND MPR
- DG SET WITH AMF CONTROL PANEL
- TCH TRIP CIRCUIT HEALTHY INDICATION (WHITE LED)
- SC SPRING CHARGED INDICATION (BLUE LED)
- BON BREAKER ON INDICATION (RED LED)
- BOFF BREAKER OFF INDICATION (GREEN LED)
- TRIP TRIPPED ON FAULT INDICATION (AMBER LED)
- DCF DC SUPPLY FAIL INDICATION (AMBER LED)
- BS BREAKER IN SERVICE POSITION (RED LED)
- BT BREAKER IN TEST POSITION (CLEAR LED)
- ACF AC SUPPLY FAIL INDICATION (AMBER LED)
- ON ON INDICATION (RED LED)
- OFF OFF INDICATION (GREEN LED)
- T TRIP INDICATION (AMBER LED)
- R R-PHASE INDICATION LAMP (RED LED)
- Y Y-PHASE INDICATION LAMP (YELLOW LED)
- B B-PHASE INDICATION LAMP (BLUE LED)
- LOCAL/OFF/REMOTE SELECTOR SWITCH
- SA SURGE ARRESTER
- ASS+DA DIGITAL AMMETER WITH BUILT IN SELECTOR SWITCH
- VSS+DV DIGITAL VOLTMETER WITH BUILT IN SELECTOR SWITCH
- 415V, FIXED TYPE MOTOR PROTECTION CIRCUIT BREAKER (MPCB)
- ICP INSTRUMENTATION CONTROL PANEL
- N.RELAY NUMERICAL RELAY
- MFM MULTI FUNCTION METER WITH RS485 COMMUNICATION (AMMETER, VOLTMETER, PF, FREQUENCY)
- PLC PROGRAMMABLE LOGIC CONTROLLER
- MPR COMPREHENSIVE MOTOR PROTECTION RELAY
- M METERING UNIT
- CAPACITOR BANK
- LCSP LOCAL CONTROL STARTER PANEL
- TTB(CT SHORT LINK)
- SS SOFT STARTER
- SD LOCAL ISOLATOR SWITCH
- RC READY TO CLOSE (CLEAR LED)
- LCP LOCAL CONTROL PANEL
- CONTROL TRANSFORMER
- TR
- I/L INTER LOCK

INTERLOCK:

INCOMER-1	INCOMER-2	BUS COUPLER	DG
ON	ON	OFF	OFF
ON	OFF	ON	OFF
OFF	OFF	ON	ON
OFF	ON	ON	OFF

NOTES:

1. TRIP COIL CIRCUITS OF ALL CIRCUIT BREAKERS SHALL BE PROVIDED WITH TRIP SUPERVISION RELAY TO SUPERVISE THE CIRCUIT IN BOTH OPEN AND CLOSED POSITION OF CIRCUIT BREAKERS.
2. ALL RELAYS USED IN 11kV SWITCHGEAR SHALL BE NUMERICAL TYPE.
3. AMMETERS IN MOTOR FEEDERS SHALL BE PROVIDED WITH SUPPRESSED SCALE UP TO 6 TIMES FULL LOAD CURRENT FOR INDICATION STARTING CURRENT.
4. ACB's SHALL BE PROVIDED WITH MICROPROCESSOR RELEASES FOR ADJUSTABLE OVERLOAD SHORT CIRCUIT, UNDER VOLTAGE AND EARTH FAULT FOR LT BREAKER. VCB'S SHALL BE PROVIDED WITH SHUNT TRIP COILS RATED WITH 110V DC FOR HT BREAKER.
5. MCCB's SHALL BE PROVIDED WITH ELECTRONIC RELEASES FOR ADJUSTABLE OVERLOAD, SHORT CIRCUIT AND EARTH FAULT.
6. ALL PANEL WIRING SHALL BE WITH 1100 VOLTS GRADE PVC INSULATED 1.5 Sqmm STRANDED COPPER WIRE FOR CONTROL WIRING & 2.5 Sqmm FOR CT SECONDARY WIRING.
7. ALL CT'S SHALL BE OF 5A SECONDARY. FOR 11kV FEEDERS, SECONDARY SHALL BE 1A.
8. ALL CONTACTOR/TIMERS etc., SHALL BE RAIL MOUNTED.
9. MINIMUM CONTACTOR RATING SHALL BE 16A.
10. CONTROL SUPPLY SHALL BE 240V AC TAPPED BETWEEN PHASE AND NEUTRAL FEEDERS MODULES.
11. MPCB SHALL BE WITH IN BUILT SINGLE PHASING PREVENTER.
12. ALL CONTACTORS SHALL BE OF AC 3 DUTY.
13. WIDTH OF FEEDER COLOUMN SHALL BE MIN. 500 mm CABLE ALLEY SHALL BE 300mm MIN.
14. ALL ACB, MCCB, CONTACTORS, MPCB, & MPR SHALL BE OF TYPE-2 CO-ORDINATION.
15. LCP SHALL BE AS INDICATED IN P&ID.
16. CT RATIO SHALL BE 10% MORE THAN THE FLC 0.85PF & 0.9 EFFICIENCY.
17. CABLE COMPARTMENT SHALL HAVE LED LAMP INTERLOCKED WITH DOOR.
18. ALL INDICATION LAMP SHALL HAVE LED CLUSTER TYPE.
19. ALL MCCB SHALL HAVE EXTENDED ROTORY HANDLE & EXTENDED BUSBAR LINK
20. OPERATION LOGIC OF 415V SWITCHBOARD:
(A) AT NORMAL CONDITION BOTH THE TRANSFORMER INCOMER FEEDER SHALL BE IN CLOSED POSITION. THE BUS COUPLER AND DG INCOMER IN OPEN POSITION.
(B) IN CASE OF FAULTS, THE FAULTY INCOMER FEEDER SHALL BE OPEN POSITON THE BUS COUPLER AND THE HEALTHY INCOMER FEEDER SHALL BE CLOSED POSITON.
(C) IN CASE OF POWER FAILURE, THE DG INCOMER, BUS COUPLER SHALL BE IN CLOSED POSITION. BOTH THE TRANSFORMER INCOMER SHALL BE SWITCHED OFF BY ACTIVATION OF UNDER VOLTAGE RELAY OF THE GRID INCOMER.
21. MOTOR FEEDER <5.5kW WILL HAVE DIRECT CONNECTED AMMETER IN Y PHASE, MOTORS >5.5kW UPTO 15kW WILL BE PROVIDED WITH 1 CT AND AMMETER AND MOTOR >15kW AND ABOVE WILL BE PROVIDED WITH 3 CTS AND AMMETER.
22. NECESSARY INTERLOCK TO SPACE HEATER WITH MOTORS TO BE PROVIDED.
23. ALL MCB SHALL HAVE KW = 100% Ics.
24. ALL MCCB CONNECTED TO MOTOR SHALL BE RATED TO MOTOR DUTY.
25. ALL ACB SHALL HAVE Icu = Ics = Icw.
26. THE 415V SIDE OF THE TRANSFORMER IS PROVIDED WITH NON SEGREGATED ALUMINUM BUS DUCT IF THE TRANSFORMER RATING IS GREATER THAN OR EQUAL TO 1000KVA. FOR THE TRANSFORMER RATING IS LESS THAN 1000KVA XLPE AL ARMOUED CABLE SHALL BE PROVIDED ON 415V SIDE.
27. CABLE SIZES LESS THAN OR EQUAL TO 6 Sqmm SHALL BE PROVIDED WITH COPPER CONDUCTORS AND AL CONDUCTORS TO BE USED FOR CABLE SIZES ABOVE 6 Sqmm.
28. CAPACITOR BANK WITH APFC SHALL BE PROVIDED WITH INTERLOCK SUCH THAT PANELS ARE FED BY DG SET, CAPACITOR BANK SHALL BE DISCONNECTED.
29. 20% SPARE FEEDERS WITH MINI OF 1 SPARE FEEDER FOR EACH RATING OF THE OUTGOING FEEDERS SHALL BE PROVIDED IN LT PANELS (PCC/MCC).

ISSUE	DATE	DESCRIPTION	BY	CIVIL	ELEC.	MECH.	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	TM		GVKM		
			CHECKED				

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS (WORKS - A) AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS (WORKS - B) HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-PIKWSDRP/WBS-3)

TITLE:
ELECTRICAL SINGLE LINE DIAGRAM FOR ELECTRICAL WORKS AT WASTE WATER TREATMENT PLANT (WWTP) - TYPICAL

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD (JV)

DESIGNED: GVKM	APPROVED	DATE: (TO ISSUE) 02-04-2025
DRAWN: TM		DATE:(CURRENT ISSUE) 02-04-2025
CHECKED: BMS		DIVISION: EL
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-EL-4001	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-EL-4001.dwg		A1 SIZE

TITLE: ELECTRICAL SINGLE LINE DIAGRAM FOR THE ELECTRICAL WORKS AT ISPS (TYPICAL) SH 01 0F 02

DWG NO: TN-KWSDRP-WBS3-EL-4002

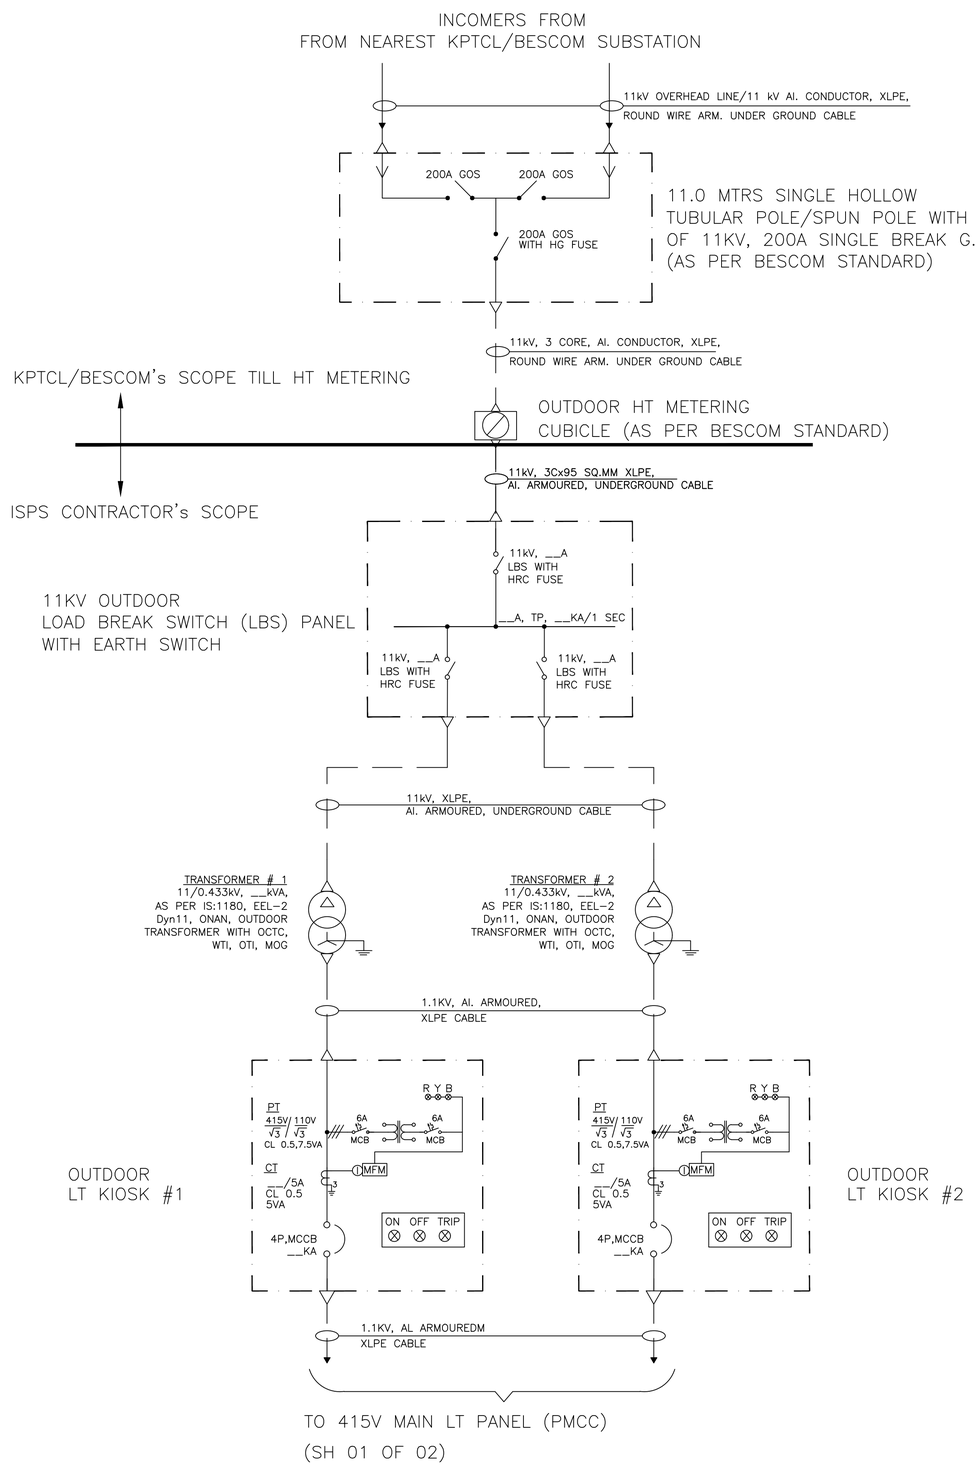

LEGEND:

- THREE WINDING DISTRIBUTION TRANSFORMER
- CURRENT TRANSFORMER
- POTENTIAL TRANSFORMER
- CABLE TERMINATION
- INDICATING LAMPS (R – RED, Y – YELLOW, B – BLUE)
- 415V, FIXED TYPE MOULDED CASE CIRCUIT BREAKER (MCCB)
- 415V, FIXED TYPE MOTOR PROTECTION CIRCUIT BREAKER (MPCB)
- 415V, MINIATURE CIRCUIT BREAKER (MCB)
- LOAD BREAK SWITCH (LBS)
- HRC FUSE
- CAPACITOR BANKS WITH APFCR PANELS
- DIRECT-ON-LINE STARTER WITH SINGLE PHASE PREVENTOR AND BIMETALLIC RELAY
- MFM — MULTIFUNCTION METER
- M — MOTOR
- A — ANALOGUE AMMETER
- ASS — AMMETER SELECTOR SWITCH
- R — RELAY
- I — INSTRUMENTATION

NOTES:

1. AMMETERS IN MOTOR FEEDERS SHALL BE PROVIDED WITH SUPPRESSED SCALE UPTO 6 TIMES FULL LOAD CURRENT FOR INDICATION THE STARTING CURRENT.
2. MCCBs SHALL BE PROVIDED WITH ELECTRONIC RELEASES FOR OVERLOAD, SHORT CIRCUIT AND EARTH FAULT.
3. ALL CTs SHALL BE OF 5A SECONDARY.
4. ALL CONTACTOR / TIMERS ETC SHALL BE RAIL MOUNTED.
5. MINIMUM CONTACTOR RATING SHALL BE 16A.
6. ALL BMRs SHALL BE WITH INBUILT SINGLE PHASING PREVENTOR. EACH BMR SHALL BE SEPARATELY MOUNTED.
7. ALL CONTACTORS SHALL BE OF AC3 DUTY.
8. WIDTH OF FEEDER COLUMN SHALL BE MIN. 500MM AND CABLE ALLEY SHALL BE 300MM MIN.
9. ALL MOTOR PROTECTION SHALL BE OF TYPE–2 CO–ORDINATION.
10. CABLE COMPARTMENT SHALL HAVE CFL LAMP FITTING INTERLOCKED WITH DOOR.
11. ALL INDICATION LAMPS SHALL BE OF CLUSTER LED TYPE.
12. ALL MCCBs SHALL HAVE EXTENDED ROTORY HANDLE & EXTENDED BUSBAR LINK.
13. NECESSARY INTERLOCK TO SPACE HEATER WITH MOTORS TO BE PROVIDED.
14. ALL MCCBs SHALL HAVE Icu = 100% OF Ics.
15. ALL MCCBs CONNECTED TO MOTOR SHALL BE RATED TO MOTOR DUTY.
16. CONTROL VOLTAGE SHALL BE 240V AC AND SHALL BE TAPPED FROM RESPECTIVE PHASE AND NEUTRAL OF FEEDERS.

ENGINEERING REFERENCE DRAWINGS:

NIL

CONSTRUCTION REFERENCE DRAWINGS:

NIL

HOLD:

NIL

ISSUE	DATE	DESCRIPTION	BY	CIVIL	ELEC.	MECH.	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	TM		GVKM		
			CHECKED				

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-PIKWSDRP/WBS-3)

TITLE:
ELECTRICAL SINGLE LINE DIAGRAM
FOR THE ELECTRICAL WORKS AT ISPS (TYPICAL)
SH 01 0F 02

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD (JV)

DESIGNED: GVKM	APPROVED	DATE: (TO ISSUE) 02–04–2025
DRAWN: TM		DATE:(CURRENT ISSUE) 02–04–2025
CHECKED: BMS		DIVISION: EL
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-EL-4002	ISSUE: P0
FILE NAME: TN–KWSDRP–WBS3–EL–4002.dwg		A1 SIZE

TITLE: ELECTRICAL SINGLE LINE DIAGRAM FOR THE ELECTRICAL WORKS AT ISPS (TYPICAL) SH 02 0F 02

DWG NO: TN-KWSDRP-WBS3-EL-4002

FROM LT KIOSK # 1 OF REF DWG. NO. (SH 01 OF 02)

FROM LT KIOSK # 2 OF REF DWG. NO. (SH 01 OF 02)

415V, __kVA D.G SET WITH AMF PANEL

415V MAIN LT PANEL (PMCC)

LOC: ELECTRICAL ROOM

1.1kV, Al, ARMOURED, XLPE CABLE (TYP)

PT 415V/√3 / 110V/√3 CL 0.5, 20VA

CT ---/5A CL 0.5 5VA

---/5A 5P10 5VA

6A MCB

R Y B

VSS V

MFM ASS A

APFCR

INCOMER−1 MCCB,4P

INCOMER−2 MCCB,4P

INCOMER−3 MCCB,4P

ON MCCB FEEDER

ON OFF TRIP

INTERLOCK

BUS−COUPLER MCCB,4P

415V, ---A, 3Ph, TPN, 50Hz, **kA/1 SEC, AL. BUSBAR−I

415V, ---A, 3Ph, TPN, 50Hz, **kA/1 SEC, AL. BUSBAR−II

MCCB TPN

MCB TP

MCCB 4P

Y−D STARTER

DOL STARTER

HOIST JB 5 TON

HOIST JB 2 TON

32A, 4P MCCB+RCCB (30 mA) 3 PHASE PLUG+SOCKET

SCREEN PANEL

MOV DB

INDOOR LDB

PDB

SPARE (2 NOS.)

SPARE

STREET LIGHTING DB

DEWATERING PUMPS

SPARE (2 NOS.)

-- kVAR APFC PANEL−2

-- kVAR APFC PANEL−1

GRIT REMOVAL PUMP

VFD PANEL−1

VFD

PMU LCS

SUBMERSIBLE MOTOR JUNCTION BOX−3

SOFT STARTER PANEL−1

IP 54 BOTTOM ENTRY

MCCB TP

---/5A CL. 0.5 5VA

ASS

SS SOFT STARTER

SUBMERSIBLE MOTOR JUNCTION BOX−1

SOFT STARTER PANEL− 2

SUBMERSIBLE MOTOR JUNCTION BOX−2

NOTES:

BUS TRANSFER ARRANGEMENT BETWEEN I/Cs, B/C & DG I/C ARE DESCRIBED AS BELOW.

A	B	C	D
INCOMER−1	BUS−COUPLER	INCOMER−2	INCOMER−3
CLOSE	OPEN	CLOSE	OPEN
OPEN	CLOSE	CLOSE	OPEN
CLOSE	CLOSE	OPEN	OPEN
OPEN	CLOSE	OPEN	CLOSE

ISSUE	DATE	DESCRIPTION	BY	CIVIL	ELEC.	MECH.	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	TM		GVKM		
			CHECKED				

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY , BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P(KWSDRP)WBS-3)

TITLE: ELECTRICAL SINGLE LINE DIAGRAM FOR THE ELECTRICAL WORKS AT ISPS (TYPICAL) SH 02 0F 02

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD (JV)

DESIGNED: GVKM	APPROVED	DATE: (TO ISSUE) 02−04−2025
DRAWN: TM		DATE:(CURRENT ISSUE) 02−04−2025
CHECKED: BMS		DIVISION: EL
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-EL-4002	ISSUE: P0
FILE NAME: TN−KWSDRP−WBS3−EL−4002.dwg		A1 SIZE

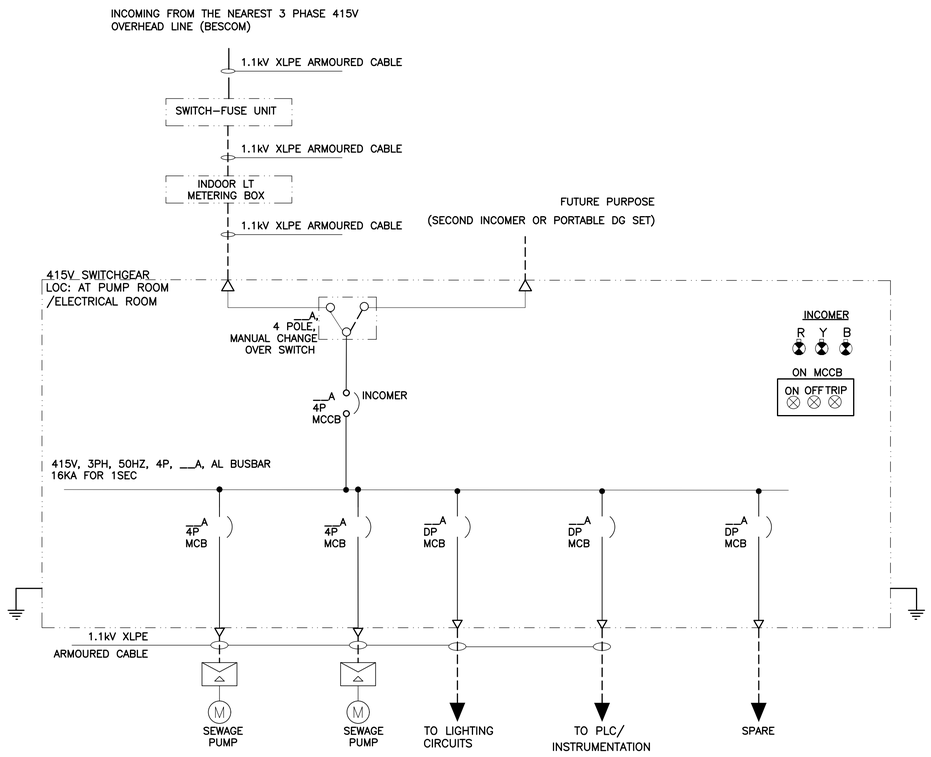

LEGEND:-

- R-PHASE INDICATION LAMP (RED LED)
- Y-PHASE INDICATION LAMP (YELLOW LED)
- B-PHASE INDICATION LAMP (BLUE LED)
- CHANGE OVER SWITCH
- 415V MOULDED CASE CIRCUIT BREAKER
- ON INDICATION (RED LED)
- OFF INDICATION (GREEN LED)
- TRIP INDICATION (AMBER LED)
- CABLE TERMINATION
- MOTOR
- 415V MINIATURE CIRCUIT BREAKER
- STAR DELTA STARTER

NOTES:-

1. MCCB's WILL BE PROVIDED WITH MICROPROCESSOR RELEASES (O/L, S/C, E/F) FOR ABOVE 250A AND THERMAL MAGNETIC TYPE (O/L, S/C, E/F) FOR BELOW 250A.
2. ALL PANEL WIRING WILL BE WITH 1100 VOLTS GRADE PVC INSULATED 1.5 Sqmm STRANDED COPPER WIRE FOR CONTROL WIRING & 2.5 Sqmm FOR CT SECONDARY WIRING.
3. ALL CONTACTOR/TIMERS etc., WILL BE RAIL MOUNTED.
4. MINIMUM CONTACTOR RATING WILL BE 16A.
5. ALL CONTACTORS WILL BE OF AC 3 DUTY.
6. ALL INDICATION LAMP WILL HAVE LED CLUSTER TYPE.
7. ALL MCB WILL HAVE KW= 100% Ics.
8. ALL MCCB CONNECTED TO MOTOR WILL BE RATED TO MOTOR DUTY.
9. CABLE SIZES LESS THAN OR EQUAL TO 6 Sqmm WILL BE PROVIDED WITH COPPER CONDUCTORS AND AL CONDUCTORS TO BE USED FOR CABLE SIZES ABOVE 6 Sqmm.
10. CAPACITOR WILL BE MIXED DIELECTRIC POLYPROPYLENE TYPE.
11. MOTOR RATING LESS THAN OR EQUAL TO 5.5kW – DOL STARTER AND MOTOR RATING ABOVE 5.5kW LESS THAN OR EQUAL TO 37kW – STAR DELTA STARTER.
12. FOR MOTOR RATING LESS THAN 15kW, MPCB WILL BE PROVIDED WITH BI-METAL OVERLOAD PROTECTION, SHORT CIRCUIT PROTECTION AND PROTECTION AGAINST SINGLE PHASING.
13. FOR MOTOR RATING MORE THAN 15kW UP TO 100kW MCCB WILL BE PROVIDED WITH ELECTRONIC MOTOR PROTECTION RELAY PROVIDING PROTECTION FROM OVERLOAD, EARTH FAULT, PHASE CURRENTS OUT OF BALANCE AND PROTECTION AGAINST SINGLE PHASING.
14. TYPE-2 COORDINATION CHART SHALL BE FOLLOWED FOR SELECTION OF COMPONENTS FOR MOTOR STARTERS.
15. DEDICATED TERMINAL BLOCK (TB'S) SHALL BE PROVIDED IN RESPECTIVE STARTER PANEL(FOR PLC INTERGATION).
16. THE CAPACITOR SHALL BE CONNECTED DIRECTLY ACROSS THE MOTOR TERMINALS.

ISSUE	DATE	DESCRIPTION	BY	CIVIL	ELEC.	MECH.	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	TM		GVKM		
			CHECKED				

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS (WORKS - A) AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS (WORKS - B) HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:
ELECTRICAL SINGLE LINE DIAGRAM
FOR THE ELECTRICAL WORKS AT
LIFT PUMPING STATION (TYPICAL)

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD (JV)

DESIGNED: GVKM	APPROVED	DATE: (TO ISSUE) 02-04-2025
DRAWN: TM		DATE:(CURRENT ISSUE) 02-04-2025
CHECKED: BMS		DIVISION: EL
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-EL-4003	ISSUE: P0
FILE NAME: TN-KWSDRP-WBS3-EL-4003.dwg		A1 SIZE

TITLE: ELECTRICAL SINGLE LINE DIAGRAM FOR ELECTRICAL WORKS AT WASTE WATER TREATMENT PLANT (WWTP) WITH REUSE AND SOLAR SLUDGE DRYING BEDS- TYPICAL

DWG NO: TN-KWSDRP-WBS3-EL-4004

INCOMERS FROM THE FROM NEAREST KPTCL/BESCOM SUBSTATION

11kV Al. CONDUCTOR, XLPE, ARM. UNDER GROUND CABLE

3 WAY RMU (DAS)
11kV, 630A, 350 MVA
(2 OD + 1VL)
(AS PER BESCOM SPECS.)

11kV, 630A ISOLATOR+ES

11kV, 630A ISOLATOR+ES

11kV, 630A VCB

11kV, AL ARMOURED XLPE CABLE

METERING CUBICLE
11KV, 3 CT & 3 PT
(AS PER BESCOM SPECS.)

TTB TVM

BESCOM'S SCOPE

PROPOSED WORKS UNDER CONTRACTOR'S SCOPE

11KV OUTDOOR VCB PANEL

11kV VCB

11kV, AL ARMOURED XLPE UNEARTHED CABLE

11kV METAL ENCLOSED SWITCHBOARD
LOC: 11kV HT ROOM

27 59 TO OUTGOING VSS+DV R Y B MCB

BUS PT 11kV/110V/110V √3 / √3 / √3 CL.–0.5 (METERING) CL.–3P (PROTECTION)

11kV, 3PH, _____A, 50HZ, TP, CU BUSBAR, ___kA FOR 1SEC

Line PT 11kV/110V/110V √3 / √3 / √3 CL.–0.5 (METERING) CL.–3P (PROTECTION)

METERING CT CL:0.5 MFM RS-485

PROTECTION CT CL:5P20 NUM RELAY 51,51N,50BF 27,59 RS-485

11kV VCB INCOMER 86 95 94

SA MCB MCB VSS+DV R

(ON I/C FEEDER) TNC ES L–O–R BON BOFF T TCH SC DCF RC BS BT ACF AWLR

(ON O/G FEEDER) TNC ES L–O–R BON BOFF T TCH SC DCF RC BS BT ACF AWLR

11kV VCB 86 95 94 WTI OTI BR PR

FROM BUS PT

METERING CT CL:0.5 MFM RS-485

PROTECTION CT CL:5P20 NUM RELAY 51,51N,50BF 51NS,50,50N RS-485

SA

SPARE

11kV, AL ARMOURED XLPE UNEARTHED CABLE

TR–1, 11kV/433V, ONAN, Z=% _____ KVA, AS PER IS:1180, DYN11, OUTDOOR PLINTH MOUNTED WITH WTI, OTI, BR, MOG, OSR PRV WITH TAP CHANGER INDICATION WITH +5% TO –15% TAPS IN STEPS OF 2.5%

R 51NS ON INDOOR SWITCHGEAR

NON – SEGREGATED TPN ALUMINIUM BUSDUCT, 415V, ___A, TPN/4P ___KA/1 SEC

DG ROOM
415V DG SET WITH AMF CONTROL PANEL WITH ACB

G 1.1kV XLPE AL ARMOURED CABLE

415V PCC
LOC: SUB–STATION BUILDING

ON MCCB ON OFF TRIP

ON ACB BON BOFF BCS TCH SC T RC

MCB R Y B

METERING CT CL.–0.5 3 1 MFM TO PLC (RS485)

EDO,ACB,TPN WITH MICROPROCESSOR RELEASE FOR O/C, E/F, UV & S/C

INCOMER–1 NC

BUS–1 R Y B

I/L

BUSCOUPLER SAME AS INCOMER NO

BUS–2 R Y B

INCOMER–2 NC

DG INCOMER NO

415V, 3PH, 50HZ, TPN, CU BUSBAR ___KA FOR 1SEC

FUSE 415/230V AC TR MCB DP

TPN MCCB

KVAr APFCR

TPN ACB

1.1kV XLPE CU/AL ARMOURED CABLE

FOR FEEDERS CONTROL SUPPLY | REUSE MCC PANEL | RTCC PANEL | BATTERY CHARGER | AIR BLOWER MCC | MLDB | EFDB SS BLDG | EFDB DG BLDG. | SPARE | CAPACITOR BANK WITH APFC | CAPACITOR BANK WITH APFC | CHLORINE MCC | RAS MCC | TSPS MCC | CENTRIFUGE MCC | RTCC PANEL | HEADWORKS MCC | SPARE | FOR FEEDERS CONTROL SUPPLY | SPARE 2 Nos | SPARE 2 Nos | MACHINE MCC PANEL (SOLAR SLUDGE DRYING BEDS)

LEGENDS:–

(R) RELAYING

(I) METERING

50 INSTANTANEOUS PHASE OVER CURRENT RELAY SUFFIX N– GROUND
51 INVERSE DEFINITE MINIMUM TIME OVER CURRENT RELAY SUFFIX N– GROUND, SUFFIX NS–STANDBY EARTH
95 TRIP CIRCUIT SUPERVISION RELAY
94 ANTI–PUMPING RELAY
27 UNDER VOLTAGE RELAY
86 LOCKOUT RELAY (HAND RESET)
PRV PRESSURE RELEASE VALVE
50BF BREAKER FAIL

3–PH DISTRIBUTION TRANSFORMER
CURRENT TRANSFORMER
POTENTIAL TRANSFORMER
CABLE TERMINATION
415V DRAW OUT TYPE AIR CIRCUIT BREAKER
11KV DRAW OUT TYPE VACUUM CIRCUIT BREAKER
415V MOULDED CASE CIRCUIT BREAKER
415V MINIATURE CIRCUIT BREAKER
BCS BREAKER CONTROL SWITCH
INDICATING LAMP

M MOTOR
STAR–DELTA STARTERS WITH SINGLE PHASE PREVENTOR AND MPR
DIRECT ONLINE STARTERS WITH SINGLE PHASE PREVENTOR AND MPR
DG SET WITH AMF CONTROL PANEL
TCH TRIP CIRCUIT HEALTHY INDICATION (WHITE LED)
SC SPRING CHARGED INDICATION (BLUE LED)
BON BREAKER ON INDICATION (RED LED)
BOFF BREAKER OFF INDICATION (GREEN LED)
BT TRIPPED ON FAULT INDICATION (AMBER LED)
DCF DC SUPPLY FAIL INDICATION (AMBER LED)
BS BREAKER IN SERVICE POSITION (RED LED)
BT BREAKER IN TEST POSITION (CLEAR LED)
ACF AC SUPPLY FAIL INDICATION (AMBER LED)
ON ON INDICATION (RED LED)

OFF OFF INDICATION (GREEN LED)
T TRIP INDICATION (AMBER LED)
R R–PHASE INDICATION LAMP (RED LED)
Y Y–PHASE INDICATION LAMP (YELLOW LED)
B B–PHASE INDICATION LAMP (BLUE LED)
L/O/R LOCAL/OFF/REMOTE SELECTOR SWITCH
SA SURGE ARRESTER
ASS+DA DIGITAL AMMETER WITH BUILT IN SELECTOR SWITCH
VSS+DV DIGITAL VOLTMETER WITH BUILT IN SELECTOR SWITCH
415V, FIXED TYPE MOTOR PROTECTION CIRCUIT BREAKER (MPCB)
ICP INSTRUMENTATION CONTROL PANEL
N.RELAY NUMERICAL RELAY
MFM MULTI FUNCTION METER WITH RS485 COMMUNICATION (AMMETER, VOLTMETER, PF, FREQUENCY)
PLC PROGRAMMABLE LOGIC CONTROLLER

MPR COMPREHENSIVE MOTOR PROTECTION RELAY
M METERING UNIT
CAPACITOR BANK
LCSP LOCAL CONTROL STARTER PANEL
TTB(CT SHORT LINK)
SS SOFT STARTER
SD LOCAL ISOLATOR SWITCH
RC READY TO CLOSE (CLEAR LED)
LCP LOCAL CONTROL PANEL
TR CONTROL TRANSFORMER
I/L INTER LOCK

INTERLOCK:

INCOMER-1	INCOMER-2	BUS COUPLER	DG
ON	ON	OFF	OFF
ON	OFF	ON	OFF
OFF	OFF	ON	ON
OFF	ON	ON	OFF

NOTES:

1. TRIP COIL CIRCUITS OF ALL CIRCUIT BREAKERS SHALL BE PROVIDED WITH TRIP SUPERVISION RELAY TO SUPERVISE THE CIRCUIT IN BOTH OPEN AND CLOSED POSITION OF CIRCUIT BREAKERS.
2. ALL RELAYS USED IN 11kV SWITCHGEAR SHALL BE NUMERICAL TYPE.
3. AMMETERS IN MOTOR FEEDERS SHALL BE PROVIDED WITH SUPPRESSED SCALE UP TO 6 TIMES FULL LOAD CURRENT FOR INDICATION STARTING CURRENT.
4. ACB's SHALL BE PROVIDED WITH MICROPROCESSOR RELEASES FOR ADJUSTABLE OVERLOAD SHORT CIRCUIT, UNDER VOLTAGE AND EARTH FAULT FOR LT BREAKER. VCB'S SHALL BE PROVIDED WITH SHUNT TRIP COILS RATED WITH 110V DC FOR HT BREAKER.
5. MCCB's SHALL BE PROVIDED WITH ELECTRONIC RELEASES FOR ADJUSTABLE OVERLOAD, SHORT CIRCUIT AND EARTH FAULT.
6. ALL PANEL WIRING SHALL BE WITH 1100 VOLTS GRADE PVC INSULATED 1.5 Sqmm STRANDED COPPER WIRE FOR CONTROL WIRING & 2.5 Sqmm FOR CT SECONDARY WIRING.
7. ALL CT'S SHALL BE OF 5A SECONDARY. FOR 11kV FEEDERS, SECONDARY SHALL BE 1A.
8. ALL CONTACTOR/TIMERS etc., SHALL BE RAIL MOUNTED.
9. MINIMUM CONTACTOR RATING SHALL BE 16A.
10. CONTROL SUPPLY SHALL BE 240V AC TAPPED BETWEEN PHASE AND NEUTRAL FEEDERS MODULES.
11. MPCB SHALL BE WITH IN BUILT SINGLE PHASING PREVENTER.
12. ALL CONTACTORS SHALL BE OF AC 3 DUTY.
13. WIDTH OF FEEDER COLOUMN SHALL BE MIN. 500 mm CABLE ALLEY SHALL BE 300mm MIN.
14. ALL ACB, MCCB, CONTACTORS, MPCB, & MPR SHALL BE OF TYPE–2 CO–ORDINATION.
15. LCP SHALL BE AS INDICATED IN P&ID.
16. CT RATIO SHALL BE 10% MORE THAN THE FLC 0.85PF & 0.9 EFFICIENCY.
17. CABLE COMPARTMENT SHALL HAVE LED LAMP INTERLOCKED WITH DOOR.
18. ALL INDICATION LAMP SHALL HAVE LED CLUSTER TYPE.
19. ALL MCCB SHALL HAVE EXTENDED ROTORY HANDLE & EXTENDED BUSBAR LINK
20. OPERATION LOGIC OF 415V SWITCHBOARD:
(A) AT NORMAL CONDITION BOTH THE TRANSFORMER INCOMER FEEDER SHALL BE IN CLOSED POSITION. THE BUS COUPLER AND DG INCOMER IN OPEN POSITION.
(B) IN CASE OF FAULTS, THE FAULTY INCOMER FEEDER SHALL BE OPEN POSITON THE BUS COUPLER AND THE HEALTHY INCOMER FEEDER SHALL BE CLOSED POSITON.
(C) IN CASE OF POWER FAILURE, THE DG INCOMER, BUS COUPLER SHALL BE IN CLOSED POSITION. BOTH THE TRANSFORMER INCOMER SHALL BE SWITCHED OFF BY ACTIVATION OF UNDER VOLTAGE RELAY OF THE GRID INCOMER.
21. MOTOR FEEDER <5.5kW WILL HAVE DIRECT CONNECTED AMMETER IN Y PHASE, MOTORS >5.5kW UPTO 15kW WILL BE PROVIDED WITH 1 CT AND AMMETER AND MOTOR >15kW AND ABOVE WILL BE PROVIDED WITH 3 CTS AND AMMETER.
22. NECESSARY INTERLOCK TO SPACE HEATER WITH MOTORS TO BE PROVIDED.
23. ALL MCB SHALL HAVE KW = 100% Ics.
24. ALL MCCB CONNECTED TO MOTOR SHALL BE RATED TO MOTOR DUTY.
25. ALL ACB SHALL HAVE Icu = Ics = Icw.
26. THE 415V SIDE OF THE TRANSFORMER IS PROVIDED WITH NON SEGREGATED ALUMINUM BUS DUCT IF THE TRANSFORMER RATING IS GREATER THAN OR EQUAL TO 1000KVA. FOR THE TRANSFORMER RATING IS LESS THAN 1000KVA XLPE AL ARMOUED CABLE SHALL BE PROVIDED ON 415V SIDE.
27. CABLE SIZES LESS THAN OR EQUAL TO 6 Sqmm SHALL BE PROVIDED WITH COPPER CONDUCTORS AND AL CONDUCTORS TO BE USED FOR CABLE SIZES ABOVE 6 Sqmm.
28. CAPACITOR BANK WITH APFC SHALL BE PROVIDED WITH INTERLOCK SUCH THAT PANELS ARE FED BY DG SET, CAPACITOR BANK SHALL BE DISCONNECTED.
29. 20% SPARE FEEDERS WITH MINI OF 1 SPARE FEEDER FOR EACH RATING OF THE OUTGOING FEEDERS SHALL BE PROVIDED IN LT PANELS (PCC/MCC).

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	TM	GVKM	

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS (WORKS - A) AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS (WORKS - B) HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-PIKWSDRPWBS-3)

TITLE:
ELECTRICAL SINGLE LINE DIAGRAM FOR ELECTRICAL WORKS AT WASTE WATER TREATMENT PLANT (WWTP) WITH REUSE AND SOLAR SLUDGE DRYING BEDS- TYPICAL

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD (JV)

DESIGNED: GVKM	APPROVED	DATE: (TO ISSUE) 02–04–2025
DRAWN: TM		DATE:(CURRENT ISSUE) 02–04–2025
CHECKED: BMS		DIVISION: EL
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-EL-4004	ISSUE: P0
FILE NAME: TN–KWSDRP–WBS3–EL–4004.dwg		A1 SIZE

TITLE: ELECTRICAL SINGLE LINE DIAGRAM FOR ELECTRICAL WORKS AT WASTE WATER TREATMENT PLANT (WWTP) WITH BIO-GAS GENERATION AND REUSE

DWG NO: TN-KWSDRP-WBS3-EL-4005

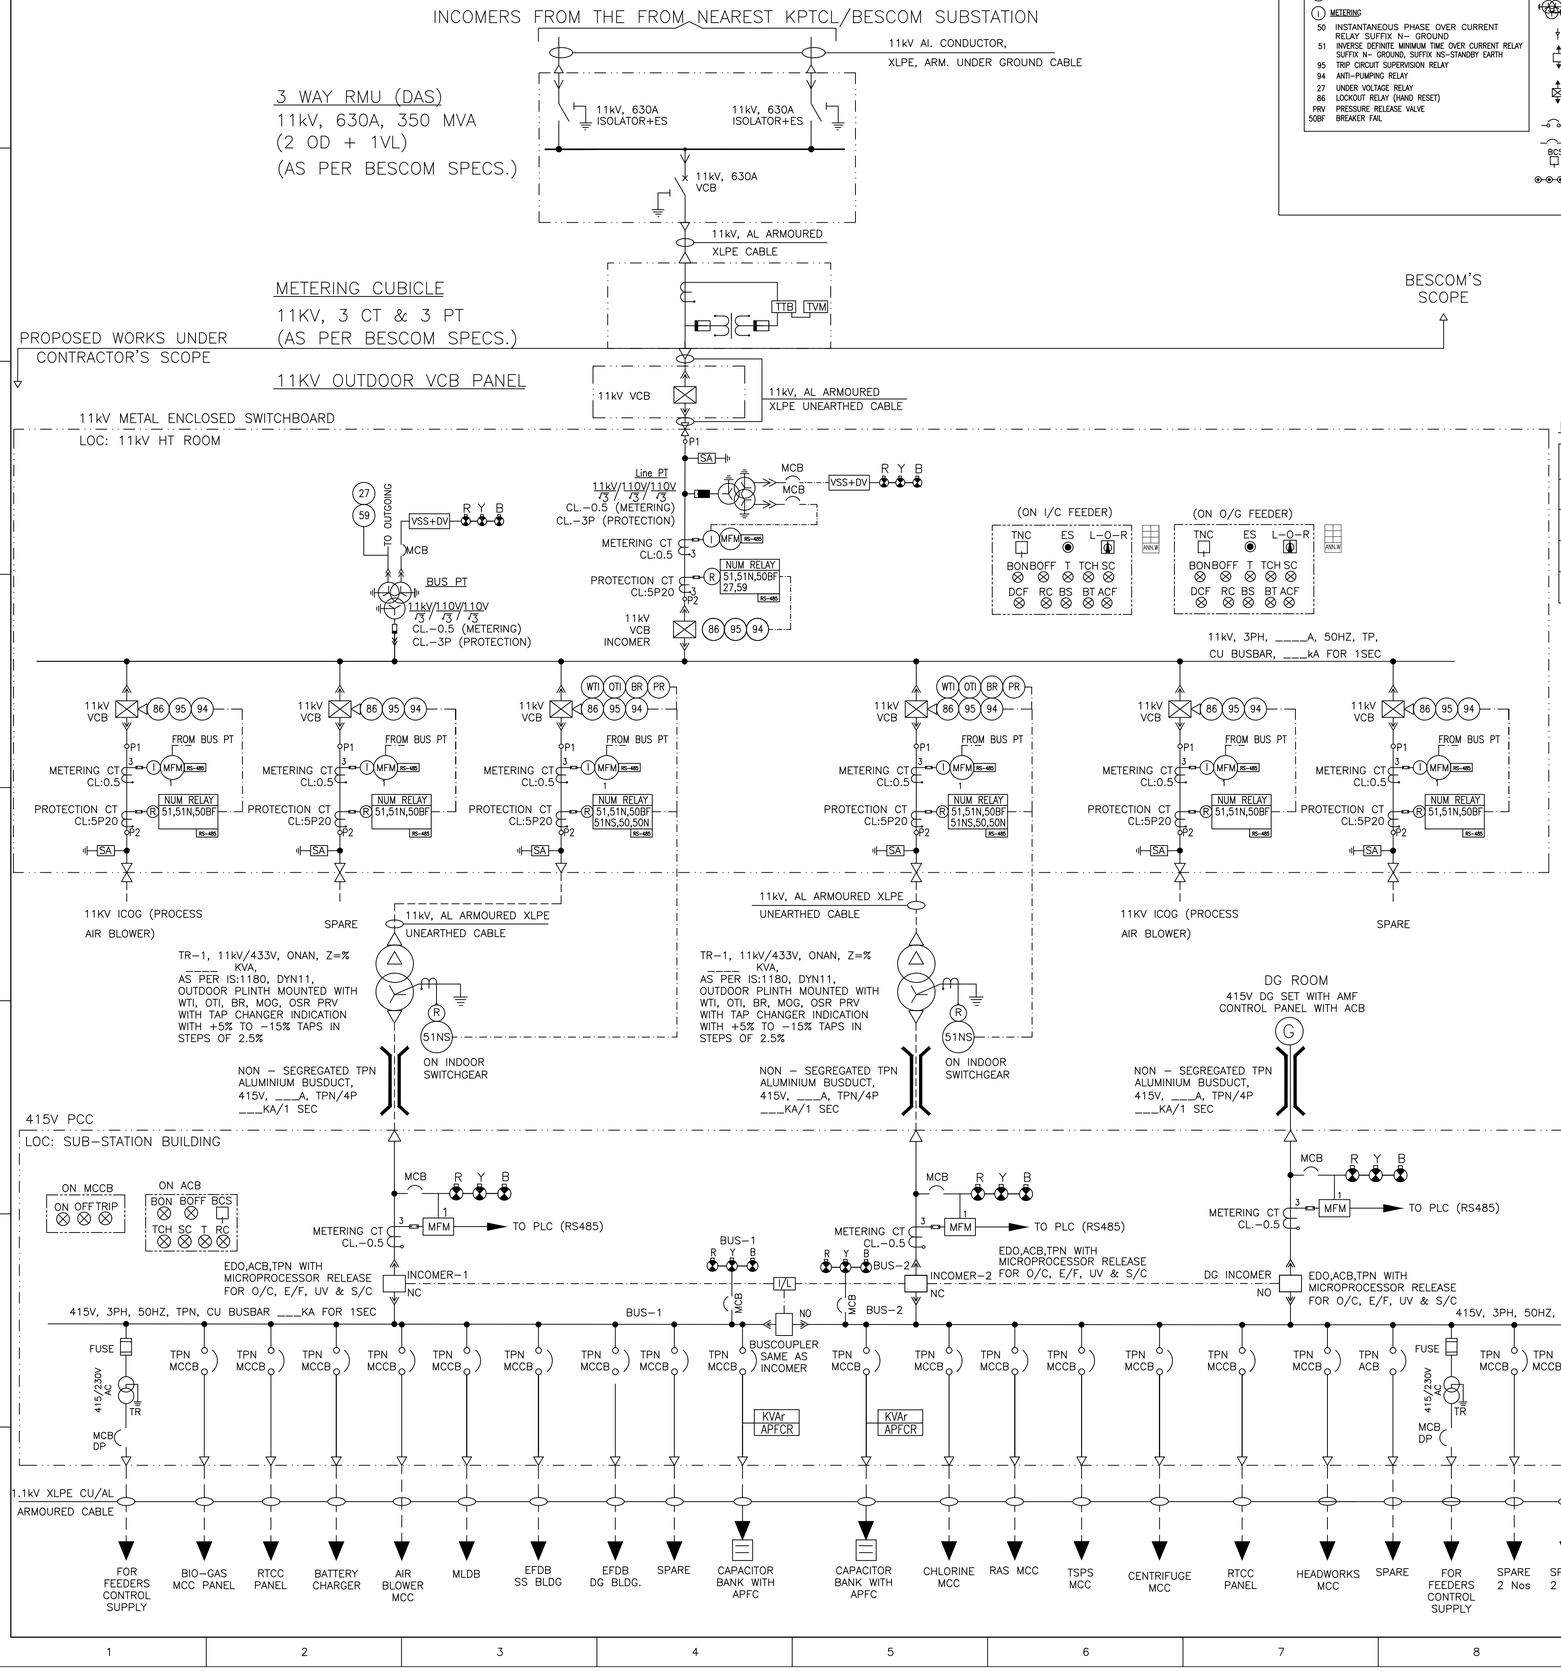

LEGENDS:–

(R) RELAYING

(I) METERING

50 INSTANTANEOUS PHASE OVER CURRENT RELAY SUFFIX N– GROUND
51 INVERSE DEFINITE MINIMUM TIME OVER CURRENT RELAY SUFFIX N– GROUND, SUFFIX NS–STANDBY EARTH
95 TRIP CIRCUIT SUPERVISION RELAY
94 ANTI–PUMPING RELAY
27 UNDER VOLTAGE RELAY
86 LOCKOUT RELAY (HAND RESET)
PRV PRESSURE RELEASE VALVE
50BF BREAKER FAIL

- 3–PH DISTRIBUTION TRANSFORMER
- CURRENT TRANSFORMER
- POTENTIAL TRANSFORMER
- CABLE TERMINATION
- 415V DRAW OUT TYPE AIR CIRCUIT BREAKER
- 11KV DRAW OUT TYPE VACUUM CIRCUIT BREAKER
- 415V MOULDED CASE CIRCUIT BREAKER
- 415V MINIATURE CIRCUIT BREAKER
- BCS BREAKER CONTROL SWITCH
- INDICATING LAMP
- (M) MOTOR
- STAR–DELTA STARTERS WITH SINGLE PHASE PREVENTOR AND MPR
- DOL DIRECT ONLINE STARTERS WITH SINGLE PHASE PREVENTOR AND MPR
- (G) DG SET WITH AMF CONTROL PANEL
- TCH TRIP CIRCUIT HEALTHY INDICATION (WHITE LED)
- SC SPRING CHARGED INDICATION (BLUE LED)
- BON BREAKER ON INDICATION (RED LED)
- BOFF BREAKER OFF INDICATION (GREEN LED)
- TRIP TRIPPED ON FAULT INDICATION (AMBER LED)
- DCF DC SUPPLY FAIL INDICATION (AMBER LED)
- BS BREAKER IN SERVICE POSITION (RED LED)
- BT BREAKER IN TEST POSITION (CLEAR LED)
- ACF AC SUPPLY FAIL INDICATION (AMBER LED)
- ON ON INDICATION (RED LED)
- OFF OFF INDICATION (GREEN LED)
- T TRIP INDICATION (AMBER LED)
- R R–PHASE INDICATION LAMP (RED LED)
- Y Y–PHASE INDICATION LAMP (YELLOW LED)
- B B–PHASE INDICATION LAMP (BLUE LED)
- L/O/R LOCAL/OFF/REMOTE SELECTOR SWITCH
- SA SURGE ARRESTER
- ASS+DA DIGITAL AMMETER WITH BUILT IN SELECTOR SWITCH
- VSS+DV DIGITAL VOLTMETER WITH BUILT IN SELECTOR SWITCH
- 415V, FIXED TYPE MOTOR PROTECTION CIRCUIT BREAKER (MPCB)
- ICP INSTRUMENTATION CONTROL PANEL
- N.RELAY NUMERICAL RELAY
- MFM MULTI FUNCTION METER WITH RS485 COMMUNICATION (AMMETER, VOLTMETER, PF, FREQUENCY)
- PLC PROGRAMMABLE LOGIC CONTROLLER
- MPR COMPREHENSIVE MOTOR PROTECTION RELAY
- M METERING UNIT
- CAPACITOR BANK
- LCSP LOCAL CONTROL STARTER PANEL
- TTB(CT SHORT LINK)
- SS SOFT STARTER
- SD LOCAL ISOLATOR SWITCH
- RC READY TO CLOSE (CLEAR LED)
- LCP LOCAL CONTROL PANEL
- CONTROL TRANSFORMER
- TR
- I/L INTER LOCK

INTERLOCK:

INCOMER-1	INCOMER-2	BUS COUPLER	DG
ON	ON	OFF	OFF
ON	OFF	ON	OFF
OFF	OFF	ON	ON
OFF	ON	ON	OFF

NOTES:

1. TRIP COIL CIRCUITS OF ALL CIRCUIT BREAKERS SHALL BE PROVIDED WITH TRIP SUPERVISION RELAY TO SUPERVISE THE CIRCUIT IN BOTH OPEN AND CLOSED POSITION OF CIRCUIT BREAKERS.
2. ALL RELAYS USED IN 11kV SWITCHGEAR SHALL BE NUMERICAL TYPE.
3. AMMETERS IN MOTOR FEEDERS SHALL BE PROVIDED WITH SUPPRESSED SCALE UP TO 6 TIMES FULL LOAD CURRENT FOR INDICATION STARTING CURRENT.
4. ACB's SHALL BE PROVIDED WITH MICROPROCESSOR RELEASES FOR ADJUSTABLE OVERLOAD SHORT CIRCUIT, UNDER VOLTAGE AND EARTH FAULT FOR LT BREAKER. VCB'S SHALL BE PROVIDED WITH SHUNT TRIP COILS RATED WITH 110V DC FOR HT BREAKER.
5. MCCB's SHALL BE PROVIDED WITH ELECTRONIC RELEASES FOR ADJUSTABLE OVERLOAD, SHORT CIRCUIT AND EARTH FAULT.
6. ALL PANEL WIRING SHALL BE WITH 1100 VOLTS GRADE PVC INSULATED 1.5 Sqmm STRANDED COPPER WIRE FOR CONTROL WIRING & 2.5 Sqmm FOR CT SECONDARY WIRING.
7. ALL CT'S SHALL BE OF 5A SECONDARY. FOR 11KV FEEDERS, SECONDARY SHALL BE 1A.
8. ALL CONTACTOR/TIMERS etc., SHALL BE RAIL MOUNTED.
9. MINIMUM CONTACTOR RATING SHALL BE 16A.
10. CONTROL SUPPLY SHALL BE 240V AC TAPPED BETWEEN PHASE AND NEUTRAL FEEDERS MODULES.
11. MPCB SHALL BE WITH IN BUILT SINGLE PHASING PREVENTER.
12. ALL CONTACTORS SHALL BE OF AC 3 DUTY.
13. WIDTH OF FEEDER COLOUMN SHALL BE MIN. 500 mm CABLE ALLEY SHALL BE 300mm MIN.
14. ALL ACB, MCCB, CONTACTORS, MPCB, & MPR SHALL BE OF TYPE–2 CO–ORDINATION.
15. LCP SHALL BE AS INDICATED IN P&ID.
16. CT RATIO SHALL BE 10% MORE THAN THE FLC 0.85PF & 0.9 EFFICIENCY.
17. CABLE COMPARTMENT SHALL HAVE LED LAMP INTERLOCKED WITH DOOR.
18. ALL INDICATION LAMP SHALL HAVE LED CLUSTER TYPE.
19. ALL MCCB SHALL HAVE EXTENDED ROTORY HANDLE & EXTENDED BUSBAR LINK
20. OPERATION LOGIC OF 415V SWITCHBOARD:

(A) AT NORMAL CONDITION BOTH THE TRANSFORMER INCOMER FEEDER SHALL BE IN CLOSED POSITION. THE BUS COUPLER AND DG INCOMER IN OPEN POSITION.

(B) IN CASE OF FAULTS, THE FAULTY INCOMER FEEDER SHALL BE OPEN POSITON THE BUS COUPLER AND THE HEALTHY INCOMER FEEDER SHALL BE CLOSED POSITON.

(C) IN CASE OF POWER FAILURE, THE DG INCOMER, BUS COUPLER SHALL BE IN CLOSED POSITION. BOTH THE TRANSFORMER INCOMER SHALL BE SWITCHED OFF BY ACTIVATION OF UNDER VOLTAGE RELAY OF THE GRID INCOMER.

21. MOTOR FEEDER <5.5kW WILL HAVE DIRECT CONNECTED AMMETER IN Y PHASE, MOTORS >5.5kW UPTO 15kW WILL BE PROVIDED WITH 1 CT AND AMMETER AND MOTOR >15kW AND ABOVE WILL BE PROVIDED WITH 3 CTS AND AMMETER.
22. NECESSARY INTERLOCK TO SPACE HEATER WITH MOTORS TO BE PROVIDED.
23. ALL MCB SHALL HAVE KW = 100% Ics.
24. ALL MCCB CONNECTED TO MOTOR SHALL BE RATED TO MOTOR DUTY.
25. ALL ACB SHALL HAVE Icu = Ics = Icw.
26. THE 415V SIDE OF THE TRANSFORMER IS PROVIDED WITH NON SEGREGATED ALUMINUM BUS DUCT IF THE TRANSFORMER RATING IS GREATER THAN OR EQUAL TO 1000KVA. FOR THE TRANSFORMER RATING IS LESS THAN 1000KVA XLPE AL ARMOUED CABLE SHALL BE PROVIDED ON 415V SIDE.
27. CABLE SIZES LESS THAN OR EQUAL TO 6 Sqmm SHALL BE PROVIDED WITH COPPER CONDUCTORS AND AL CONDUCTORS TO BE USED FOR CABLE SIZES ABOVE 6 Sqmm.
28. CAPACITOR BANK WITH APFC SHALL BE PROVIDED WITH INTERLOCK SUCH THAT PANELS ARE FED BY DG SET, CAPACITOR BANK SHALL BE DISCONNECTED.
29. 20% SPARE FEEDERS WITH MINI OF 1 SPARE FEEDER FOR EACH RATING OF THE OUTGOING FEEDERS SHALL BE PROVIDED IN LT PANELS (PCC/MCC).

ISSUE	DATE	DESCRIPTION	BY	CIVIL	ELEC.	MECH.	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	TM		GVKM		
			CHECKED				

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-PIKWSDRPWBS-3)

TITLE:
ELECTRICAL SINGLE LINE DIAGRAM FOR ELECTRICAL WORKS AT WASTE WATER TREATMENT PLANT (WwTP) WITH BIO-GAS GENERATION AND REUSE

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD (JV)

DESIGNED: GVKM	APPROVED	DATE: (TO ISSUE) 02–04–2025
DRAWN: TM		DATE:(CURRENT ISSUE) 02–04–2025
CHECKED: BMS		DIVISION: EL
SCALE: NTS	DWG. NO. TN–KWSDRP–WBS3–EL–4005	ISSUE: P0
FILE NAME: TN–KWSDRP–WBS3–EL–4005.dwg		A1 SIZE

TITLE: TYPICAL HYDRAULIC FLOW DIAGRAM FOR INTERMEDIATE SEWAGE PUMPING STATION

DWG NO: TN-KWSDRP-WBS3-HFD-6010

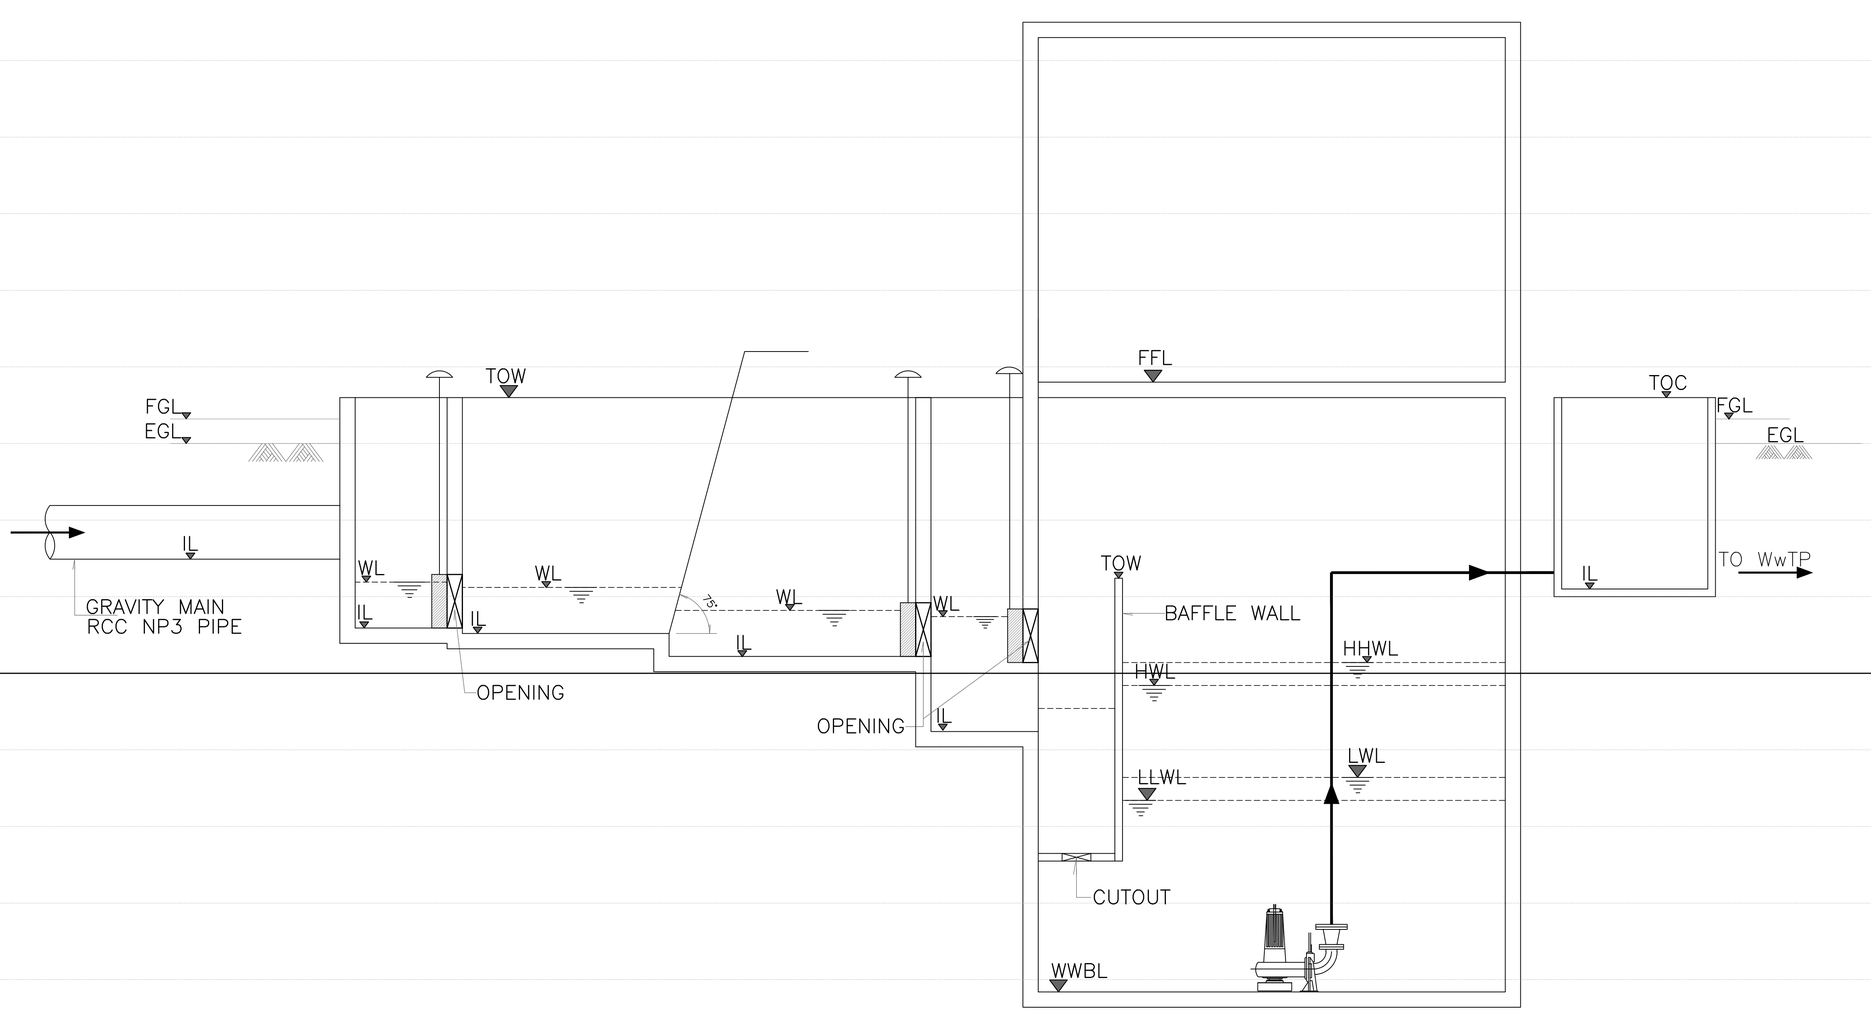

HYDRAULIC FLOW DIAGRAM

LEGENDS :

IL – INVERT LEVEL
WL – WATER LEVEL
EGL – EXISTING GROUND LEVEL
FFL – FINISHED FLOOR LEVEL
FGL – FINISHED GROUND LEVEL
TOW – TOP OF WALL
HWL – HIGH WATER LEVEL
HHWL– HIGH HIGH WATER LEVEL
LWL – LOW WATER LEVEL
LLWL– LOW LOW WATER LEVEL
RCC – REINFORCED CEMENT CONCRETE
WWBL– WET WELL BOTTOM LEVEL
ISPS – INTERMEDIATE SEWAGE PUMPING STATION

NOTE :

1. ALL LEVELS SHALL BE DETERMINED BY THE BIDDER BASED ON SITE SURVEY DETAILS BASED ON THE PROPOSED ISPS

ENGINEERING REFERENCE DRAWINGS :

–NIL–

ISSUE	DATE	DESCRIPTION	BY	CIVIL	ELEC.	MECH.	APPD.
T0	02/04/2025	FOR TENDER PURPOSE	TM			AM	
			CHECKED				

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS (WORKS - A) AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS (WORKS - B) HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE: TYPICAL HYDRAULIC FLOW DIAGRAM FOR INTERMEDIATE SEWAGE PUMPING STATION

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD (JV)

DESIGNED: AM	APPROVED	DATE: (TO ISSUE) 02–04–2025
DRAWN: TM		DATE:(CURRENT ISSUE) 02–04–2025
CHECKED: BMS		DIVISION: ME
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-HFD-6010	ISSUE: P0

FILE NAME: TN–KWSDRP–WBS3–HFD–6010.dwg A1 SIZE

TITLE: SCADA CONTROL SYSTEM ARCHITECTURE DRAWING FOR WWTP AT IBLUR

DWG NO: TN-KWSDRP-WBS3-IC-5003

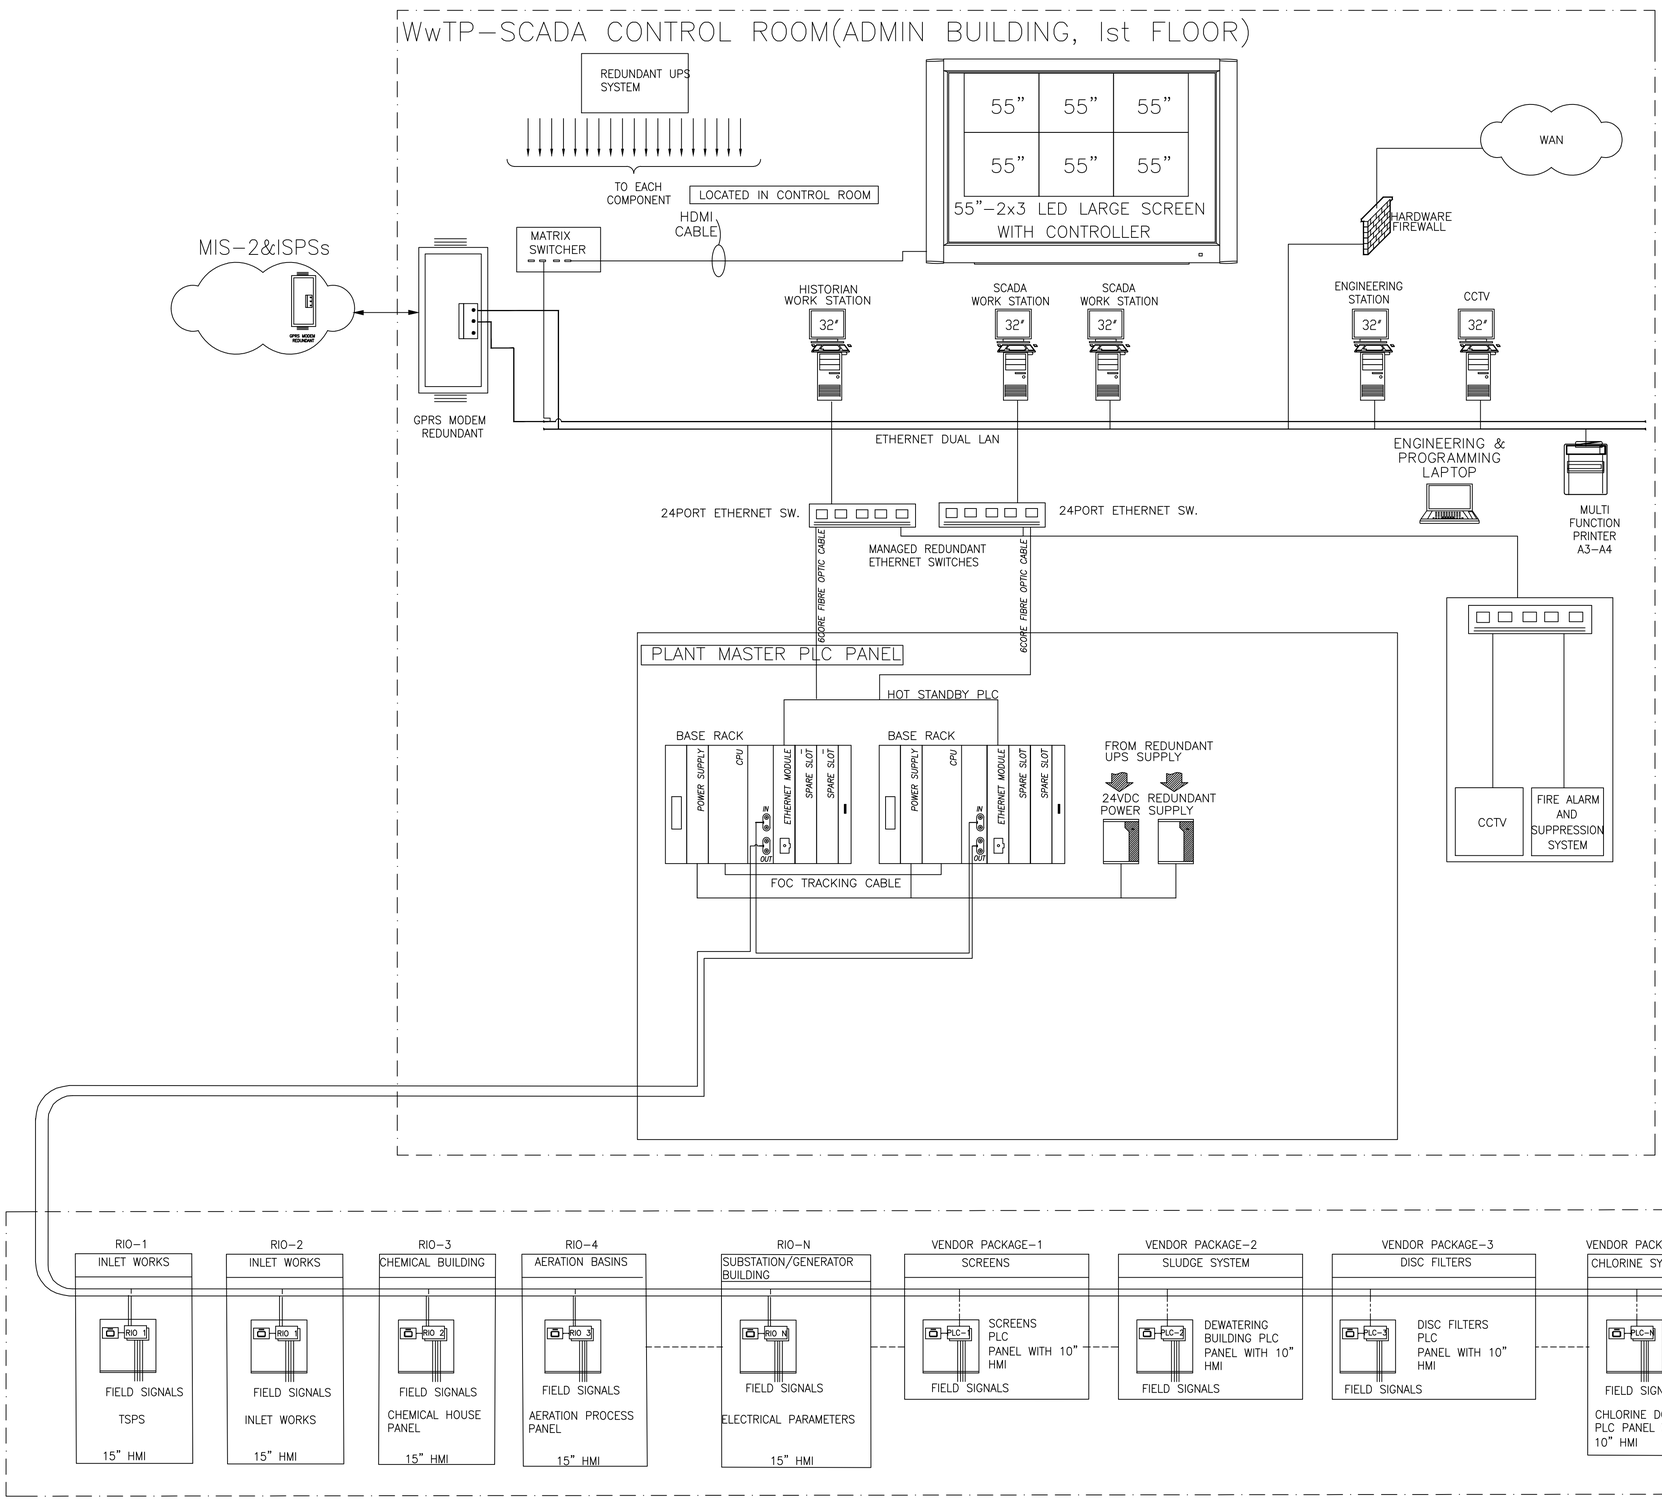

LEGEND:–

S.No.	SYMBOL	DESCRIPTION
1.	PLC	PROGRAMMABLE LOGIC CONTROLLER
2.	———	ETHERNET CABLE
3.	–·–·–·–	MODBUS RS485 CABLE
4.	═══	SINGLE MODE OPTICAL FIBER CABLE (OFC)–REDUNDANT MODE
5.	═══	SIGNAL CABLE
6.	———	HDMI CABLE
7.	SCADA	SUPERVISORY CONTROL AND DATA AQUISITION
8.	HMI	HUMAN MACHINE INTERFACE
9.	CCTV	CLOSED CIRCUIT TELEVISION
10.	CPU	CENTRAL PROCESSING UNIT
11.	UPS	UNINTERRUPTIBLE POWER SUPPLY
12.	WAN	WIDE AREA NETWORK
13.	LAN	LOCAL AREA NETWORK
14.	ODU	OUT DOOR DISPLAY UNIT
15.	OARM	ONLINE ANALYTICAL REAL TIME MULTIPARAMETERS
16.	KSPCB	KARNATAKA STATE POLLUTION CONTROL BOARD

NOTES:–

1. PLANT MASTER PLC SHALL BE HOT–STAND–BY CONFIGURATION[REDUNDANT CONTROLLERS, POWER SUPPLY & COMMUNICATION MODULES]
2. SCADA CONTROL ROOM SHALL BE LOCATED AT 1ST FLOOR OF ADMIN BUILDING.
3. REDUNDANT SCADA SERVERS SHALL BE CONFIGURED WITH HOTSTAND–BY CONTROLLERS
4. HISTORIAN SERVER (BLADE TYPE) SHALL BE CONFIGURED WITH SCADA SERVER AND THE SAME SHALL BE UTILIZED THROUGH HISTORIAN OPERATOR WORKSTATION FOR CONTINUOUS BACKUP & RETRIEVAL OF SCADA SERVER DATA
5. ALL RIO PANELS SHALL BE CONFIGURED THROUGH PLANT HOTSTAND–BY CONTROLLER THROUGH REDUNDANT OPTICAL FIBRE CABLE (OFC) UNDER RING NETWROK TOPOLOGY.
6. THE INPUT & OUTPUT (ANALOG / DIGITAL) MODULES SHALL BE AS REQUIRED SUBJECT TO APPROVED INPUT & OUTPUT(IO) SCHEDULE.
7. THE SPARE PHILOSOPHY FOR INPUT & OUTPUT (ANALOG/ DIGTAL) SHALL BE CONSIDERED AS 30% WHICH INCLUDES PANEL ACCESSERIES OF POTENTIAL FREE CONTACTS & TERMINAL BLOCKS– APPLICABLE FOR RIO PANELS AS WELL AS ANY SUB PROCESS SYSTEMS OF VENDOR PACKAGE PLC PANELS.
8. THE SPARE MEMORY FOR CONROLLERS SHALL BE 50% SPARE AS PROGRAM MEMORY AND DATA MEMORY
9. MULTI FUNCTION ENERGY METERS (MFMs) SHALL BE CONNECTED TO RESPECTIVE RIO PANEL THROUGH RS–485 CONNECTIVITY
10. FIRE ALARM SYSTEM & CLOSE CIRCUIT TELEVISION SYSTEMS SHALL BE INTERFACED WITH PLANT SCADA SYSTEMS.
11. 15" INCHES PANEL MOUNTED HMIs SHALL BE CONSIDERED FOR EACH RIO PANEL AND 10" INCHES PANEL MOUNTED HMIS SHALL BE CONSIDERED IN CASE OF ANY SUB PROCESS SYSTEMS OF VENDOR PACKAGE CONTROL SYSTEM
12. LARGE VIDEO SCREEN (55" led 2 X3 DISPLAY ARRAY) WITH REQUIRED CONTROLLER AND SOFTWARE FOR SCREEN SPLITTING BETWEEN VARIOUS LED ARRAY SCREENS WITH SCADA & CCTV SYSTEM FOR LIVE MONITORING OF SCADA & CCTV FEEDS. OPERATOR CAN ALSO BE ABLE TO CHANGE PLANT SCADA SCREENS IN LED ARRAYS AS PER HIS CONVINIENT WITH RESPECT TO BETTER OPERATIONAL POINT OF VIEW.
13. PLANT BULK DATA [COMPLETE PLANT OPERATIONAL DATA INCLUSIVE OF LAB DATA THROUGH LIMS] TO BE TRANSMITTED TO MIS–2 CENTRAL SCADA SYSTEM AT SHIMSHA BHAVAN THROUGH REDUNDANT GPRS COMMUNICATION MODULES THROUGH INTERFACE PANEL.
14. ONLINE ANALYTICAL REALTIME MULTIPARAMETER SHALL BE CONSIDERED FOR INLET & OUTLET OF WwTP AND THOSE READINGS TRANSMITTED TO KSPCB AS WELL AS PLANT SCADA SYSTEM.
15. THE VENDOR PLCs DATA SHALL BE INTERFACED WITH PLC / SCADA SYSTEM BY USING SERIAL COMMUNICATION FOR THE PURPOSE OF CONTINUOUS MONITORING & CONTROL.
16. The RIO Panel shall be applicable for any non–SBR Packages (i.e. Vendor Package PLC applicable for SBR Package)

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MR	

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:

SCADA CONTROL SYSTEM ARCHITECTURE DRAWING FOR WwTP AT IBLUR

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD (JV)

DESIGNED: MR	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: IC
SCALE: NTS	DWG. NO. TN–KWSDRP–WBS3–IC–5003	ISSUE: P0
FILE NAME: TN–KWSDRP–WBS3–IC–5003.dwg		A1 SIZE

TITLE: SCADA CONTROL SYSTEM ARCHITECTURE DRAWING FOR WWTP AT U M KAVAL

DWG NO: TN-KWSDRP-WBS3-IC-5004

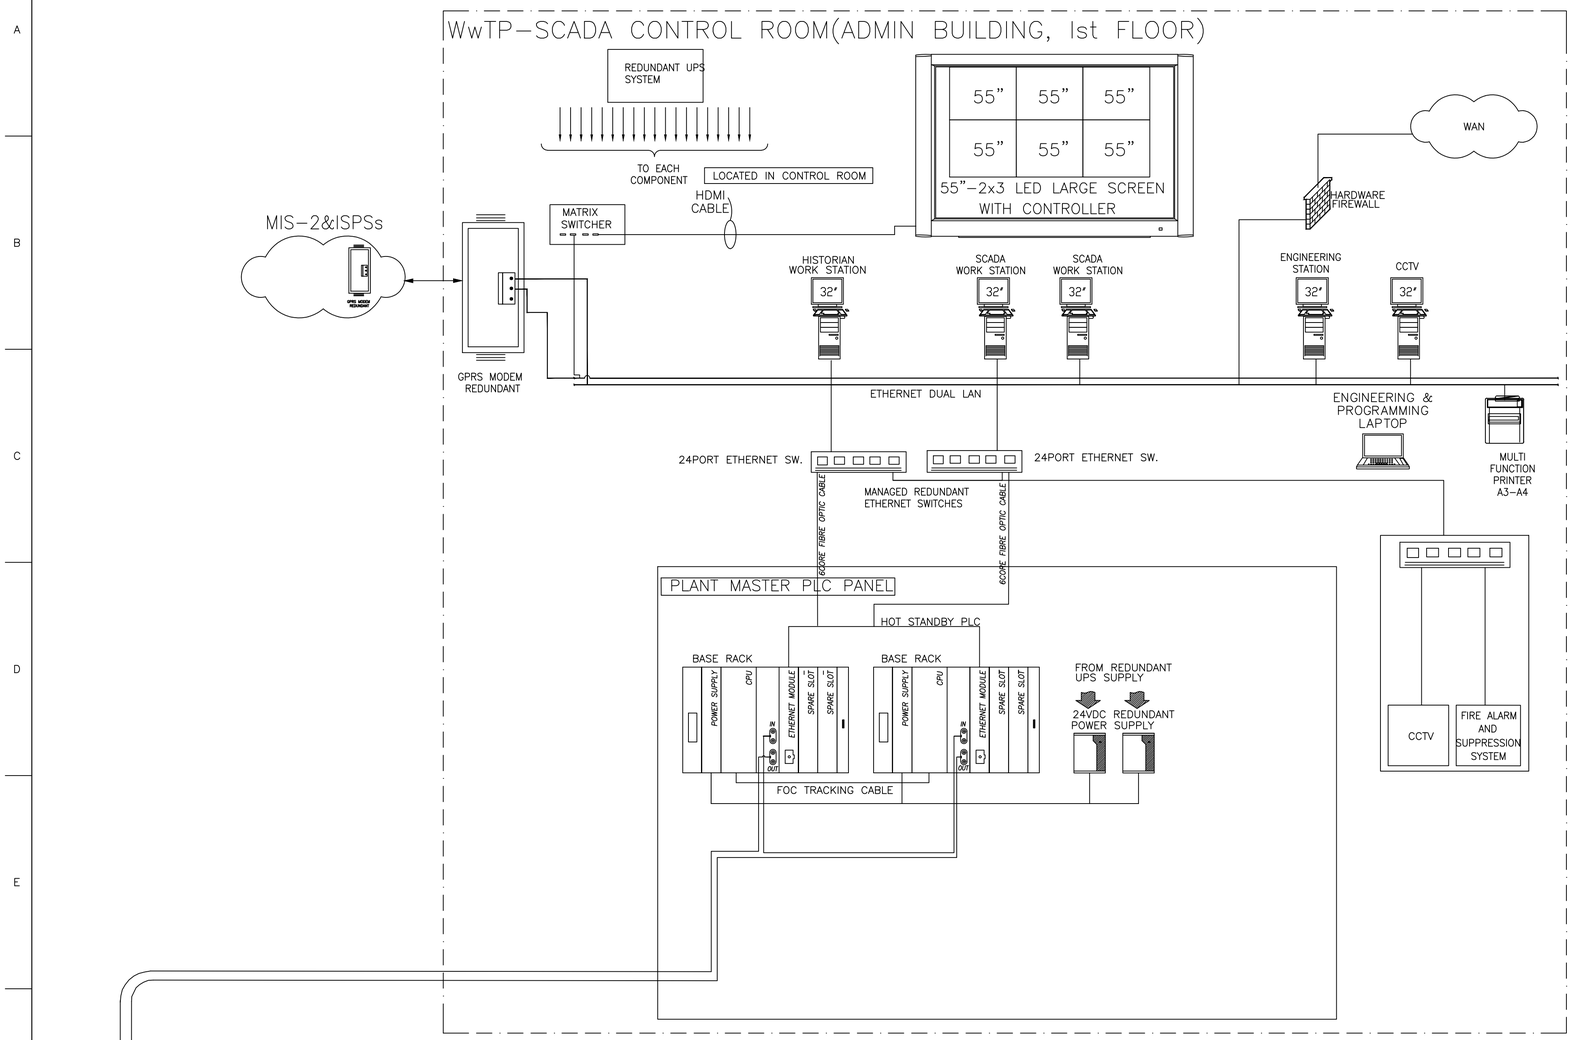

LEGEND:–

S.No.	SYMBOL	DESCRIPTION
1.	PLC	PROGRAMMABLE LOGIC CONTROLLER
2.	———	ETHERNET CABLE
3.	—·—·—·—	MODBUS RS485 CABLE
4.	═══	SINGLE MODE OPTICAL FIBER CABLE (OFC)–REDUNDANT MODE
5.	▬▬	SIGNAL CABLE
6.	———	HDMI CABLE
7.	SCADA	SUPERVISORY CONTROL AND DATA AQUISITION
8.	HMI	HUMAN MACHINE INTERFACE
9.	CCTV	CLOSED CIRCUIT TELEVISION
10.	CPU	CENTRAL PROCESSING UNIT
11.	UPS	UNINTERRUPTIBLE POWER SUPPLY
12.	WAN	WIDE AREA NETWORK
13.	LAN	LOCAL AREA NETWORK
14.	ODU	OUT DOOR DISPLAY UNIT
15.	OARM	ONLINE ANALYTICAL REAL TIME MULTIPARAMETERS
16.	KSPCB	KARNATAKA STATE POLLUTION CONTROL BOARD

NOTES:–

1. PLANT MASTER PLC SHALL BE HOT–STAND–BY CONFIGURATION[REDUNDANT CONTROLLERS, POWER SUPPLY & COMMUNICATION MODULES]
2. SCADA CONTROL ROOM SHALL BE LOCATED AT 1ST FLOOR OF ADMIN BUILDING.
3. REDUNDANT SCADA SERVERS SHALL BE CONFIGURED WITH HOTSTAND–BY CONTROLLERS
4. HISTORIAN SERVER (BLADE TYPE) SHALL BE CONFIGURED WITH SCADA SERVER AND THE SAME SHALL BE UTILIZED THROUGH HISTORIAN OPERATOR WORKSTATION FOR CONTINUOUS BACKUP & RETRIEVAL OF SCADA SERVER DATA
5. ALL RIO PANELS SHALL BE CONFIGURED THROUGH PLANT HOTSTAND–BY CONTROLLER THROUGH REDUNDANT OPTICAL FIBRE CABLE (OFC) UNDER RING NETWROK TOPOLOGY.
6. THE INPUT & OUTPUT (ANALOG / DIGITAL) MODULES SHALL BE AS REQUIRED SUBJECT TO APPROVED INPUT & OUTPUT(IO) SCHEDULE.
7. THE SPARE PHILOSOPHY FOR INPUT & OUTPUT (ANALOG/ DIGTAL) SHALL BE CONSIDERED AS 30% WHICH INCLUDES PANEL ACCESSERIES OF POTENTIAL FREE CONTACTS & TERMINAL BLOCKS– APPLICABLE FOR RIO PANELS AS WELL AS ANY SUB PROCESS SYSTEMS OF VENDOR PACKAGE PLC PANELS.
8. THE SPARE MEMORY FOR CONROLLERS SHALL BE 50% SPARE AS PROGRAM MEMORY AND DATA MEMORY
9. MULTI FUNCTION ENERGY METERS (MFMs) SHALL BE CONNECTED TO RESPECTIVE RIO PANEL THROUGH RS–485 CONNECTIVITY
10. FIRE ALARM SYSTEM & CLOSE CIRCUIT TELEVISION SYSTEMS SHALL BE INTERFACED WITH PLANT SCADA SYSTEMS.
11. 15" INCHES PANEL MOUNTED HMIs SHALL BE CONSIDERED FOR EACH RIO PANEL AND 10" INCHES PANEL MOUNTED HMIS SHALL BE CONSIDERED IN CASE OF ANY SUB PROCESS SYSTEMS OF VENDOR PACKAGE CONTROL SYSTEM
12. LARGE VIDEO SCREEN (55" led 2 X3 DISPLAY ARRAY) WITH REQUIRED CONTROLLER AND SOFTWARE FOR SCREEN SPLITTING BETWEEN VARIOUS LED ARRAY SCREENS WITH SCADA & CCTV SYSTEM FOR LIVE MONITORING OF SCADA & CCTV FEEDS. OPERATOR CAN ALSO BE ABLE TO CHANGE PLANT SCADA SCREENS IN LED ARRAYS AS PER HIS CONVINIENT WITH RESPECT TO BETTER OPERATIONAL POINT OF VIEW.
13. PLANT BULK DATA [COMPLETE PLANT OPERATIONAL DATA INCLUSIVE OF LAB DATA THROUGH LIMS] TO BE TRANSMITTED TO MIS–2 CENTRAL SCADA SYSTEM AT SHIMSHA BHAVAN THROUGH REDUNDANT GPRS COMMUNICATION MODULES THROUGH INTERFACE PANEL.
14. ONLINE ANALYTICAL REALTIME MULTIPARAMETER SHALL BE CONSIDERED FOR INLET & OUTLET OF WwTP AND THOSE READINGS TRANSMITTED TO KSPCB AS WELL AS PLANT SCADA SYSTEM.
15. THE VENDOR PLCs DATA SHALL BE INTERFACED WITH PLC / SCADA SYSTEM BY USING SERIAL COMMUNICATION FOR THE PURPOSE OF CONTINUOUS MONITORING & CONTROL.
16. .The RIO Panel shall be applicable for any non–SBR Packages (i.e. Vendor Package PLC applicable for SBR Package)

ISSUE	DATE	DESCRIPTION					
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MR			
			BY	I&C.			APPD.
			CHECKED				

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:

SCADA CONTROL SYSTEM ARCHITECTURE DRAWING FOR WwTP AT U M KAVAL

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD (JV)

DESIGNED: MR	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: IC
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-IC-5004	ISSUE: P0
FILE NAME: TN–KWSDRP–WBS3–IC–5004.dwg		A1 SIZE

TITLE: SCADA CONTROL SYSTEM ARCHITECTURE DRAWING FOR WWTP AT HULIMAVU

DWG NO: TN-KWSDRP-WBS3-IC-5005

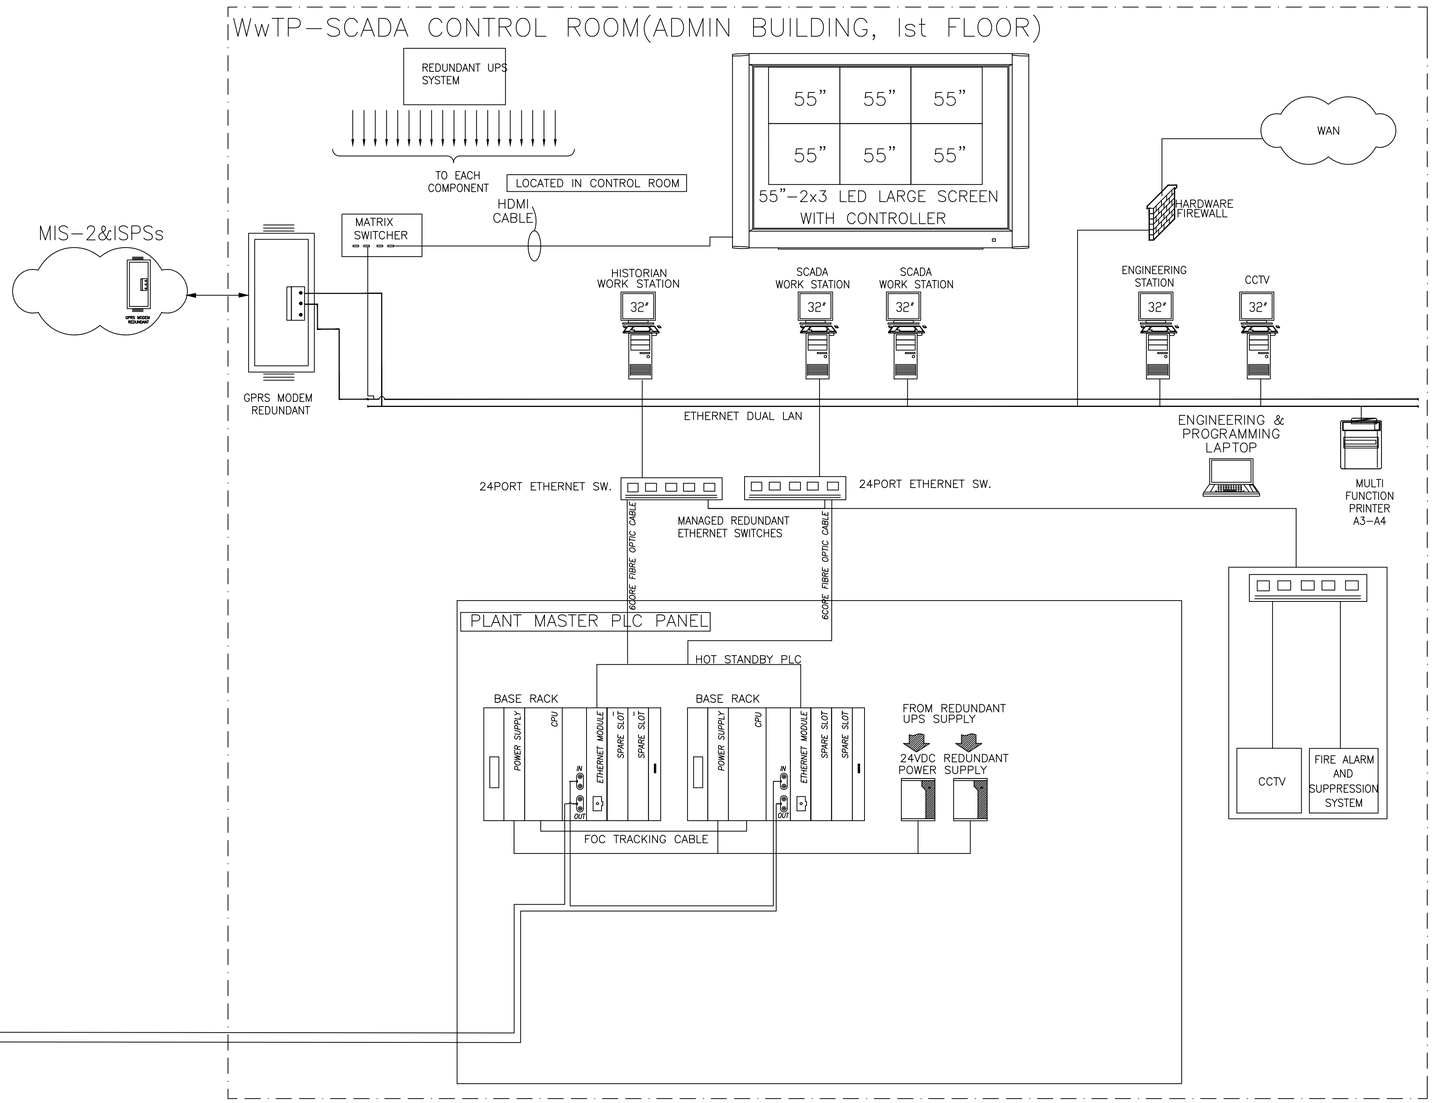

LEGEND:–

S.No.	SYMBOL	DESCRIPTION
1.	PLC	PROGRAMMABLE LOGIC CONTROLLER
2.	———	ETHERNET CABLE
3.	–·–·–·–	MODBUS RS485 CABLE
4.	———	SINGLE MODE OPTICAL FIBER CABLE (OFC)–REDUNDANT MODE
5.	═══	SIGNAL CABLE
6.	———	HDMI CABLE
7.	SCADA	SUPERVISORY CONTROL AND DATA AQUISITION
8.	HMI	HUMAN MACHINE INTERFACE
9.	CCTV	CLOSED CIRCUIT TELEVISION
10.	CPU	CENTRAL PROCESSING UNIT
11.	UPS	UNINTERRUPTIBLE POWER SUPPLY
12.	WAN	WIDE AREA NETWORK
13.	LAN	LOCAL AREA NETWORK
14.	ODU	OUT DOOR DISPLAY UNIT
15.	OARM	ONLINE ANALYTICAL REAL TIME MULTIPARAMETERS
16.	KSPCB	KARNATAKA STATE POLLUTION CONTROL BOARD

NOTES:–

1. PLANT MASTER PLC SHALL BE HOT–STAND–BY CONFIGURATION[REDUNDANT CONTROLLERS, POWER SUPPLY & COMMUNICATION MODULES]
2. SCADA CONTROL ROOM SHALL BE LOCATED AT 1ST FLOOR OF ADMIN BUILDING.
3. REDUNDANT SCADA SERVERS SHALL BE CONFIGURED WITH HOTSTAND–BY CONTROLLERS
4. HISTORIAN SERVER (BLADE TYPE) SHALL BE CONFIGURED WITH SCADA SERVER AND THE SAME SHALL BE UTILIZED THROUGH HISTORIAN OPERATOR WORKSTATION FOR CONTINUOUS BACKUP & RETRIEVAL OF SCADA SERVER DATA
5. ALL RIO PANELS SHALL BE CONFIGURED THROUGH PLANT HOTSTAND–BY CONTROLLER THROUGH REDUNDANT OPTICAL FIBRE CABLE (OFC) UNDER RING NETWROK TOPOLOGY.
6. THE INPUT & OUTPUT (ANALOG / DIGITAL) MODULES SHALL BE AS REQUIRED SUBJECT TO APPROVED INPUT & OUTPUT(IO) SCHEDULE.
7. THE SPARE PHILOSOPHY FOR INPUT & OUTPUT (ANALOG/ DIGTAL) SHALL BE CONSIDERED AS 30% WHICH INCLUDES PANEL ACCESSERIES OF POTENTIAL FREE CONTACTS & TERMINAL BLOCKS– APPLICABLE FOR RIO PANELS AS WELL AS ANY SUB PROCESS SYSTEMS OF VENDOR PACKAGE PLC PANELS.
8. THE SPARE MEMORY FOR CONROLLERS SHALL BE 50% SPARE AS PROGRAM MEMORY AND DATA MEMORY
9. MULTI FUNCTION ENERGY METERS (MFMs) SHALL BE CONNECTED TO RESPECTIVE RIO PANEL THROUGH RS–485 CONNECTIVITY
10. FIRE ALARM SYSTEM & CLOSE CIRCUIT TELEVISION SYSTEMS SHALL BE INTERFACED WITH PLANT SCADA SYSTEMS.
11. 15" INCHES PANEL MOUNTED HMIs SHALL BE CONSIDERED FOR EACH RIO PANEL AND 10" INCHES PANEL MOUNTED HMIS SHALL BE CONSIDERED IN CASE OF ANY SUB PROCESS SYSTEMS OF VENDOR PACKAGE CONTROL SYSTEM
12. LARGE VIDEO SCREEN (55" led 2 X3 DISPLAY ARRAY) WITH REQUIRED CONTROLLER AND SOFTWARE FOR SCREEN SPLITTING BETWEEN VARIOUS LED ARRAY SCREENS WITH SCADA & CCTV SYSTEM FOR LIVE MONITORING OF SCADA & CCTV FEEDS. OPERATOR CAN ALSO BE ABLE TO CHANGE PLANT SCADA SCREENS IN LED ARRAYS AS PER HIS CONVINIENT WITH RESPECT TO BETTER OPERATIONAL POINT OF VIEW.
13. PLANT BULK DATA [COMPLETE PLANT OPERATIONAL DATA INCLUSIVE OF LAB DATA THROUGH LIMS] TO BE TRANSMITTED TO MIS–2 CENTRAL SCADA SYSTEM AT SHIMSHA BHAVAN THROUGH REDUNDANT GPRS COMMUNICATION MODULES THROUGH INTERFACE PANEL.
14. ONLINE ANALYTICAL REALTIME MULTIPARAMETER SHALL BE CONSIDERED FOR INLET & OUTLET OF WwTP AND THOSE READINGS TRANSMITTED TO KSPCB AS WELL AS PLANT SCADA SYSTEM.
15. THE VENDOR PLCs DATA SHALL BE INTERFACED WITH PLC / SCADA SYSTEM BY USING SERIAL COMMUNICATION FOR THE PURPOSE OF CONTINUOUS MONITORING & CONTROL.
16. The RIO Panel shall be applicable for any non–SBR Packages (i.e. Vendor Package PLC applicable for SBR Package)

ISSUE	DATE	DESCRIPTION						APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MR				
			BY	I&C.				
			CHECKED					

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS (WORKS - A) AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS (WORKS - B) HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:

SCADA CONTROL SYSTEM ARCHITECTURE DRAWING FOR WwTP AT HULIMAVU

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD (JV)

DESIGNED: MR	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: IC
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-IC-5005	ISSUE: P0
FILE NAME: TN–KWSDRP–WBS3–IC–5005.dwg		A1 SIZE

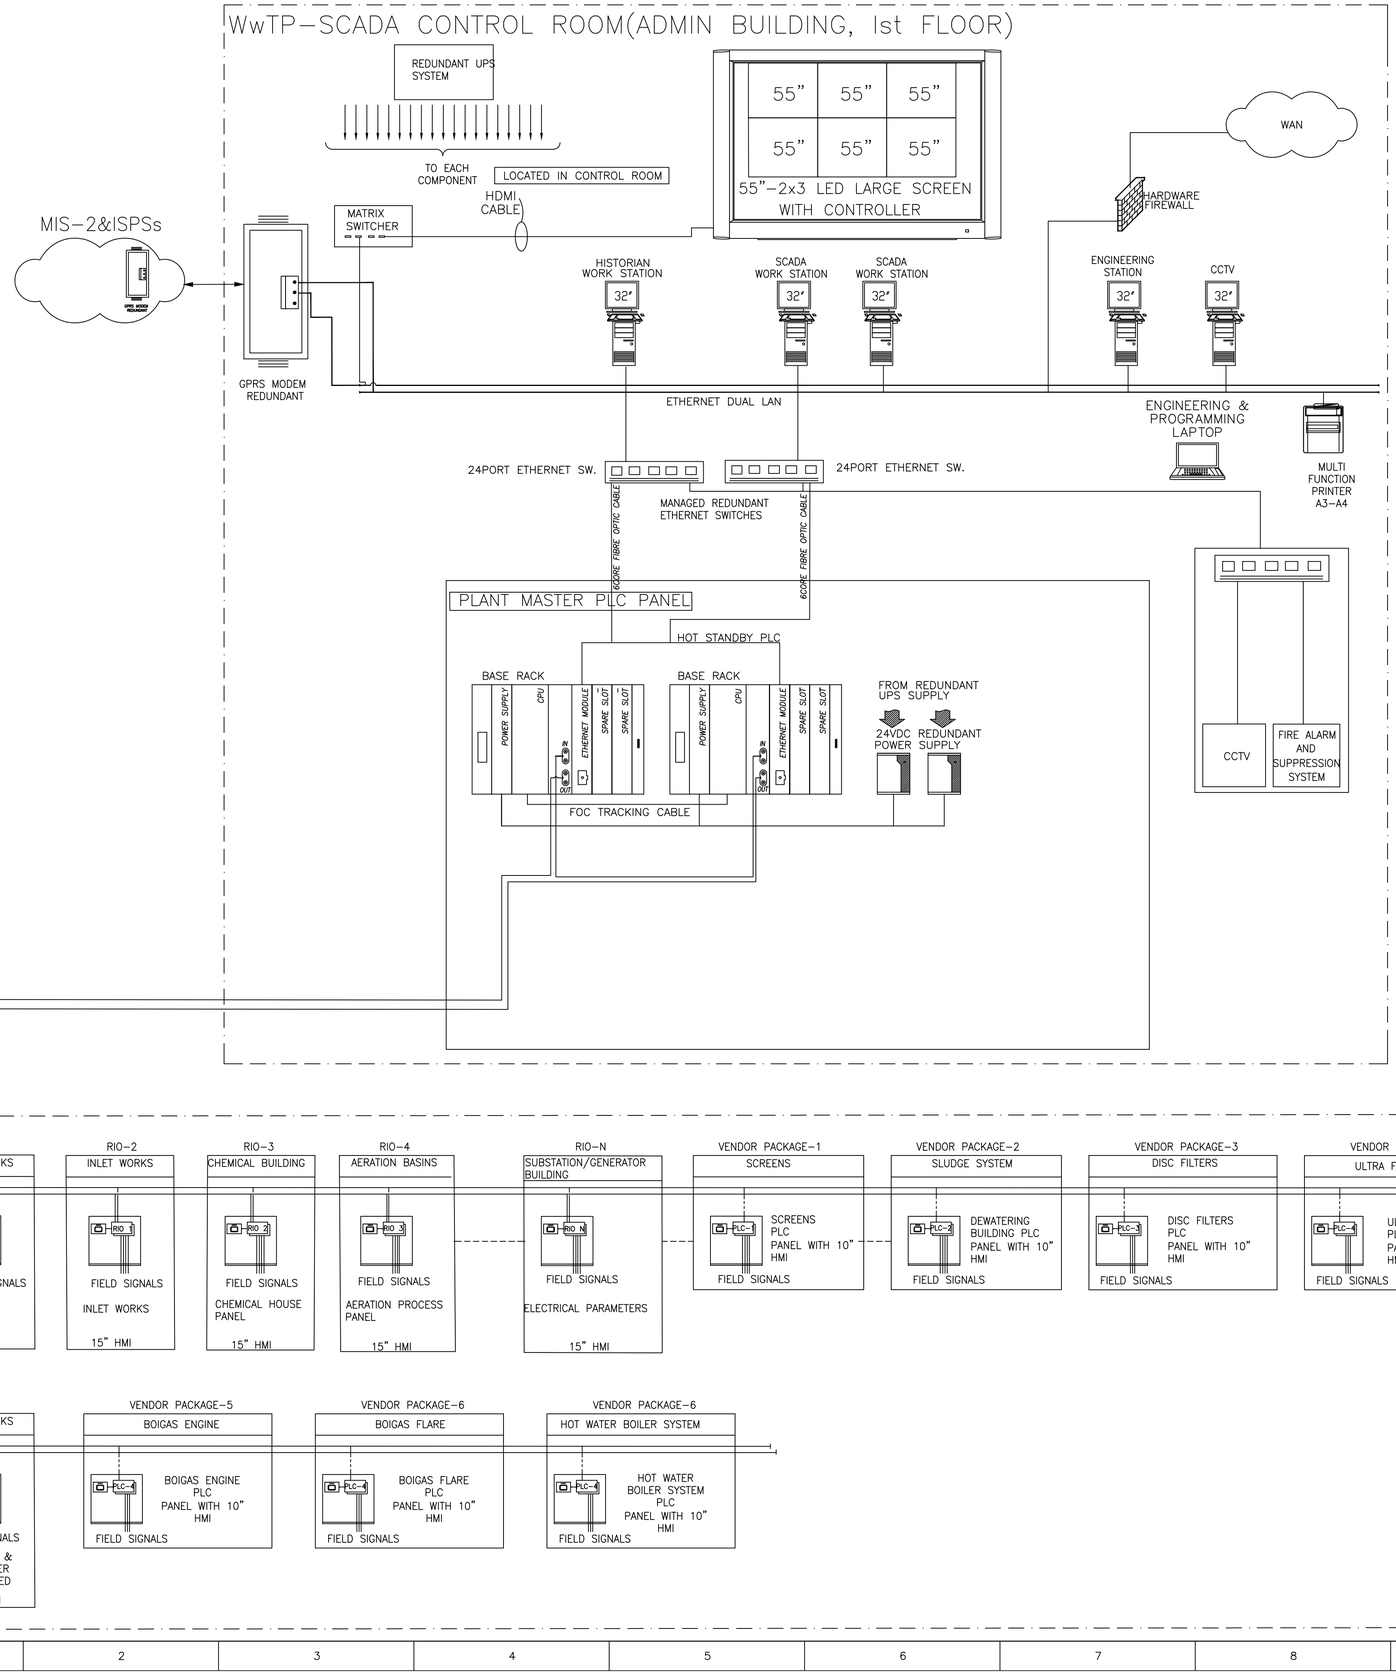

LEGEND:–

S.No.	SYMBOL	DESCRIPTION
1.	PLC	PROGRAMMABLE LOGIC CONTROLLER
2.	———	ETHERNET CABLE
3.	——–·——–·——	MODBUS RS485 CABLE
4.	═══	SINGLE MODE OPTICAL FIBER CABLE (OFC)–REDUNDANT MODE
5.	▬▬▬	SIGNAL CABLE
6.	———	HDMI CABLE
7.	SCADA	SUPERVISORY CONTROL AND DATA AQUISITION
8.	HMI	HUMAN MACHINE INTERFACE
9.	CCTV	CLOSED CIRCUIT TELEVISION
10.	CPU	CENTRAL PROCESSING UNIT
11.	UPS	UNINTERRUPTIBLE POWER SUPPLY
12.	WAN	WIDE AREA NETWORK
13.	LAN	LOCAL AREA NETWORK
14.	ODU	OUT DOOR DISPLAY UNIT
15.	OARM	ONLINE ANALYTICAL REAL TIME MULTIPARAMETERS
16.	KSPCB	KARNATAKA STATE POLLUTION CONTROL BOARD

NOTES:–

1. PLANT MASTER PLC SHALL BE HOT–STAND–BY CONFIGURATION[REDUNDANT CONTROLLERS, POWER SUPPLY & COMMUNICATION MODULES]
2. SCADA CONTROL ROOM SHALL BE LOCATED AT 1ST FLOOR OF ADMIN BUILDING.
3. REDUNDANT SCADA SERVERS SHALL BE CONFIGURED WITH HOTSTAND–BY CONTROLLERS
4. HISTORIAN SERVER (BLADE TYPE) SHALL BE CONFIGURED WITH SCADA SERVER AND THE SAME SHALL BE UTILIZED THROUGH HISTORIAN OPERATOR WORKSTATION FOR CONTINUOUS BACKUP & RETRIEVAL OF SCADA SERVER DATA
5. ALL RIO PANELS SHALL BE CONFIGURED THROUGH PLANT HOTSTAND–BY CONTROLLER THROUGH REDUNDANT OPTICAL FIBRE CABLE (OFC) UNDER RING NETWROK TOPOLOGY.
6. THE INPUT & OUTPUT (ANALOG / DIGITAL) MODULES SHALL BE AS REQUIRED SUBJECT TO APPROVED INPUT & OUTPUT(IO) SCHEDULE.
7. THE SPARE PHILOSOPHY FOR INPUT & OUTPUT (ANALOG/ DIGTAL) SHALL BE CONSIDERED AS 30% WHICH INCLUDES PANEL ACCESSERIES OF POTENTIAL FREE CONTACTS & TERMINAL BLOCKS– APPLICABLE FOR RIO PANELS AS WELL AS ANY SUB PROCESS SYSTEMS OF VENDOR PACKAGE PLC PANELS.
8. THE SPARE MEMORY FOR CONROLLERS SHALL BE 50% SPARE AS PROGRAM MEMORY AND DATA MEMORY
9. MULTI FUNCTION ENERGY METERS (MFMs) SHALL BE CONNECTED TO RESPECTIVE RIO PANEL THROUGH RS–485 CONNECTIVITY
10. FIRE ALARM SYSTEM & CLOSE CIRCUIT TELEVISION SYSTEMS SHALL BE INTERFACED WITH PLANT SCADA SYSTEMS.
11. 15" INCHES PANEL MOUNTED HMIs SHALL BE CONSIDERED FOR EACH RIO PANEL AND 10" INCHES PANEL MOUNTED HMIS SHALL BE CONSIDERED IN CASE OF ANY SUB PROCESS SYSTEMS OF VENDOR PACKAGE CONTROL SYSTEM
12. LARGE VIDEO SCREEN (55" led 2 X3 DISPLAY ARRAY) WITH REQUIRED CONTROLLER AND SOFTWARE FOR SCREEN SPLITTING BETWEEN VARIOUS LED ARRAY SCREENS WITH SCADA & CCTV SYSTEM FOR LIVE MONITORING OF SCADA & CCTV FEEDS. OPERATOR CAN ALSO BE ABLE TO CHANGE PLANT SCADA SCREENS IN LED ARRAYS AS PER HIS CONVINIENT WITH RESPECT TO BETTER OPERATIONAL POINT OF VIEW.
13. PLANT BULK DATA [COMPLETE PLANT OPERATIONAL DATA INCLUSIVE OF LAB DATA THROUGH LIMS] TO BE TRANSMITTED TO MIS–2 CENTRAL SCADA SYSTEM AT SHIMSHA BHAVAN THROUGH REDUNDANT GPRS COMMUNICATION MODULES THROUGH INTERFACE PANEL.
14. ONLINE ANALYTICAL REALTIME MULTIPARAMETER SHALL BE CONSIDERED FOR INLET & OUTLET OF WwTP AND THOSE READINGS TRANSMITTED TO KSPCB AS WELL AS PLANT SCADA SYSTEM.
15. THE VENDOR PLCs DATA SHALL BE INTERFACED WITH PLC / SCADA SYSTEM BY USING SERIAL COMMUNICATION FOR THE PURPOSE OF CONTINUOUS MONITORING & CONTROL.
16. The RIO Panel shall be applicable for any non–SBR Packages (i.e. Vendor Package PLC applicable for SBR Package)

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	MR	

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS (WORKS - A) AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS (WORKS - B) HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:

SCADA CONTROL SYSTEM ARCHITECTURE DRAWING FOR WwTP AT ANJANAPURA

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD (JV)

DESIGNED: MR	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: IC
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-IC-5006	ISSUE: P0
FILE NAME: TN–KWSDRP–WBS3–IC–5006.dwg		A1 SIZE

TITLE: SCADA CONTROL SYSTEM ARCHITECTURE DRAWING FOR WWTP AT ANJANAPURA

DWG NO: TN-KWSDRP-WBS3-IC-5006

TITLE: CONTROL SYSTEM ARCHITECTURE DRAWING FOR INTERMEDIATE SEWAGE PUMPING STATION (ISPS) AT GOTTIGERE

DWG NO: TN-KWSDRP-WBS3-IC-5011

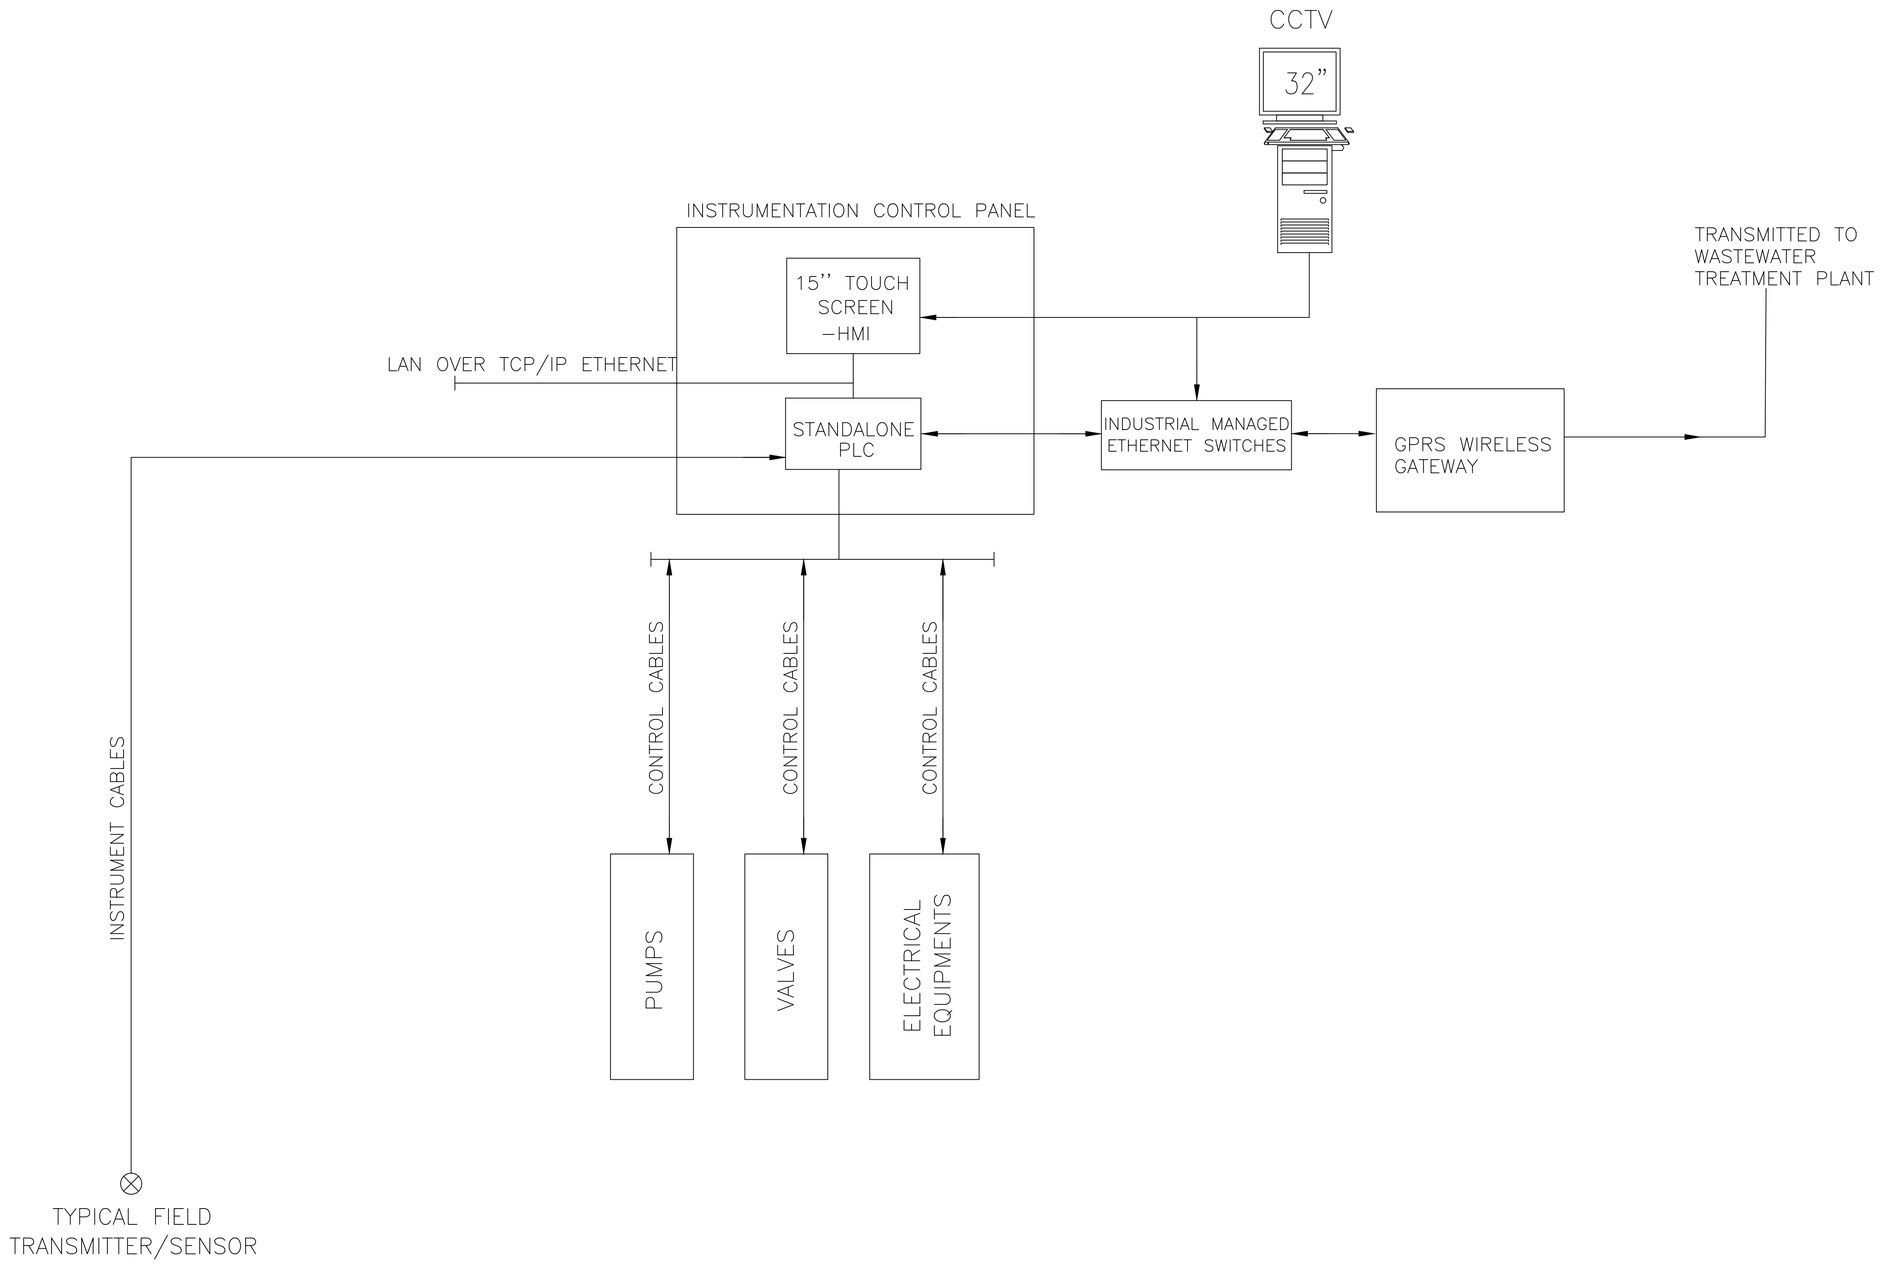

LEGENDS :

PLC – PROGRAMMABLE LOGIC CONTROLLER
GPRS – GENERAL PACKET RADIO SERVICE
ISPS – INTERMEDIATE SEWAGE PUMPING STATION

HMI – HUMAN MACHINE INTERFACE

NOTES :

1. The PLC shall be Standalone configuration installed under Internal Wiring Instrumentation Control Panel embedded with 15'' Panel Mounted Touch Screen HMI.
2. The ISPS PLC Data shall be integrated to respective STP for continuous monitoring by using GPRS wireless communication system.
3. The PLC/HMI System shall be proposed at Intermediate Sewage Pumping Station (ISPS) for the purpose of Automatic Operational requirement pertaining to Pumps sequence of Operation subject to Step Logic Level Control including all protection Interlocks.
4. The UPS system shall be applicable for back–up power supply requirement for entire Instrumentation, Control & Automation (ICA) equipment.

ISSUE	DATE	DESCRIPTION	BY	CHECKED	APPD.
T0	07/04/2025	FOR TENDER PURPOSE	SGS	MR	

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS (WORKS - A) AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS (WORKS - B) HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:
CONTROL SYSTEM ARCHITECTURE DRAWING FOR INTERMEDIATE SEWAGE PUMPING STATION (ISPS) AT GOTTIGERE

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD (JV)

DESIGNED: MR	APPROVED	DATE: (TO ISSUE) 07–04–2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 07–04–2025
CHECKED: BMS		DIVISION: IC
SCALE: NTS	DWG. NO. TN–KWSDRP–WBS3–IC–5011	ISSUE: P0
FILE NAME: TN–KWSDRP–WBS3–IC–5011.dwg		A1 SIZE

TITLE: CONTROL SYSTEM ARCHITECTURE DRAWING FOR INTERMEDIATE SEWAGE PUMPING STATION (ISPS) AT VAKIL GARDEN

DWG NO: TN-KWSDRP-WBS3-IC-5012

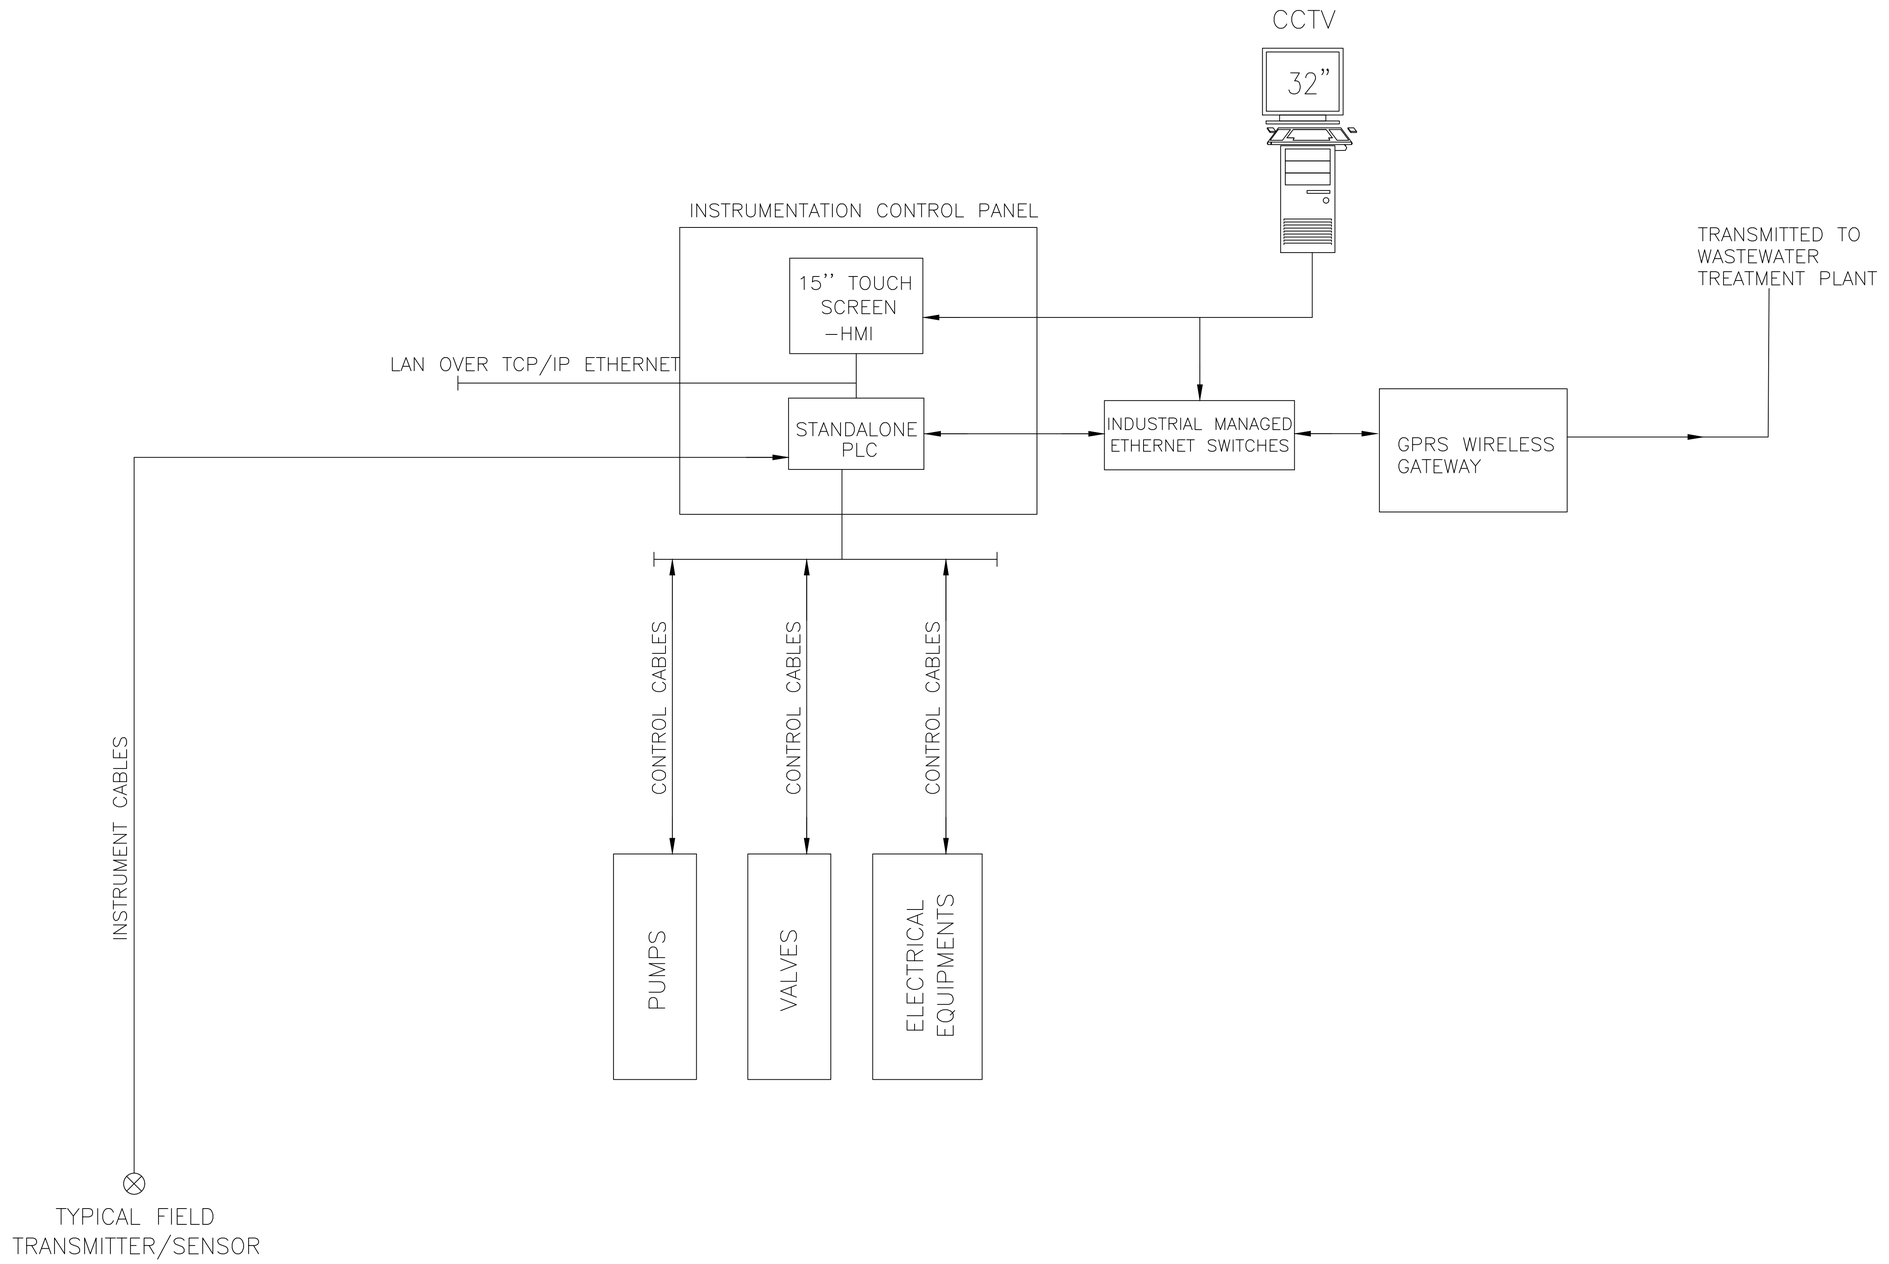

LEGENDS :

PLC – PROGRAMMABLE LOGIC CONTROLLER
GPRS – GENERAL PACKET RADIO SERVICE
ISPS – INTERMEDIATE SEWAGE PUMPING STATION

HMI – HUMAN MACHINE INTERFACE

NOTES :

1. The PLC shall be Standalone configuration installed under Internal Wiring Instrumentation Control Panel embedded with 15'' Panel Mounted Touch Screen HMI.
2. The ISPS PLC Data shall be integrated to respective STP for continuous monitoring by using GPRS wireless communication system.
3. The PLC/HMI System shall be proposed at Intermediate Sewage Pumping Station (ISPS) for the purpose of Automatic Operational requirement pertaining to Pumps sequence of Operation subject to Step Logic Level Control including all protection Interlocks.
4. The UPS system shall be applicable for back–up power supply requirement for entire Instrumentation, Control & Automation (ICA) equipment.

ISSUE	DATE	DESCRIPTION	BY / CHECKED	APPD.
T0	07/04/2025	FOR TENDER PURPOSE	SGS / MR / IC	

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS [WORKS - A] AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS [WORKS - B] HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-P/KWSDRP/WBS-3)

TITLE:
CONTROL SYSTEM ARCHITECTURE DRAWING FOR INTERMEDIATE SEWAGE PUMPING STATION (ISPS) AT VAKIL GARDEN

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD (JV)

DESIGNED: MR	APPROVED	DATE: (TO ISSUE) 07–04–2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 07–04–2025
CHECKED: BMS		DIVISION: IC
SCALE: NTS	DWG. NO. TN–KWSDRP–WBS3–IC–5012	ISSUE: P0
FILE NAME: TN–KWSDRP–WBS3–IC–5012.dwg		A1 SIZE

TITLE: TYPICAL MECHANICAL GA DRAWING FOR LIFT PUMPING STATION

DWG NO: TN-KWSDRP-WBS3-ME-6000

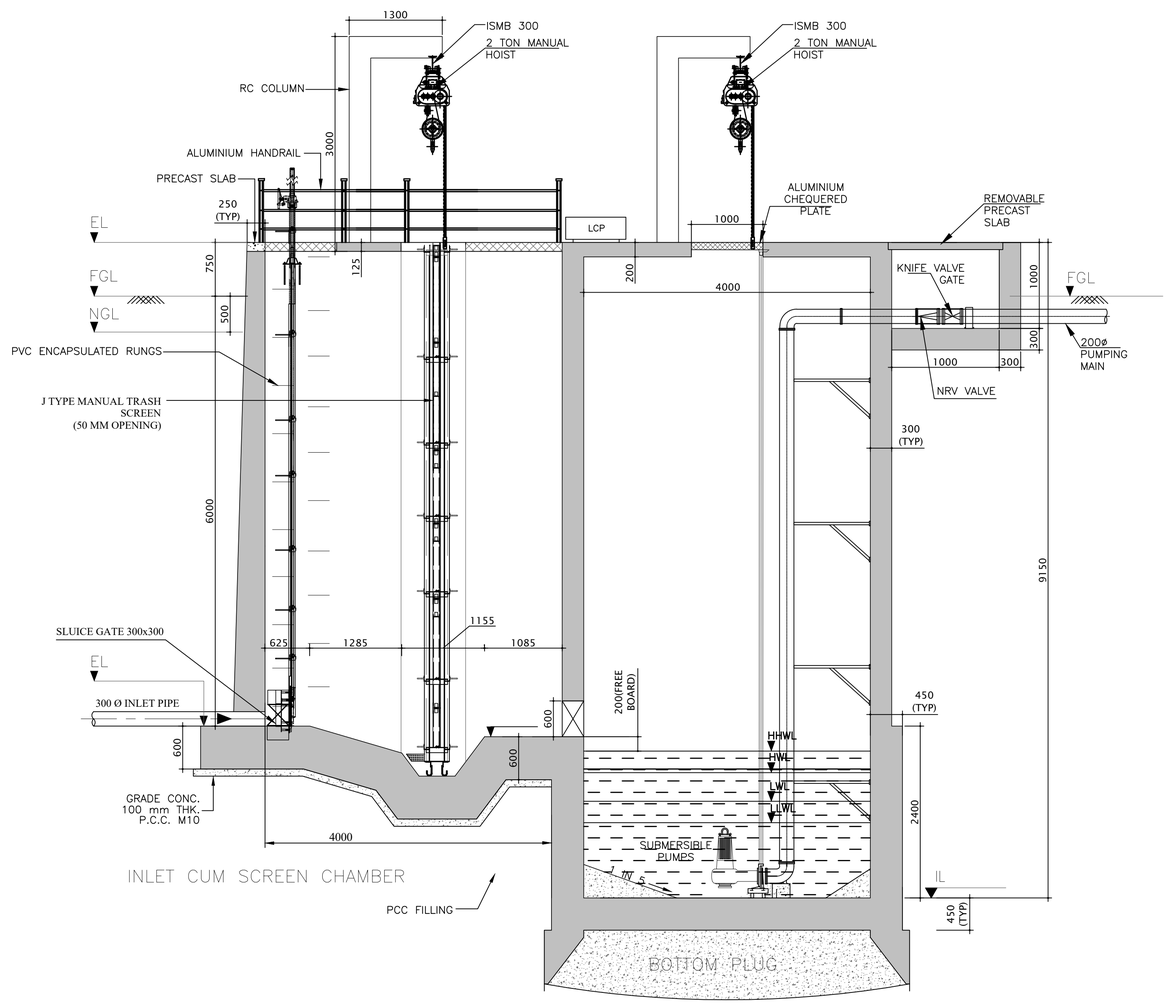

SECTIONAL ELEVATION X–X

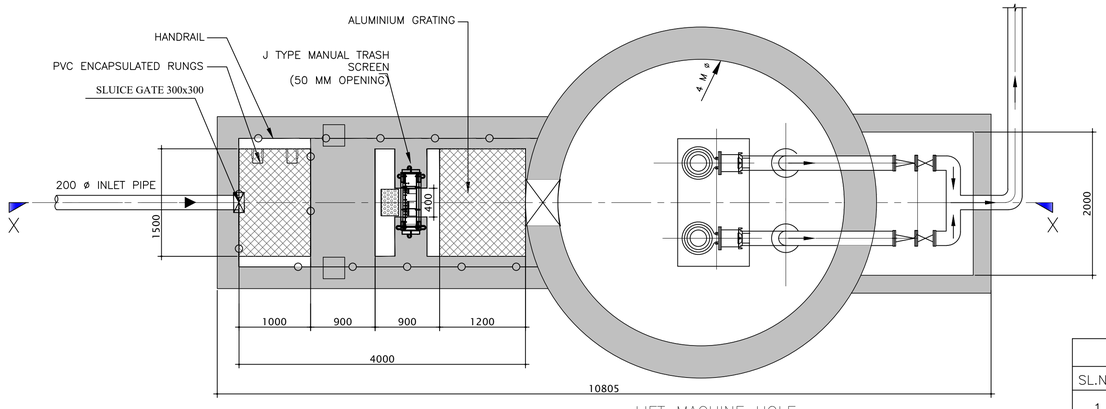

SECTIONAL PLAN

NOTE :

1. ALL DIMENSIONS ARE IN mm AND LEVELS ARE IN m.
2. AREA OF LAND ALLOCATED FOR LPS=12m L X 8m W.
3. SBC=200 kN/m^2 @ 6m BELOW NGL AND 250 kN/m^2 @ 9m BELOW NGL.
4. CEMENT USED SHALL BE SRPC.
5. CRS BARS CONFIRMING TO IS 1786 TO BE USED.
6. PROTECTIVE COATINGS 500MICRONS TO BE PROVIDED FOR INSIDE SURFACES.
7. SS304 HANDRAILS AND CHEQUERED PLATES SHALL BE IN ALUMINIUM

MECHANICAL EQUIPMENT LIST

SL.NO	EQUIPMENT NAME	CAPACITY	TYPE	QUANTITY	REMARKS
1	LPS pumps	AS PER BID SPECIFICATION AND BOQ	Non clog Submersible	2	
2	Manual monororail hoist (Trash Screens)			1	
3	Trash Screens		J Type Manual Trash Screens	1	

ISSUE	DATE	DESCRIPTION	BY	MECH.	CIVIL	CHECKED	APPD.
P0	02/04/2025	FOR TENDER PURPOSE	SGS	AM	MKV		

FOR TENDER PURPOSE ONLY

BANGALORE WATER SUPPLY AND SEWERAGE BOARD
KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAMME (KWSDRP) FUNDED BY WORLD BANK

DESIGN, ENGINEERING, CONSTRUCTION AND COMMISSIONING OF WASTEWATER TREATMENT PLANTS WITH TERITIARY TREATMENT FACILITY, BIOGAS GENERATION & SOLAR SLUDGE DRYING BED AND INTERMEDIATE SEWAGE PUMPING STATION ALONG WITH OPERATION & MAINTENANCE THEREOF FOR TEN YEARS (WORKS - A) AND PROCUREMENT AND CONSTRUCTION OF RISING MAIN, MAIN SEWERS AND LATERALS INCLUDING MACHINE HOLES AND LIFT SEWAGE PUMPING STATIONS (WORKS - B) HYBRID MODE FOR BOMMANAHALLI ZONES IN 110 VILLAGE AREAS (PHASE II) UNDER KARNATAKA WATER SECURITY AND DISASTER RESILIENCE PROGRAM (KWSDRP) - (CONTRACT PACKAGE NO. BWSSB CE-PKWSDRP/WBS-3)

TITLE: TYPICAL MECHANICAL GA DRAWING FOR LIFT PUMPING STATION

PROJECT MANAGEMENT CONSULTANTS:
TATA CONSULTING ENGINEERS LTD
NJS ENGINEERS INDIA PVT. LTD(JV)

DESIGNED: AM	APPROVED	DATE: (TO ISSUE) 02/04/2025
DRAWN: SGS		DATE:(CURRENT ISSUE) 02/04/2025
CHECKED: BMS		DIVISION: ME
SCALE: NTS	DWG. NO. TN-KWSDRP-WBS3-ME-6000	ISSUE: P0
FILE NAME: TN–BWSSB–CP–ME–6000.dwg		A1 SIZE